

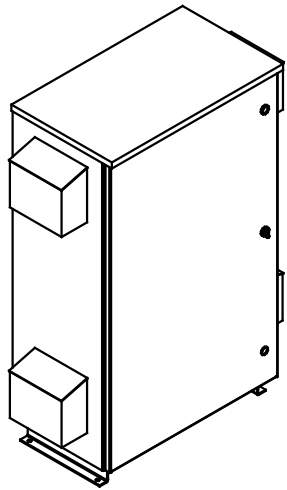


SEE DWG# 26757 FOR SCHEMATIC

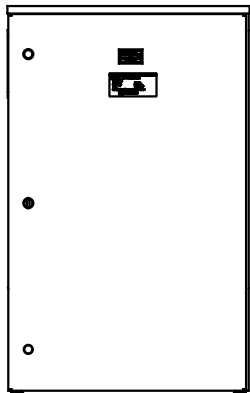


CUSTOMER IS RESPONSIBLE FOR INSTALLATION TO MEET ALL NATIONAL AND LOCAL ELECTRICAL CODES.


NOTE: USE ONLY HUBS OR FITTINGS THAT COMPLY WITH UL514B FOR TYPE 3R ENCLOSURES.

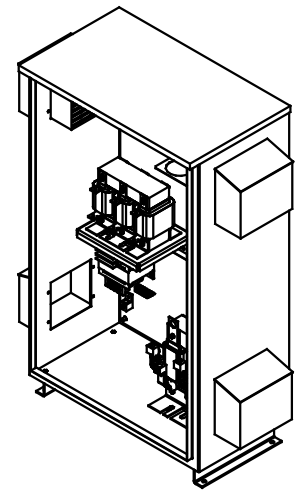


INSIDE DOOR

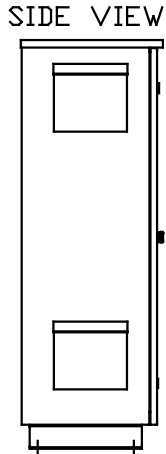



SIDE VIEW

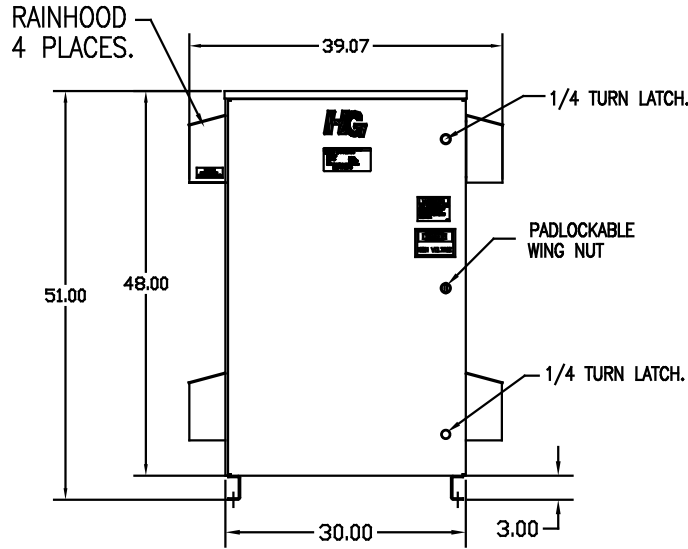

FRONT VIEW WITH DOOR

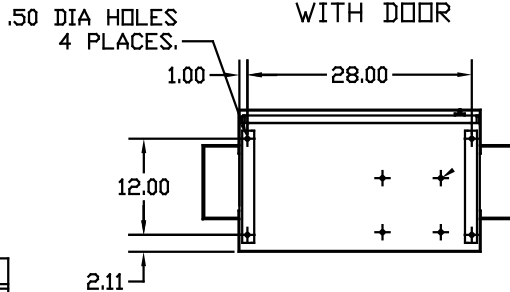

FRONT VIEW WITHOUT DOOR

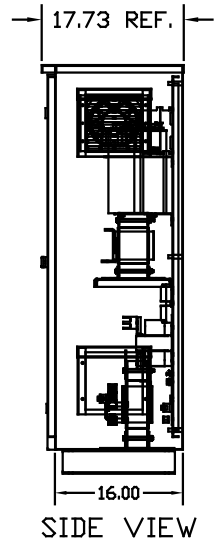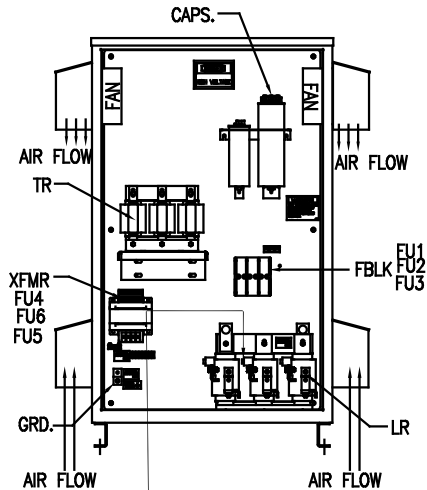

SIDE VIEW

SYMBOL	TCI PART NUMBER
LR	KDRL2T
TR	KTR45A65HGX1
CAP.1, CAP.2	KCAP20A6B
CAP.3	KCAP5A6A
XFMR.	23899
Fu1,2,3	11077
Fu4,6	14106
Fu5	23977

L1 L2 L3 T1 T2 T3

SUGGESTED CUSTOMER WIRE ENTRY AND EXIT LOCATION

GROUND LUG:
WIRE RANGE- 250MCM-6
TIGHTENING TORQUE 275 IN-LB.

CUSTOMER CONNECTIONS
WIRE RANGE- 250MCM-6
TIGHTENING TORQUE 275 IN-LB.

UNIT SPECIFICATIONS:

KVAR	HARMONIC	VOLT	HZ	PHASE	HP
45	5TH	480	60	3	150
ENCLOSURE		TYPE 3R- COLOR, WHITE			
APPROX.WT. LBS		400			

NO	REVISION	DATE	BY	TOLERANCES EXCEPT AS NOTED	SCALE	DATE	APPROV	DWG. NO.	REV. NO.
				XX ±.12 .XXX±.06 FRACTIONAL ± 1/32 ANGULAR ± 1/2°	TO FIT	09/12/08	DSW	103622DG	1

7878 N. 86th STREET
MILWAUKEE, WI 53224

HG150AW03ST, 150HP
480/3/60 UL TYPE 3R

SCALE TO FIT