




LABEL PLACED ON INSIDE WALL OF CABINET.

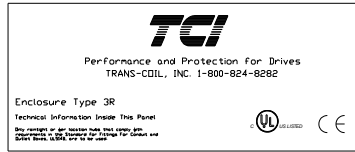

LABEL PLACED ON FRONT OF CABINET.

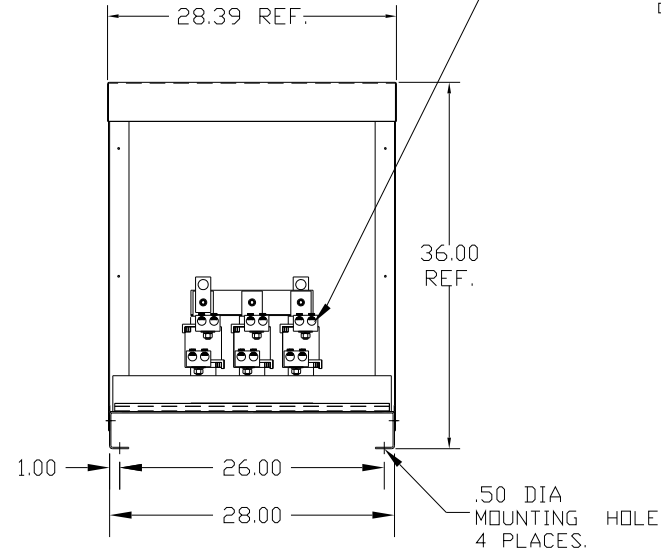

NOTE: ROTATED AS NEEDED TO MEET CLEARANCE BETWEEN TERMINAL OR LUGS (PHASE TO PHASE). ALSO TO MEET CLEARANCE FROM TERMINALS OR LUGS TO GROUNDING SURFACE.

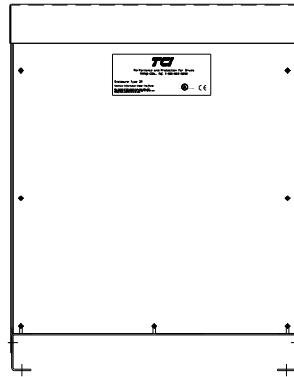


CATALOG NO	VOLTAGE	NEC MOTOR HP	NEC MOTOR CURRENT	WATTS LOSS	APPROX. WEIGHT-LBS
KDRULS46HE3R	575/600	500	472	661	345

NOTE 1: WATTS LOSS WILL VARY DUE TO FUNDAMENTAL FREQUENCY, CARRIER FREQUENCY AND OTHER SYSTEM CHARACTERISTICS.

KDR DRIVE REACTORS COMPLY WITH THE THERMAL AND ALTITUDE STANDARDS SET FORTH BY NEMA ST20-1992..

NEC MOTOR CURRENTS SHOWN IN THE 208/240 VOLT CHART ARE BASED ON HORSEPOWER AT 208 VOLT. 575/600 VOLT CHART USE THE 575 VOLT CURRENT RATING.

LUG WIRE RANGE TWO 600MCM-2, AL. OR CU. FOR REACTOR.  
TIGHTENING TORQUE. 500 LB-IN

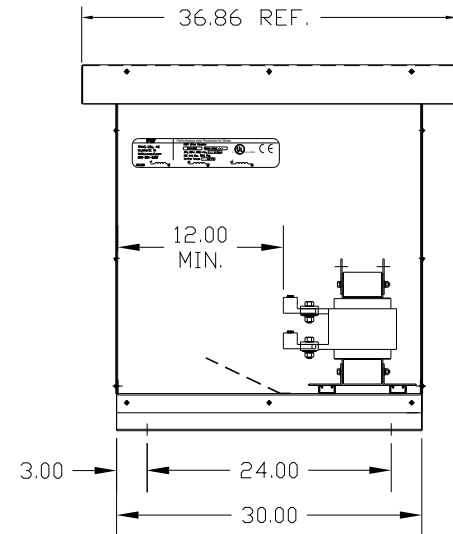

				TOLERANCES (EXCEPT AS NOTED)		7878 N. 86th STREET MILWAUKEE, WI 53224		
				DECIMAL	FRACTIONAL			
				.XX ± .03	± 1/32	KDR FRAME S (ILSCO LUGS) TYPE 3R ENCLOSURE		
				.XXX ± .01	ANGULAR ± 1/2°			
NO	REVISION	DATE	BY			DRN BY DSW SCALE TO FIT	DATE 09/22/04 APPRVD.	DWG. NO. B KDRSE3R-1DG SHT. 1 OF 1