
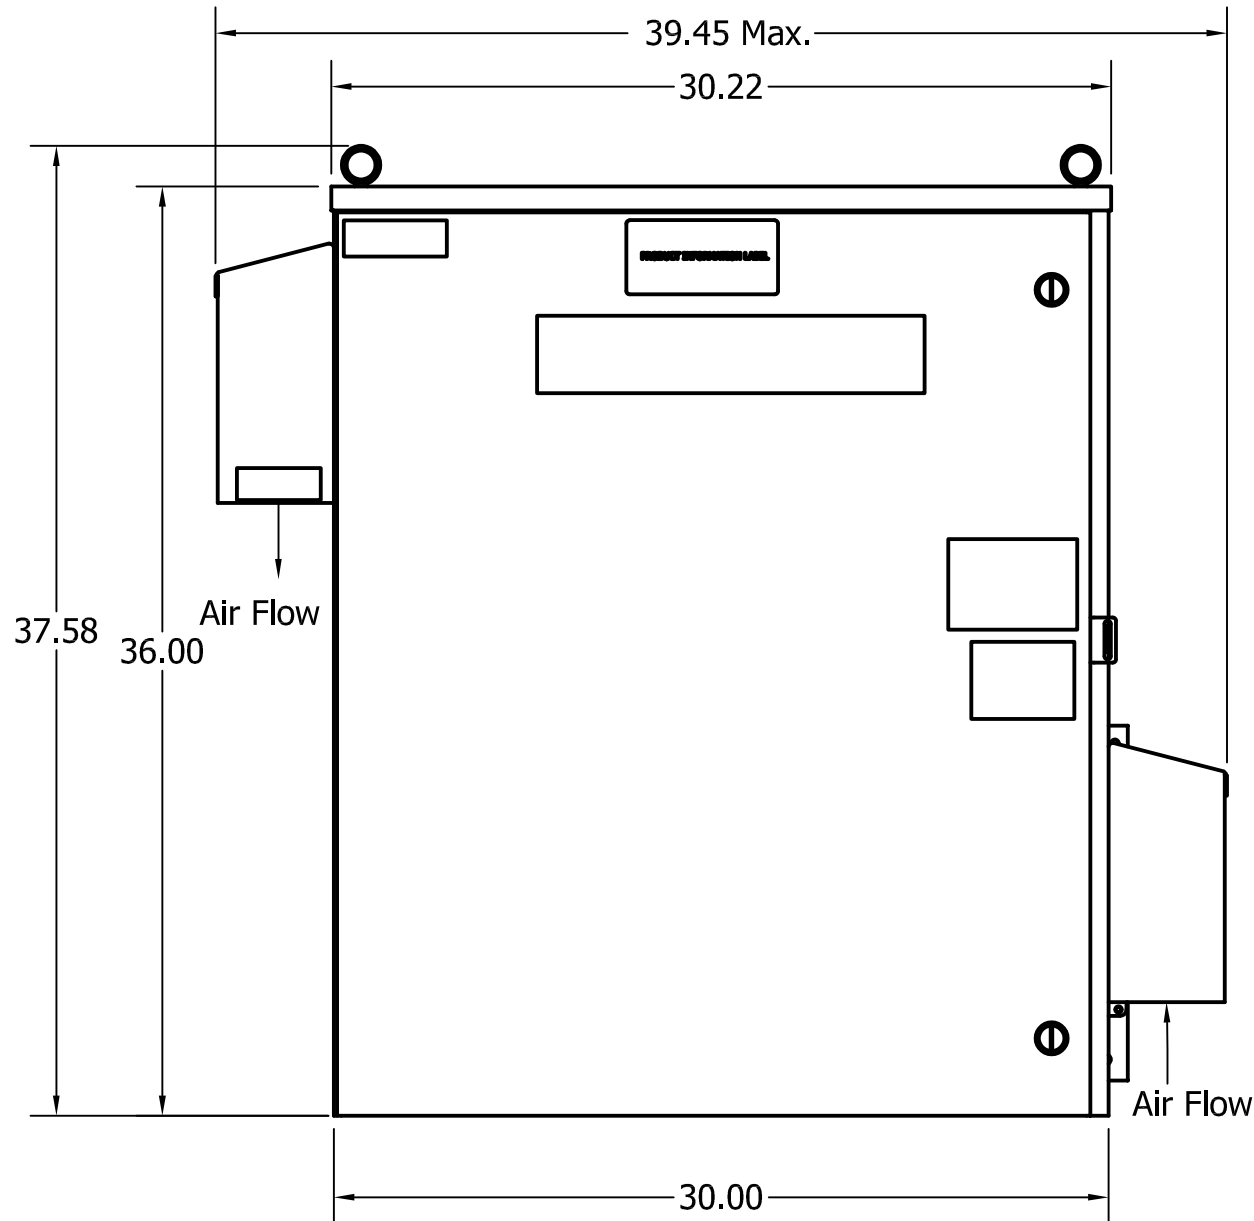







Alternate Rain Hood Construction.

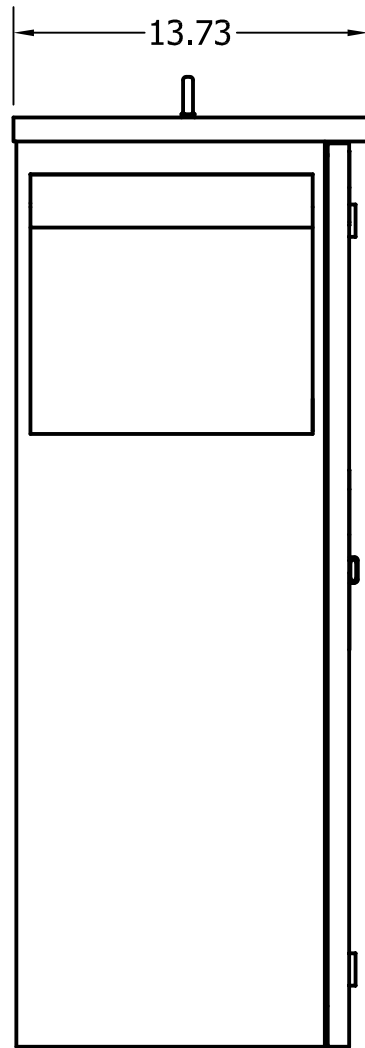

Unit Specifications					
kVar	Harmonic	Volt	HZ.	Phase	HP
15	5TH	480	60	3	100

TCI Part Number	Option	Weight	Schematic
HGL0100AW3S0000	Standard	270lbs	30586-1
HGL0100AW3C0000	Contactors	271lbs	30586

See IOM Manual For Wire Range And Tightening Torque.

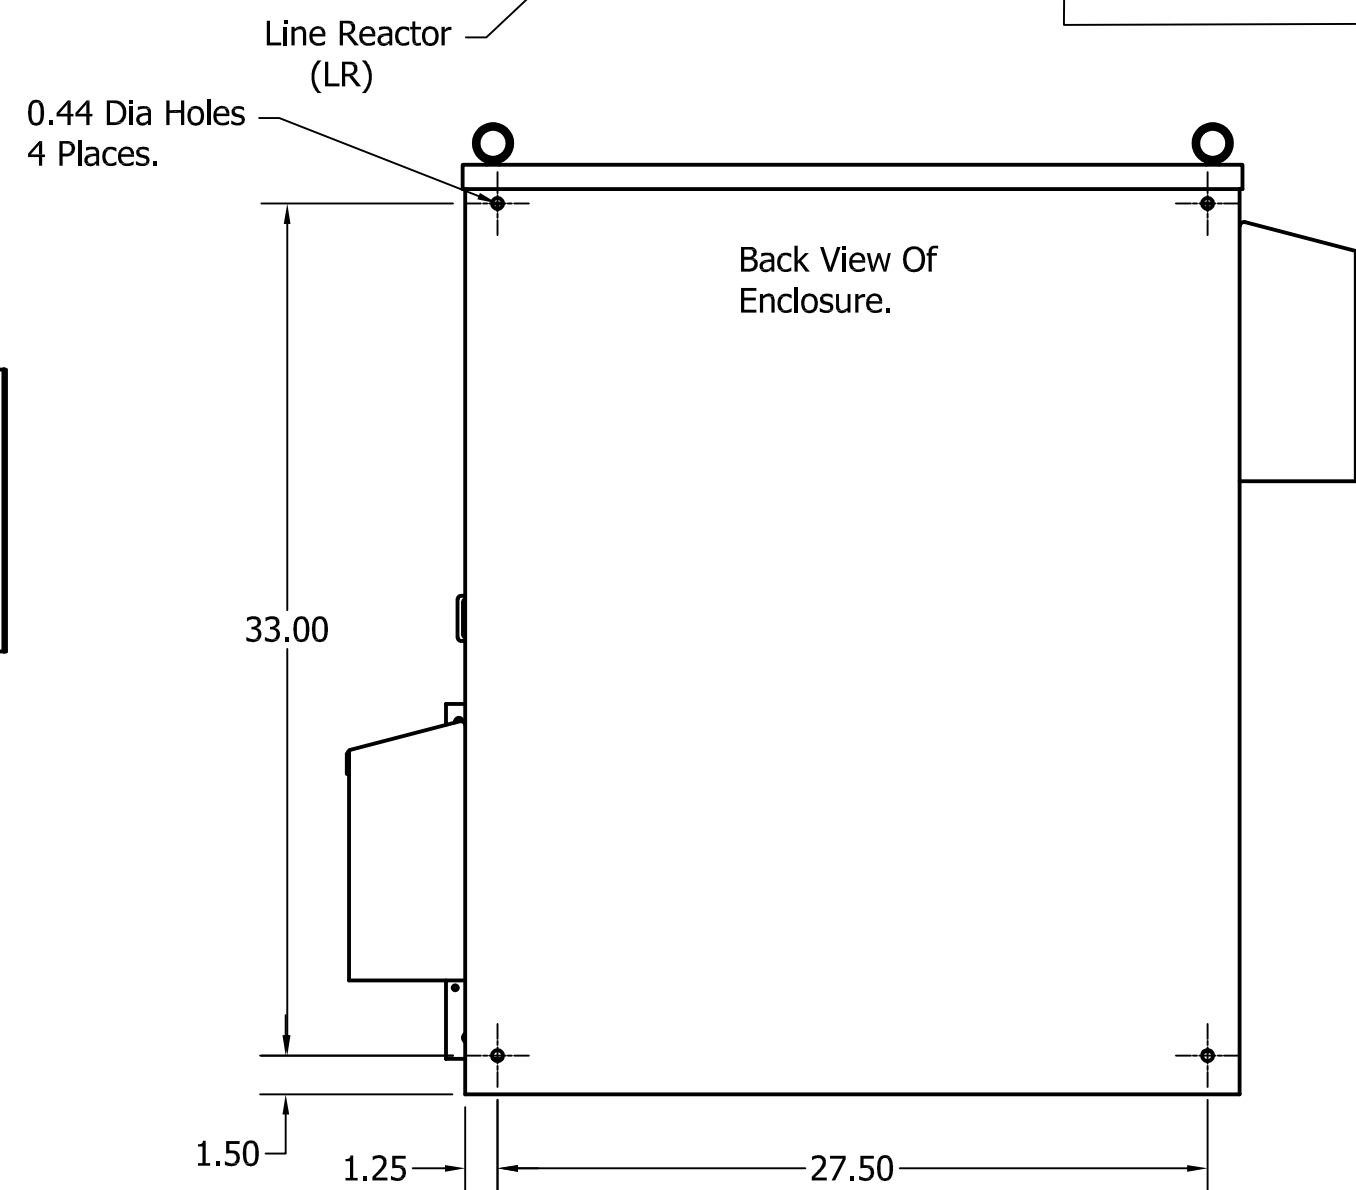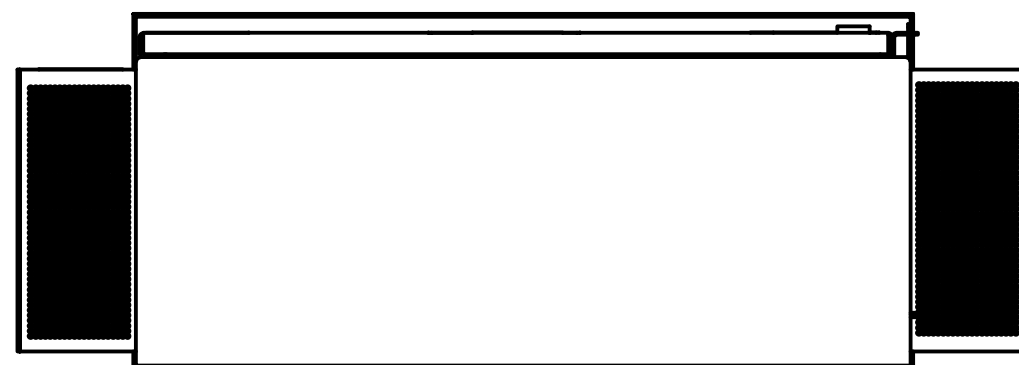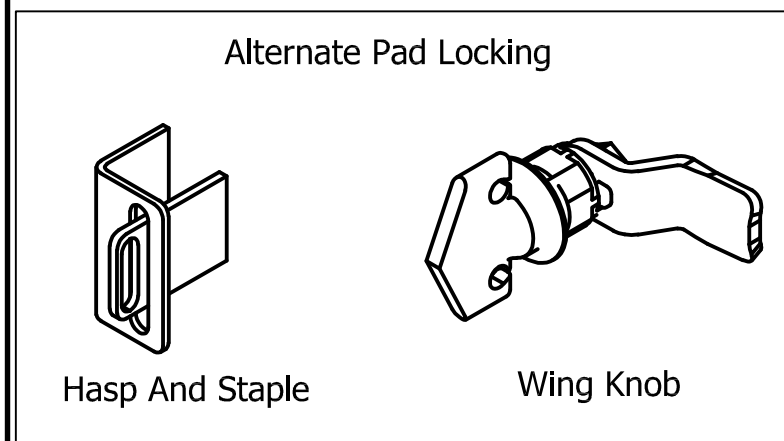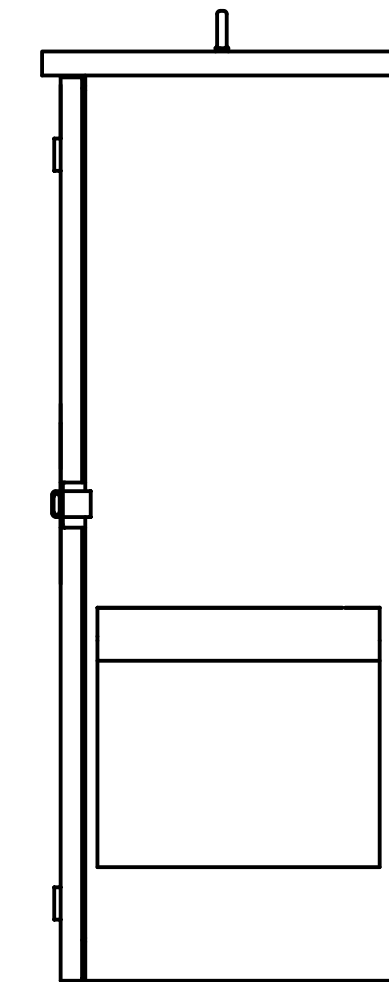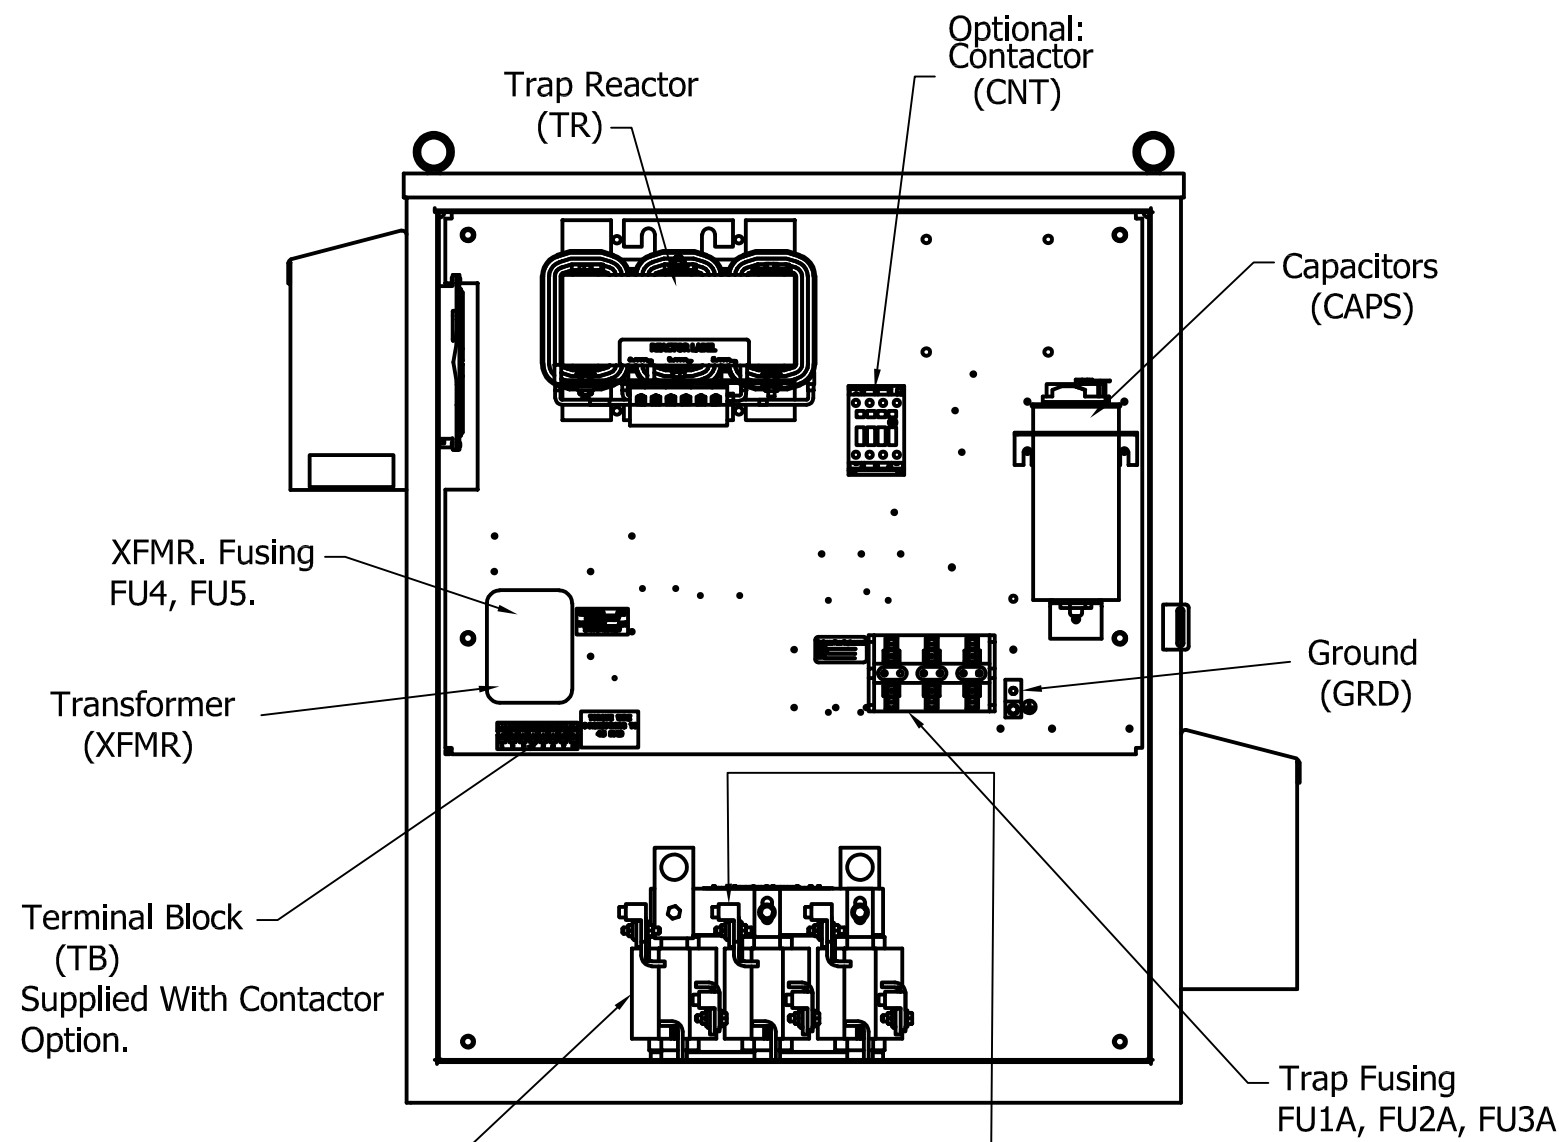

Suggested Customer Enclosure Entry.

Customer Connection  
L1 L2 L3  
T1 T2 T3

CUSTOMER IS RESPONSIBLE FOR INSTALLATION TO MEET ALL NATIONAL AND LOCAL ELETRICAL CODES.

NOTE: USE ONLY HUBS OR FITTINGS THAT COMPLY WITH UL514B FOR TYPE 3R ENCLOSURES

Material(s) Shall be RoHS Compliant

TCI, LLC CLAIMS PROPRIETARY RIGHTS IN THE MATERIAL HEREIN DISCLOSED. IT IS SUPPLIED WITHOUT PREDJUDICE TO ANY PATENT RIGHTS OF TCI AND MAY NOT BE REPRODUCED OR USED TO MANUFACTURE ANYTHING SHOWN THEREIN WITHOUT WRITTEN PERMISSION FROM TCI.

NO	REVISION	DATE	BY	SCALE
A	AS DESIGNED	5/31/17	DSW	ANGULAR +/- 1°

	W132 N10611 Grant Drive Germantown, WI 53022	
	HGL0100AW3C0000, 480V, 100HP, 3 Phase HGL0100AW3S0000, 480V, 100HP, 3 Phase 60 Hz, Type 3R, Low C, Passive Harmonic Filter	
DRN. BY DSW	DATE 5/31/17	DWG. No. 107032DG
SCALE 1/8	APRVD.	SHEET 1 OF 1