

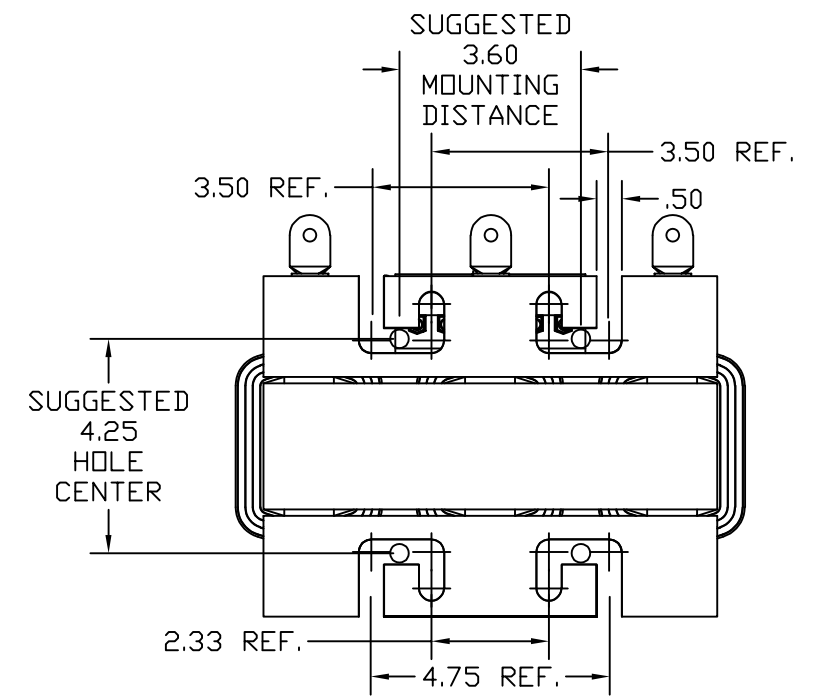
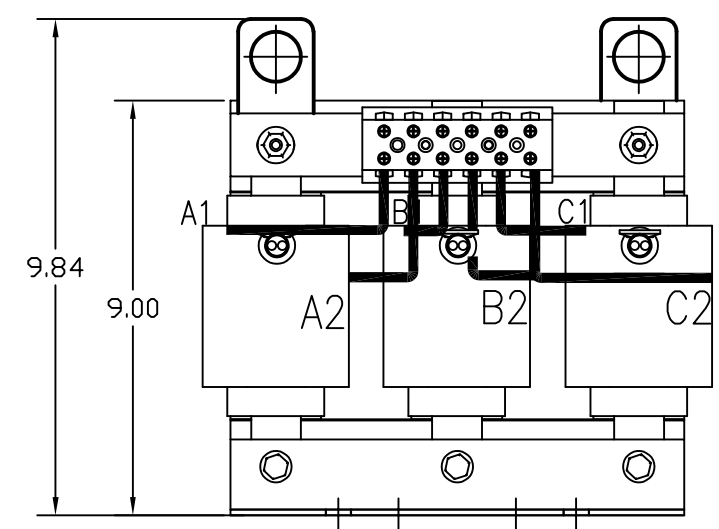
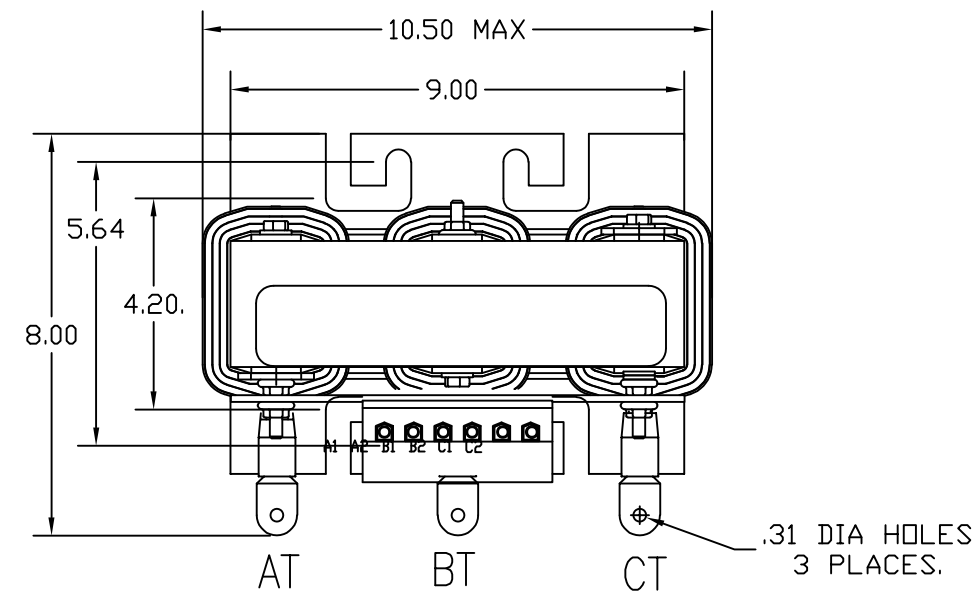


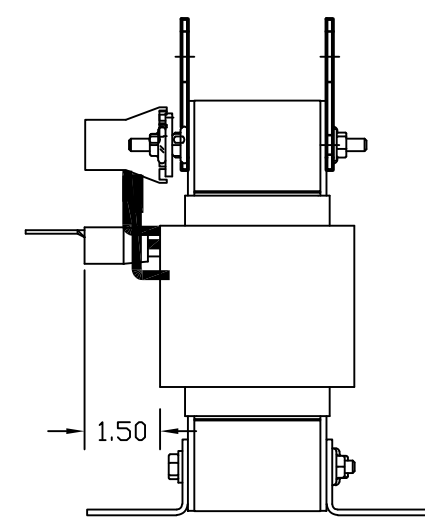

HP	CATALOG NO	MEASURED GAP	GAP ITEM #	RATED __AMPS(A)	MAX __AMPS(A)	APPROX WT-LBS
50	KDRG41TT	0.063	13, 14	38.66	52	60

TERMINAL BLOCK TORQUE(LB-IN)=CUSTOMER WIRE
35 = 1 AWG THRU 4 AWG 30 = 6 AWG THRU 14 AWG 25 = 16 AWG THRU 20 AWG 20 = 22 AWG

NOTE: A1, AT A2, B1, BT, B2, C1, CT C2, TERMINAL BLOCK AND COIL FOR REFERENCE ONLY.

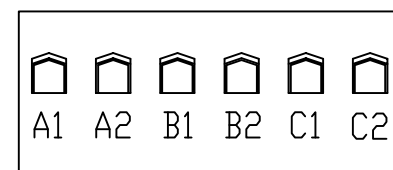

THE INFORMATION AND DESIGNS CONTAINED IN THIS DRAWING ARE CONFIDENTIAL AND THE PROPRIETARY PROPERTY OF ALLIED MOTION TECHNOLOGIES INC. AND ITS SUBSIDIARIES. NEITHER THIS DESIGN NOR ANY INFORMATION CONTAINED IN THIS DRAWING MAY BE REPRODUCED OR DISCLOSED TO OTHERS WITHOUT THE EXPRESS WRITTEN CONSENT OF ALLIED MOTION TECHNOLOGIES INC. AND ITS SUBSIDIARIES.

				TOLERANCES (EXCEPT AS NOTED)
				DECIMAL
				.XX ±.25
				.XXX±.10
				FRACTIONAL ± 1/16
△	Added lift rings	2/1/23	JSG	ANGULAR ± 1°
NO	REVISION	DATE	BY	

W132 N10611 Grant Drive
Germantown, WI 53022
© TCI, 2021

KDRG41TT, 50 HP
HGP FILTER REACTOR

DRN. BY	DSW	DATE	5/30/14	DWG. NO.	105666DG
SCALE	TO FIT	SIZE	B		SHT.1 OF1