

See V1K Installation Guide For Terminal Wire Size And Torque Information.





Note: Maintain Clearance of 3 Inches On All Sides To Other Equipment.

Suggested Customer Entrance (Bottom Entry)

Suggested Customer Entrance (Either Side)

| V1K Part Number | Max Voltage | Amps | Phase | Weight (LBS) |
|-----------------|-------------|------|-------|--------------|
| V1K130A01* | 600 | 130 | 3 | 75 |
| V1K130A01EX* | 600 | 130 | 3 | 75 |

* = (Blank) - No Thermal Switch
 * = T - Thermal Switch Option

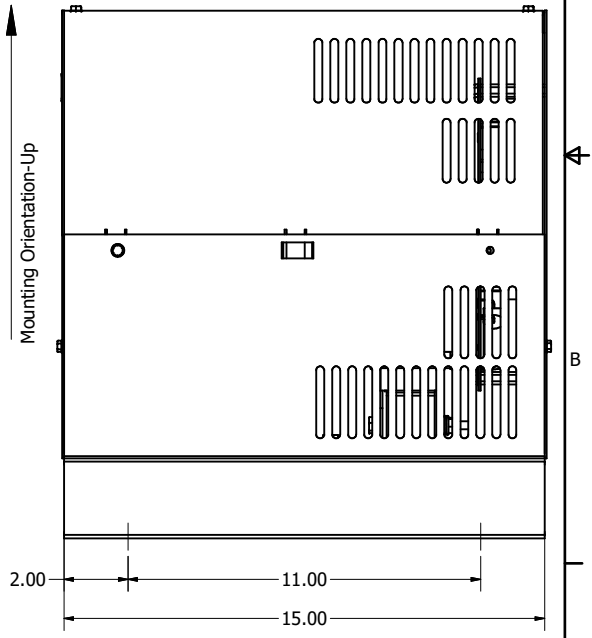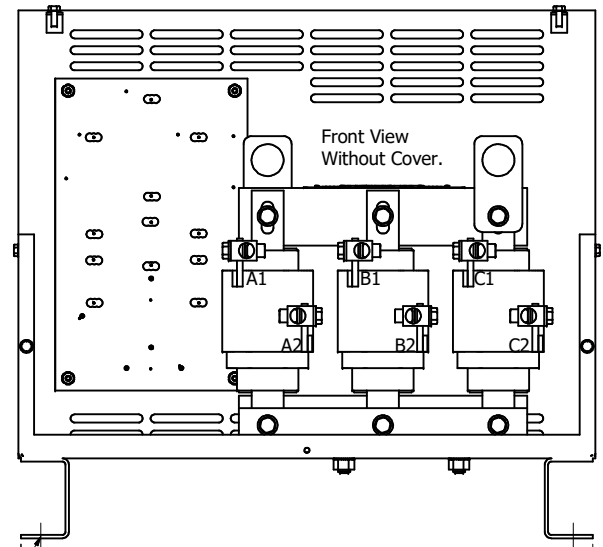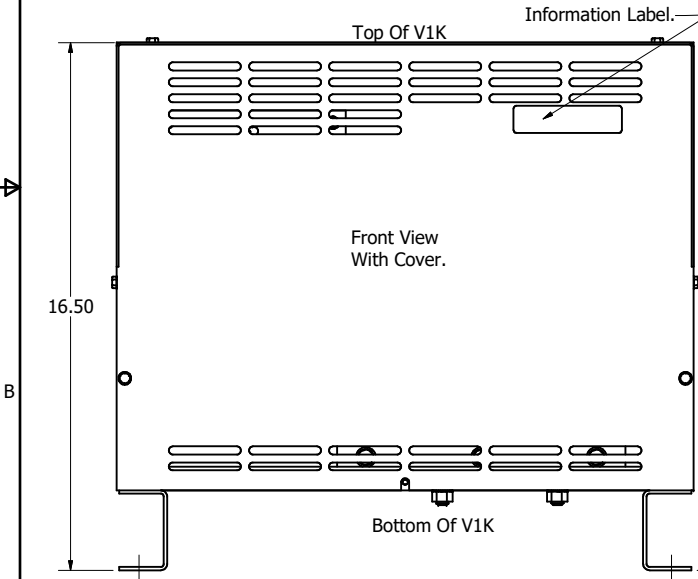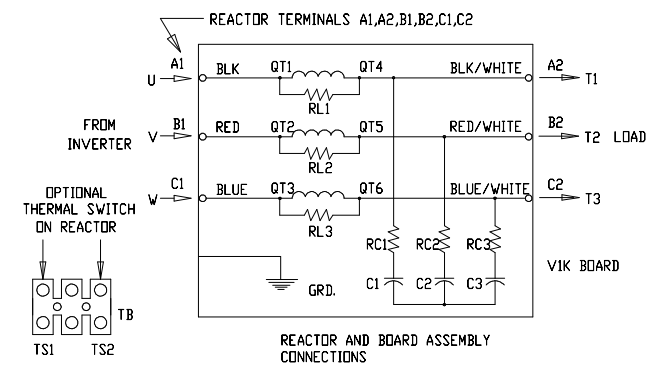

0.41 Dia Mounting Holes
4 Places.

16.61
17.85

(Customer Connections)
Markings On Coil
For Reference Only.

Customer Is Responsible For Installation To Meet All National And Local Electrical Codes.

Material(s) Shall be RoHS Compliant

| | | | | | | | | | | | |
|------------------------------|-------------------------|--|---------------------------|-------------|---------|------------|------------------------------------|--------|----------|------|--------|
| TOLERANCES (EXCEPT AS NOTED) | | THE INFORMATION AND DESIGNS CONTAINED IN THIS DRAWING ARE CONFIDENTIAL AND THE PROPRIETARY PROPERTY OF ALIENT INC. AND ITS SUBSIDIARIES. NEITHER THIS DESIGN NOR ANY INFORMATION CONTAINED IN THIS DRAWING MAY BE REPRODUCED OR DISCLOSED TO OTHERS WITHOUT THE EXPRESS WRITTEN CONSENT OF ALIENT INC. AND ITS SUBSIDIARIES. | | DESIGNED BY | DATE | REVISED BY | DATE | SCALE | TO | SIZE | SHEET |
| DECIMAL | .XX ± .25 .XXX ± .10 | H | 6535 Termination to 32766 | DSW | 4/26/17 | G | 6391, Inductor Updated | TO FIT | 102408DG | C | 1 OF 1 |
| FRACTIONAL | ± 1/32 | F | 4658 Rated To Max Voltage | | | J | 4030, Combine, Update V1K Drawings | | | | |
| ANGULAR | ± 1° | E | REVISION | | | | | | | | |



W132N10611 Grant Drive
Germantown, WI 53022
© 2024 Allient Inc.