



See V1K Installation Guide For Terminal Wire Size And Torque Information.

Note: Maintain Clearance of 3 Inches On All Sides To Other Equipment.



V1K Part Number	Max Voltage	Amps	Weight (LBS)
V1K200A01*	600	200	65

* = (Blank) - No Thermal Switch
* = T - Thermal Switch Option



Optional Thermal Switch On Reactor

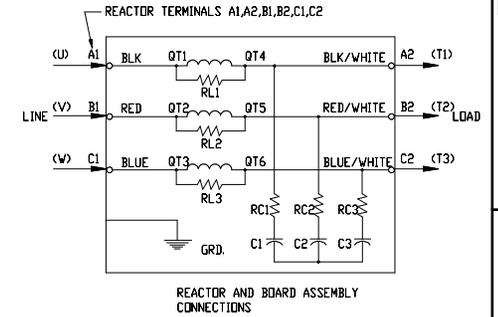

Optional Thermal Switch Terminal Block (TB) (0.38-16, Ground Stud.) Information Label

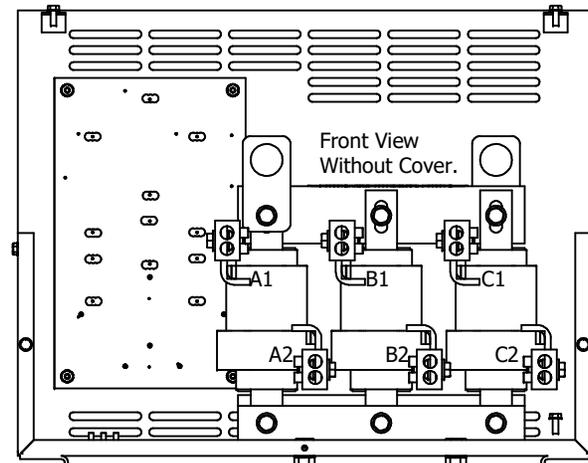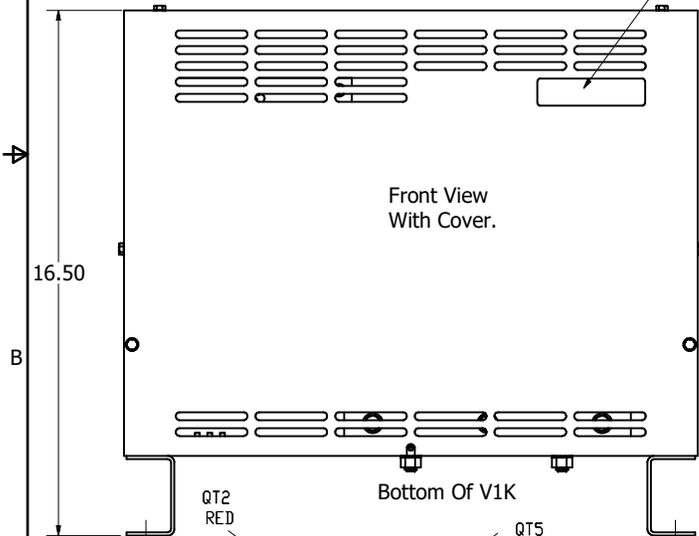

(Customer Connections) Markings On Coil For Reference Only.

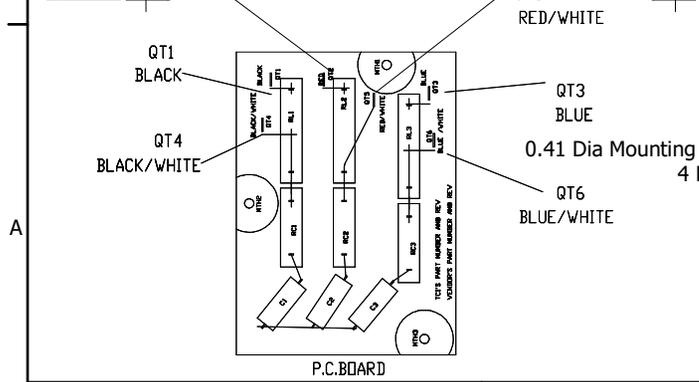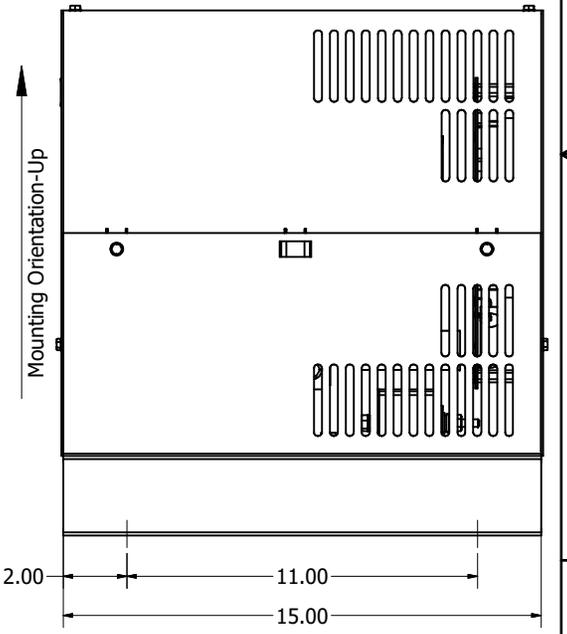

0.41 Dia Mounting Holes 4 Places.

Customer Is Responsible For Installation to Meet All National And Local Electrical Codes.
Material(s) Shall be RoHS Compliant

DIMENSIONS IN INCHES (EXCEPT AS NOTED) TOLERANCES (EXCEPT AS NOTED) DECIMAL .XX ± .25 .XXX ± .10 FRACTIONAL ± 1/32 ANGLES ± 1°		THE INFORMATION AND DESIGN CONTAINED IN THIS DRAWING ARE CONFIDENTIAL AND THE PROPRIETARY PROPERTY OF ALLIANT INC. AND ITS SUBSIDIARIES. NEITHER THIS DESIGN NOR ANY INFORMATION CONTAINED IN THIS DRAWING MAY BE REPRODUCED OR DISCLOSED TO OTHERS WITHOUT THE EXPRESS WRITTEN CONSENT OF ALLIANT INC. AND ITS SUBSIDIARIES.		DES BY: DSW DATE: 4/26/17 SCALE: 1/3 DEN. NO.: 102410-1DG SIZE: C SHEET 1 OF 1	
J	7429	Flag Termination Updated/ Drawing Chg	03/9/26	DSW	
NO	ECO	REVISION	DATE	BY	



V1K200A01
200A, V1K Type 1