

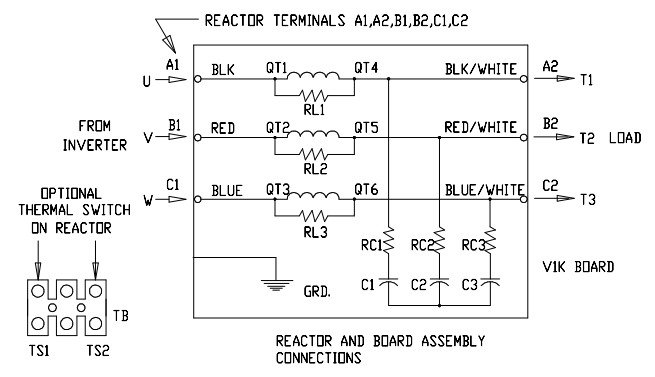
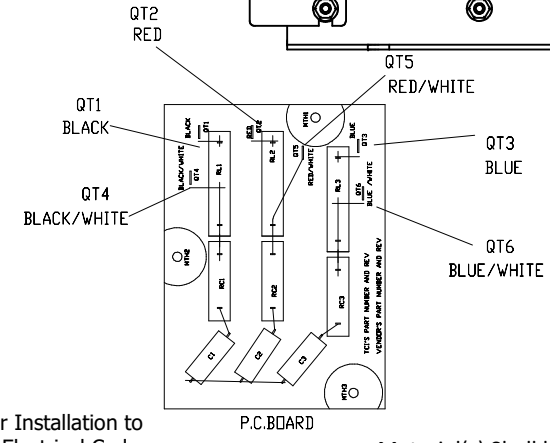
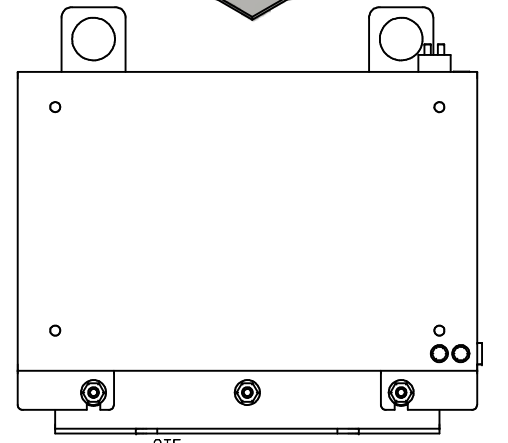


See V1K Installation Guide For Terminal Wire Size And Torque Information.

Note: Maintain Clearance of 3 Inches On All Sides To Other Equipment. * = (Blank) - No Thermal Switch
* = T - Thermal Switch Option

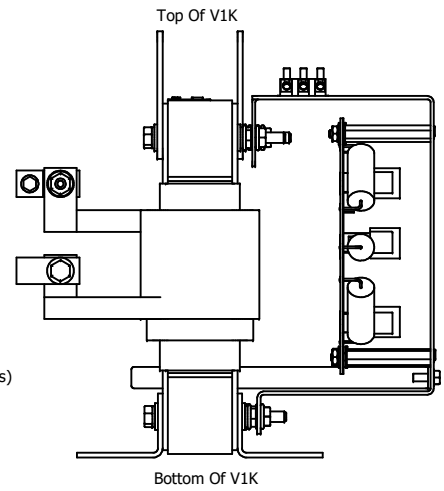

V1K Part Number	Max Voltage	Amps	Phase	Weight (LBS)
V1K130A00*	600	130	3	40
V1K130A00EX*	600	130	3	40

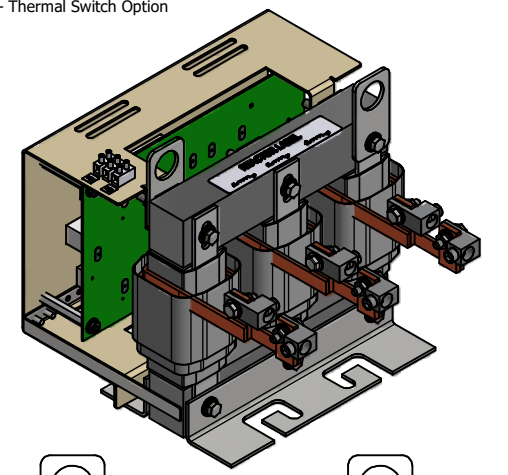

Customer Is Responsible For Installation to Meet All National And Local Electrical Codes.

Material(s) Shall be RoHS Compliant

TOLERANCES (EXCEPT AS NOTED)		THE INFORMATION AND DESIGNS CONTAINED IN THIS DRAWING ARE CONFIDENTIAL AND THE PROPRIETARY PROPERTY OF ALLIENT INC. AND ITS SUBSIDIARIES. NEITHER THIS DESIGN NOR ANY INFORMATION CONTAINED IN THIS DRAWING MAY BE REPRODUCED OR DISCLOSED TO OTHERS WITHOUT THE EXPRESS WRITTEN CONSENT OF ALLIENT INC. AND ITS SUBSIDIARIES.		REV. BY	DATE	REV. BY	DATE	SCALE	SIZE	SHT. 1 OF 1
DECIMAL	.XX ± .25 .XXX ± .10			I	6535, Termination change	2/14/2024	DSW			
FRACTIONAL	± 1/32			H	6391, Inductor Updated	8/24/2023	DSW	4/26/17		
ANGULAR	± 1°			G	5720, Update Board Bracket	2/10/2022	DSW			
				F	4658, Rated to Max Voltage	03/04/2019	DSW			
				E	4030, Combine V1k Drawings	6/7/17	DSW			
				NO	REVISION	DATE	BY	1/2	102651DG	



V1K Open