
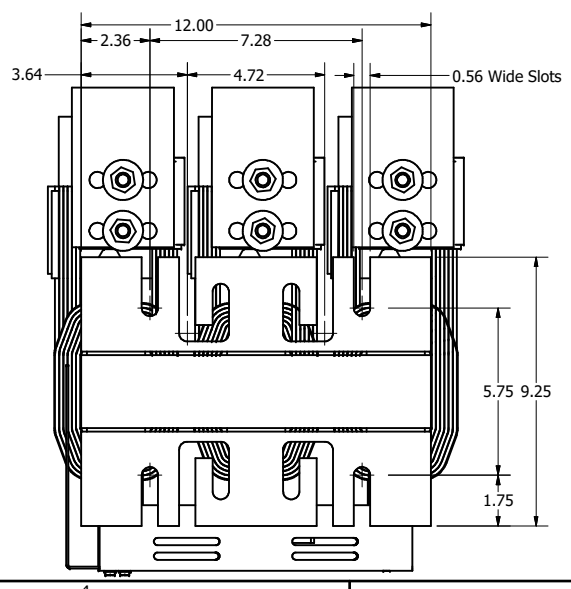
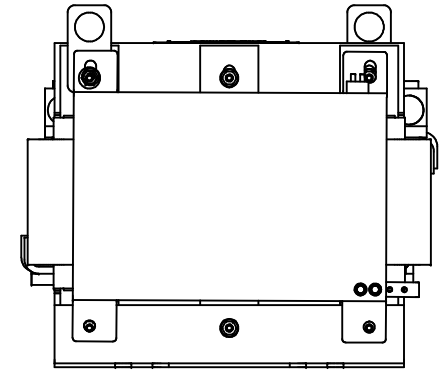
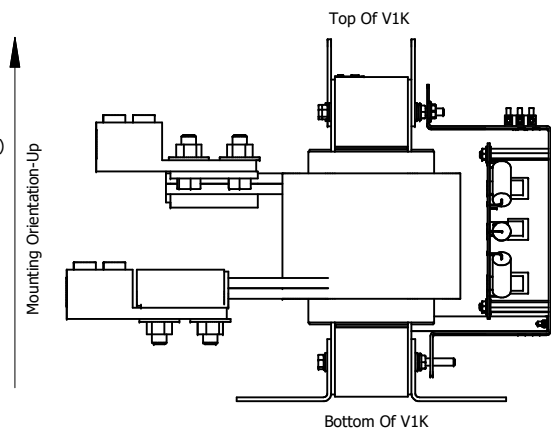
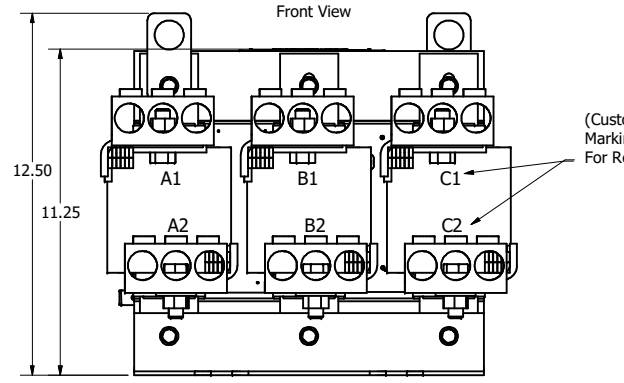
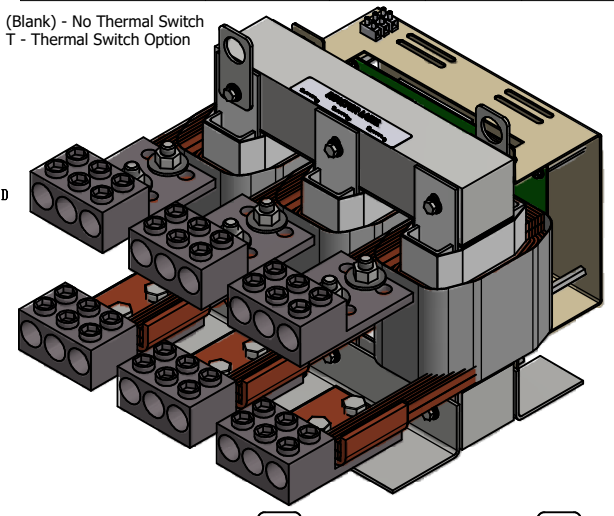



See V1K Installation Guide For
Terminal Wire Size And Torque Information.
Note: Maintain Clearance of 3 Inches On All Sides To Other Equipment.

* = (Blank) - No Thermal Switch
* = T - Thermal Switch Option

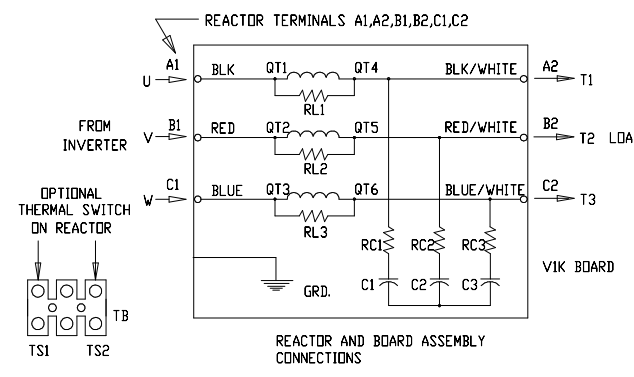

Customer Is Responsible For Installation to
Meet All National And Local Electrical Codes.
Material(s) Shall be RoHS Compliant

THE INFORMATION AND DESIGNS CONTAINED IN THIS DRAWING ARE CONFIDENTIAL AND THE PROPRIETARY PROPERTY OF ALLIED MOTION TECHNOLOGIES INC. AND ITS SUBSIDIARIES. NEITHER THIS DESIGN NOR ANY INFORMATION CONTAINED IN THIS DRAWING MAY BE REPRODUCED OR DISCLOSED TO OTHERS WITHOUT THE EXPRESS WRITTEN CONSENT OF ALLIED MOTION TECHNOLOGIES INC. AND ITS SUBSIDIARIES.				TOLERANCES (EXCEPT AS NOTED)		 TCI <i>An Allied Motion Company</i> W132N10611 (Rev'd 12/16) © 2022 TCI, LLC
				DECIMAL	.XX ± .25 .XXX ± .10	
L	6012 Add T/S Options	08/03/22	JRN	FRACTIONAL	± 1/16	V1K Open 750 Amps
K	5720, Update Board Mounting	9/21/2021	DSW	ANGULAR	± 1°	
J	4658, Rated to Max Voltage	03/06/2019	DSW	SCALE	TO FIT	102660DG SHT 1 OF 1
T	4030, Combine V1k Drawings	6/19/17	DSW	DATE	BY	
NO	REVISION	DATE	BY	DATE	BY	