


See V1K Installation Guide For Terminal Wire Size And Torque Information.






Note: Maintain Clearance of 3 Inches On All Sides To Other Equipment.

V1K Part Number	Max Voltage	Amps	Phase	Weight (LBS)
V1K200A03*	600	200	3	85

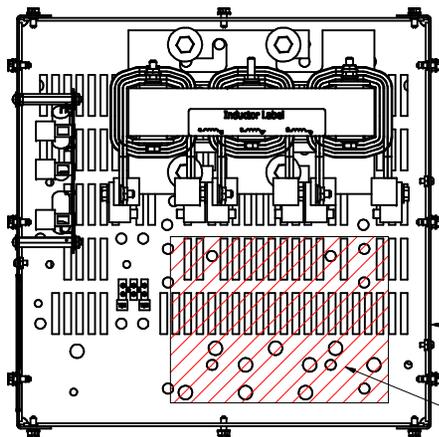

Suggested Customer Entry Side Of Enclosure.

Suggested Customer Entry Bottom Of Enclosure.

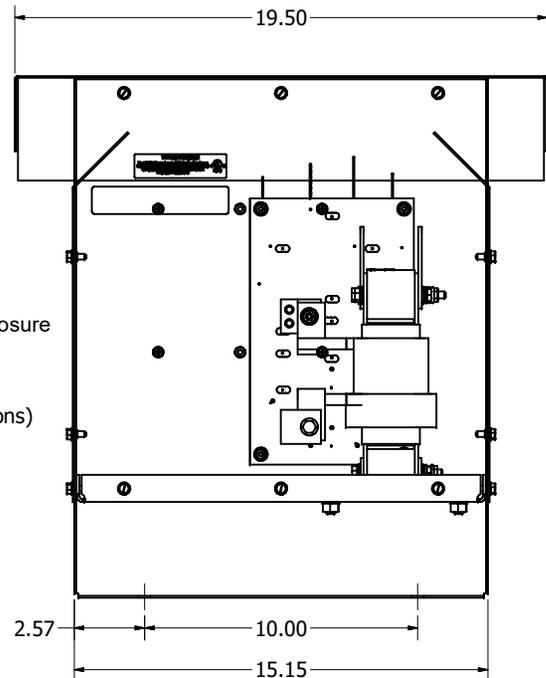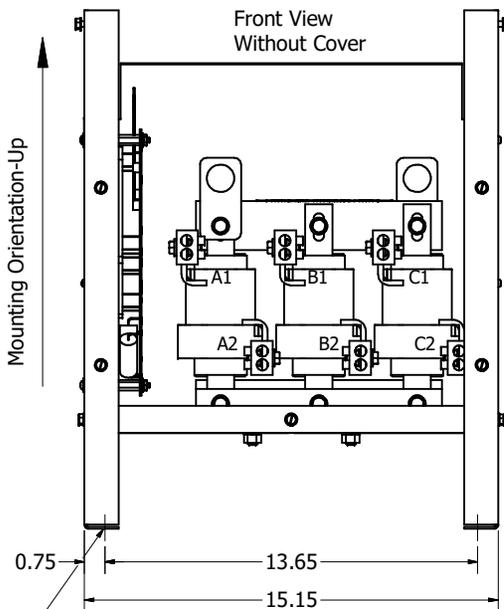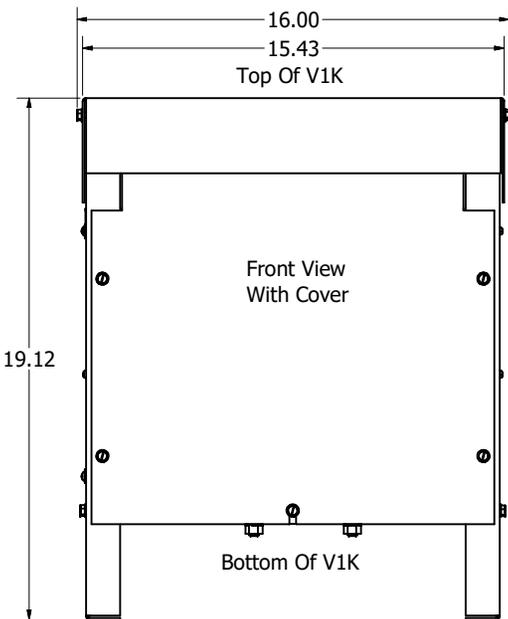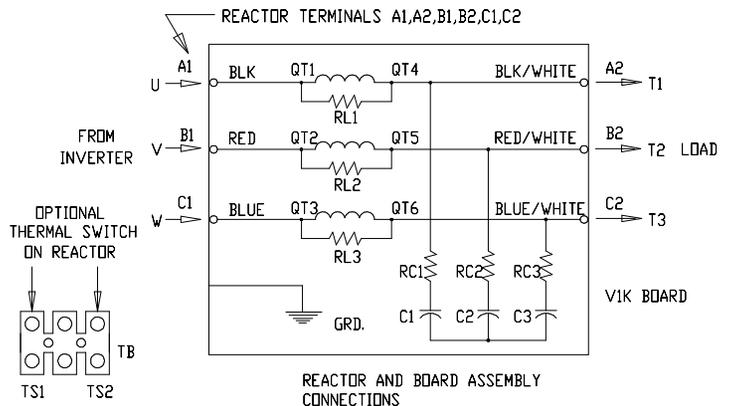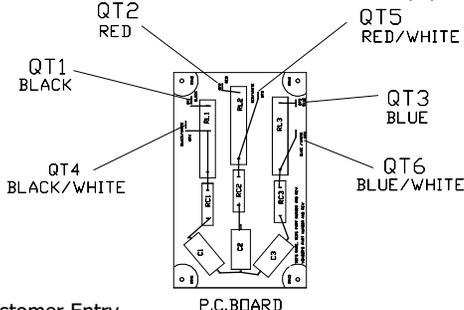

Material(s) Shall be RoHS Compliant  
Customer Is Responsible For Installation to Meet All National And Local Electrical Codes.

0.44 Dia Mounting Holes  
4 Places.

NOTE: USE ONLY HUBS OR FITTINGS THAT COMPLY WITH UL514B FOR TYPE 3R ENCLOSURES

DIMENSIONS IN INCHES (EXCEPT AS NOTED)		TOLERANCES (EXCEPT AS NOTED)	
DECIMAL	± .05	XX ± .25	XXX ± .10
FRACTIONAL	± 1/32	ANGULAR	± 1°

NO	ECO	REVISION	DATE	BY
G	7429	Flag Termination Chg. Drawing chg.	03/09/26	DSW

DESIGNED BY	DATE	SCALE	DRAWING NO.	SHEET	TOTAL SHEETS
DSW	06/26/17	1/3	104233-1DG	1	1

**Allient Power**  
W132N10611 Grant Drive  
Germentown, WI 53022  
© 2026 Allient Inc.

V1K200A03  
200A, V1K Type 3R