

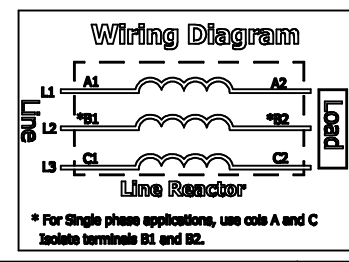


(Customer Connections) Markings On Coils For Reference Only.

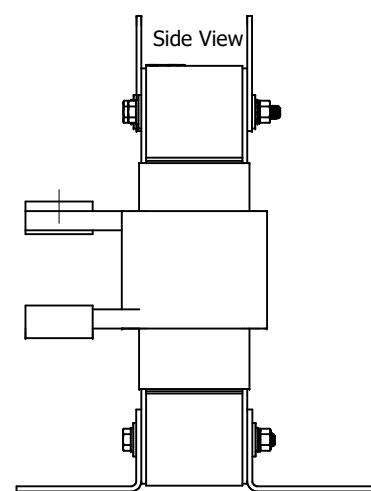

480 Rated Voltage, 600 Max Voltage, Low Z, Impedance.

Part Number	Horsepower (HP)	Motor Amps (A)	Maximum Amps (A)	Inductance (uH)	Weight (LBS)	Available Lug Kit	Losses (W)	Terminal Hole Size (Inches)
KDRL1L	450	515	575	36.3	110	SLK14	509	0.53
KDRL2L	500	590	610	31.5	110	SLK14	518	0.53

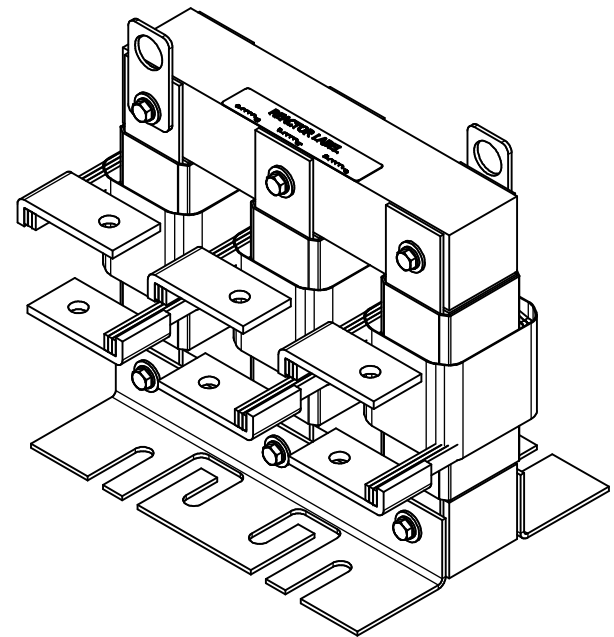

TCI, LLC
Germantown, WI, USA
transcoll.com
800-824-8282

(800) 824-8282 transcoll.com

KDRL Drive Reactor
KDR— Motor Amps —
3PH, 3Ø/3W/4—V Rated, 600V Max, —A Max
40C Amb Max, 155C Rise, RoHS
Manual #30895 LUG KIT #SLK—

DATE CODE

Notes:

1. KDR Lug Kits sold separately. Contact TCI.
2. UL file number: cULus Listed File E116124.
3. KDR Drive Reactors Comply With The Thermal and Altitude Standards Set Forth by NEMA ST20-1992.
4. KDR IOM Manual Part Number 30895
5. Material(s) Shall be RoHS Compliant
6. Customer Is Responsible For Installation To Meet All National And Local Electrical Codes.

TOLERANCES (EXCEPT AS NOTED)		THE INFORMATION AND DESIGNS CONTAINED IN THIS DRAWING ARE CONFIDENTIAL AND THE PROPRIETARY PROPERTY OF ALLIENT INC. AND ITS SUBSIDIARIES. NEITHER THIS DESIGN NOR ANY INFORMATION CONTAINED IN THIS DRAWING MAY BE REPRODUCED OR DISCLOSED TO OTHERS WITHOUT THE EXPRESS WRITTEN CONSENT OF ALLIENT INC. AND ITS SUBSIDIARIES.				DESIGNED BY	DSW	<p>W132N10611 Grant Drive Germantown, WI 53022 © 2024 Allient Inc.</p>	
DECIMAL	.XX ± .25 .XXX ± .10					DATE	3/23/18		
FRACTIONAL	± 1/32					REV	6850, Match Revs	10/23/2024	DSW
ANGULAR	± 1°					REV	6688, 107537-5 to 107537-13	6/12/2024	DSW
						NO	REVISION	DATE	BY
						SCALE	1/3.2	107537-13DG	
						SHEET 1 OF 1			