
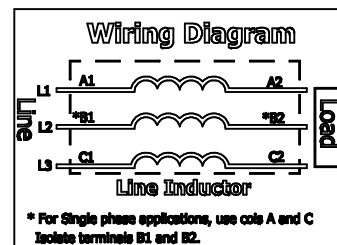



(Customer Connections) Markings On Coil For Reference Only.

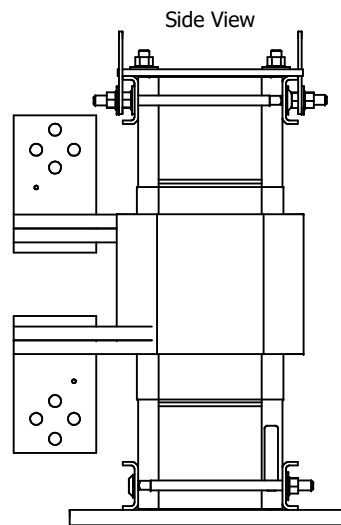


Notes:

1. KDR Lug Kits sold separately. Contact TCI.
2. UL file number: cULus Listed File E116124.
3. KDR Drive Reactors Comply With The Thermal and Altitude Standards Set Forth by NEMA ST20-1992.
4. KDR IOM Manual Part Number 30895
5. NEC Current For 208/240 Volts, Horsepower Based On 208 Volts.
6. Material(s) Shall be RoHS Compliant
7. Customer Is Responsible For Installation To Meet All National And Local Electrical Codes.

480 Rated Voltage, 600 Max Voltage, High Z, Impedance.							
Part Number	Horsepower (HP)	Motor Amps (A)	Maximum Amps (A)	Inductance (uH)	Weight (LBS)	Available Lug Kit	Terminal Hole Size (Inches)
KDRX4H	1000	1200	1200	26	285	SLK24	0.44

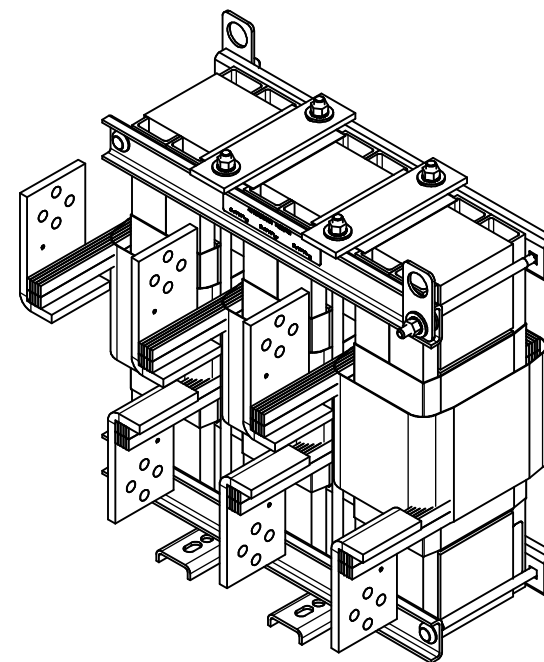

DIMENSIONS IN INCHES (EXCEPT AS NOTED) TOLERANCES (EXCEPT AS NOTED) DECIMAL .XX ± .25 .XXX ± .10 FRACTIONAL ± 1/32 ANGULAR ± 1°	THE INFORMATION AND DESIGNS CONTAINED IN THIS DRAWING ARE CONFIDENTIAL AND THE PROPRIETARY PROPERTY OF ALLIANT INC. AND ITS SUBSIDIARIES. NEITHER THIS DESIGN NOR ANY INFORMATION CONTAINED IN THIS DRAWING MAY BE REPRODUCED OR DISCLOSED TO OTHERS WITHOUT THE EXPRESS WRITTEN CONSENT OF ALLIANT INC. AND ITS SUBSIDIARIES.				DESIGNED BY DSW DATE 3/5/18		 KDRX4H KDR, 480V, 1200A, 1000HP	W132N10611 Grant Drive Germantown, WI 53022 © 2025 - Alliant Inc.		
	G	7049	Update Top Plate	9/11/25	DSW	SCALE 1:3.2		DESIGN NO. 107539-7DG	SHEET 1	OF 1
	C	6252	Flag Updated	4/26/23	DSW					
	NO	ECO	REVISION	DATE	BY					

Alliant Power

W132N10611 Grant Drive
Germantown, WI 53022
© 2025 Alliant Inc.