

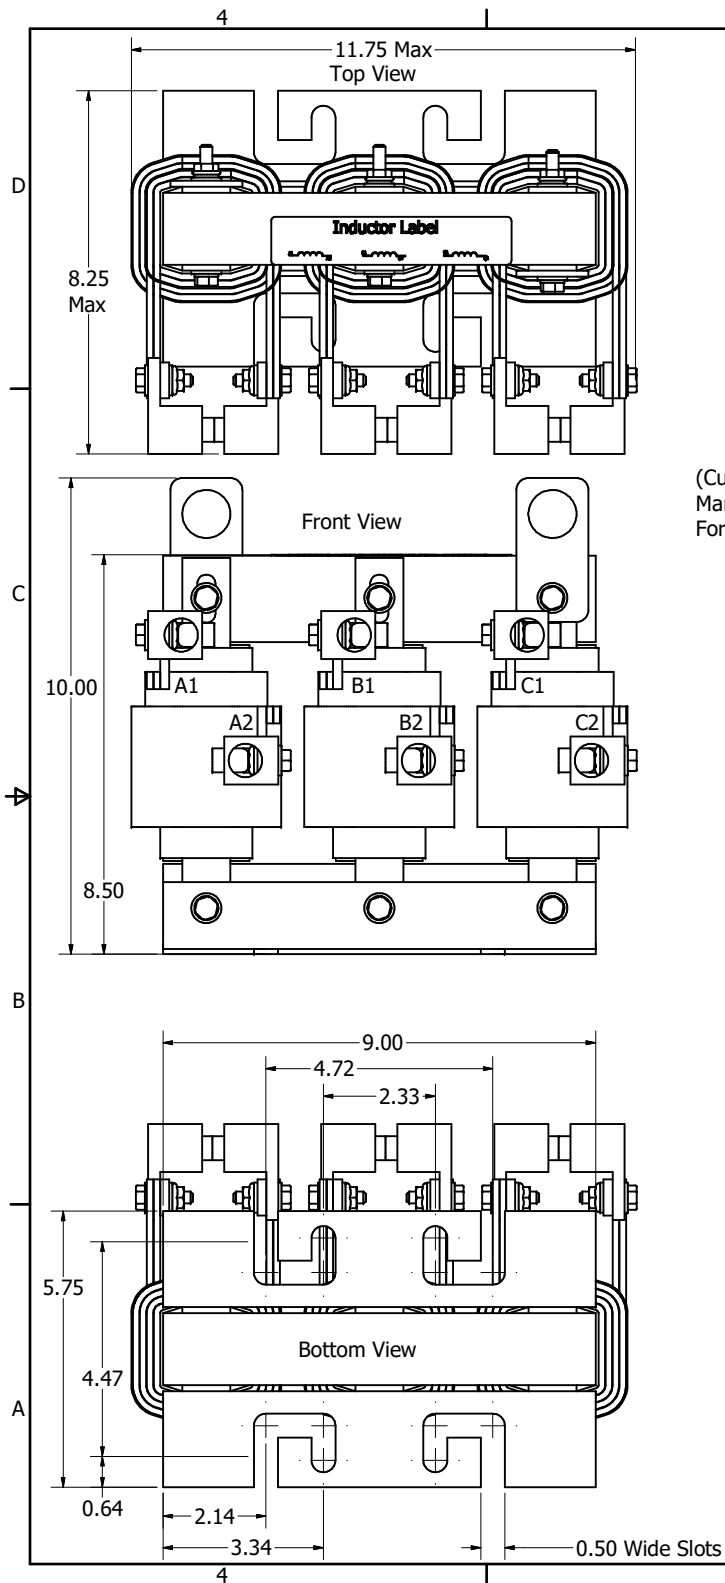


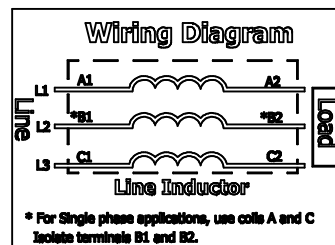


(Customer Connections)  
Markings On Coils  
For Reference Only.

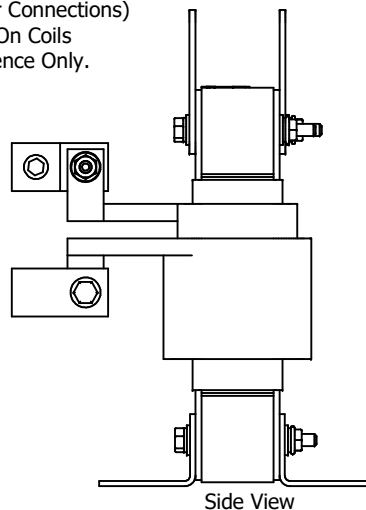

575 Rated Voltage, 600 Max Voltage, Low Z, Impedance.

| Part Number | Horsepower (HP) | Motor Amps (A) | Maximum Amps (A) | Inductance (uH) | Weight (LBS) | Losses (W) | Attached Lug Kit |
|-------------|-----------------|----------------|------------------|-----------------|--------------|------------|------------------|
| KDRULH43L   | 125             | 125            | 125              | 203             | 33           | 261        | SLK10            |
| KDRULH44L   | 150             | 144            | 144              | 215             | 38           | 253        | SLK21            |

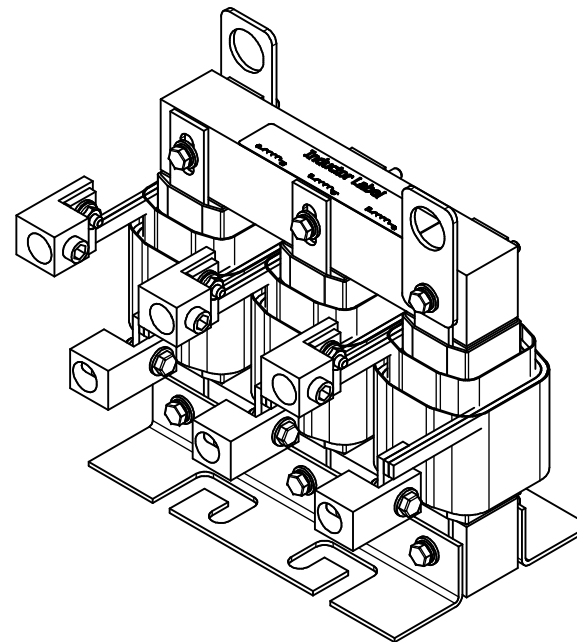

Notes:

1. UL file number: cULus Listed File E116124.
2. KDR Drive Reactors Comply With The Thermal and Altitude Standards Set Forth by NEMA ST20-1992.
3. KDR IOM Manual Part Number 30895
4. Material(s) Shall be RoHS Compliant
5. Customer Is Responsible For Installation To Meet All National And Local Electrical Codes.

|                                                                                                                               |  |                                                                                                                                                                                                                                                                                                                                |  |                               |  |                            |  |             |  |              |  |
|-------------------------------------------------------------------------------------------------------------------------------|--|--------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|--|-------------------------------|--|----------------------------|--|-------------|--|--------------|--|
| DIMENSIONS IN INCHES (EXCEPT AS NOTED) TOLERANCES (EXCEPT AS NOTED) DECIMAL XX ± .25 XXX ± .10 FRACTIONAL ± 1/32 ANGULAR ± 1° |  | THE INFORMATION AND DESIGNS CONTAINED IN THIS DRAWING ARE CONFIDENTIAL AND THE PROPRIETARY PROPERTY OF ALLIENT INC. AND ITS SUBSIDIARIES. NEITHER THIS DESIGN NOR ANY INFORMATION CONTAINED IN THIS DRAWING MAY BE REPRODUCED OR DISCLOSED TO OTHERS WITHOUT THE EXPRESS WRITTEN CONSENT OF ALLIENT INC. AND ITS SUBSIDIARIES. |  | DESIGNED BY DSW DATE 01/26/24 |  | DRAWN BY DSW DATE 01/26/24 |  | SCALE 1/2   |  | SHEET 1 OF 1 |  |
| A 6535                                                                                                                        |  | Bus bar to Flag termination                                                                                                                                                                                                                                                                                                    |  | 01/26/24                      |  | DSW                        |  | 107589-12DG |  | SHT. 1 OF 1  |  |
| NO ECO                                                                                                                        |  | REVISION                                                                                                                                                                                                                                                                                                                       |  | DATE                          |  | BY                         |  | 1/2         |  | SHT. 1 OF 1  |  |

**Allient Power**

W132N10611 Grant Drive  
Germantown, WI 53022  
© 2024 Allient Inc.

KDRUL H Frame, Flag Termination  
Inductor Drawing