

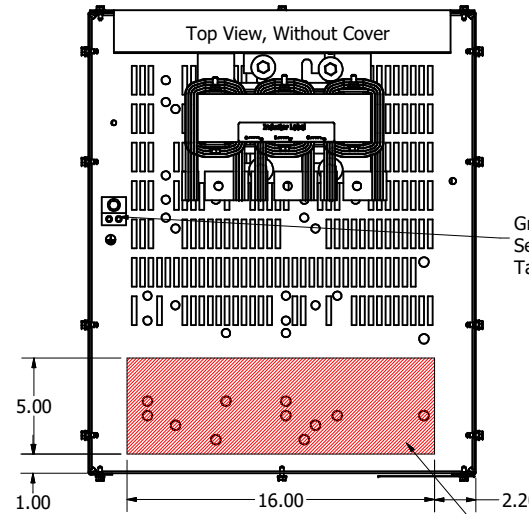
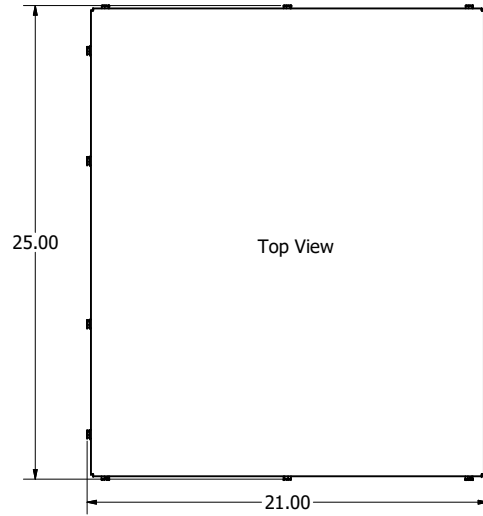



For Electrical Information See: **KDRG45L**

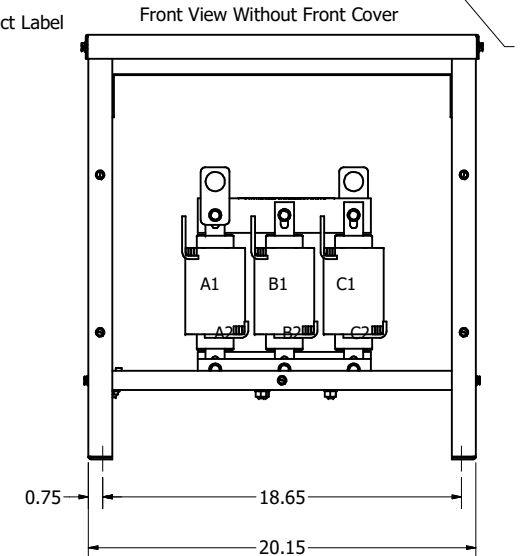

Ground Lug.
See IOM Manual, Part# 30895
Table S2/0, Wire Size And Torque.

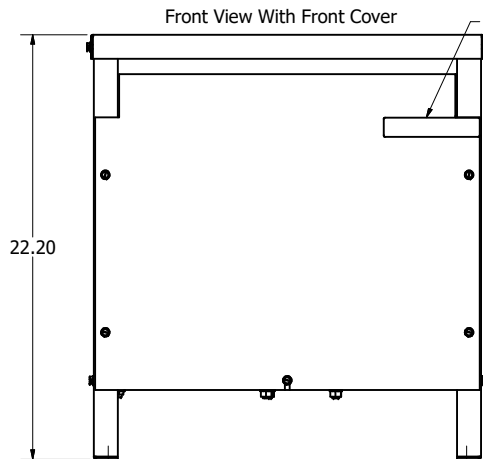


Suggested
Customer Wire Entrance
Bottom Of Enclosure.
See Note: 6
(Non Removeable Panel)

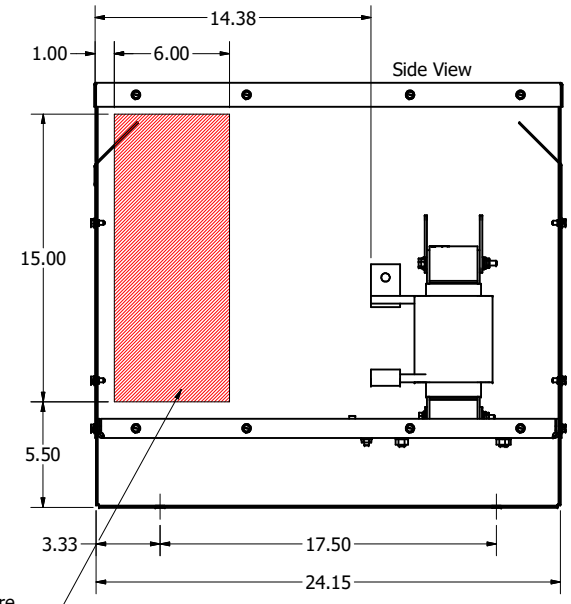


Suggested
Customer Entrance
Either Side Of Enclosure.
See Note: 6
(Non Removeable Panel)

Notes:

1. KDR Lug Kits sold separately. Contact TCI.
2. UL file number: cULus Listed File E116124.
3. KDR Drive Inductors Comply With The Thermal and Altitude Standards Set Forth by NEMA ST20-1992.
4. KDR IOM Manual Part Number 30895
5. Material(s) Shall be RoHS Compliant
6. Customer Is Responsible For Installation To Meet All National And Local Electrical Codes.
7. Dimensions are in inches unless otherwise specified.

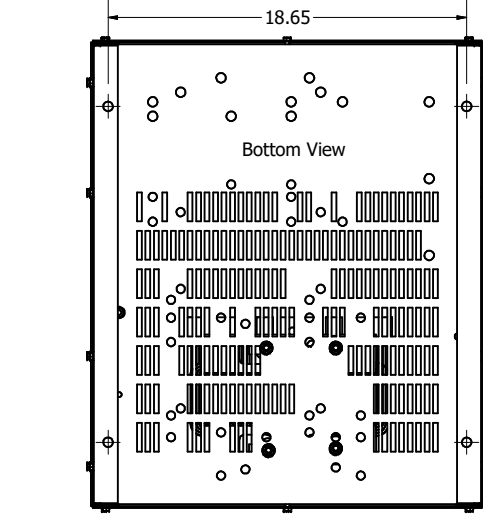

(Customer Connections)
Markings On Reactor
For Reference Only.

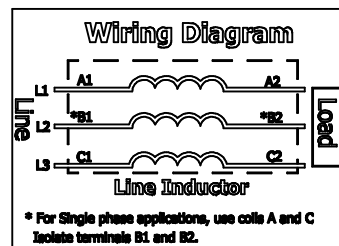

TOLERANCES (EXCEPT AS NOTED)		THE INFORMATION AND DESIGN CONTAINED IN THIS DRAWING ARE CONFIDENTIAL AND THE PROPRIETARY PROPERTY OF ALLIANT INC. AND ITS SUBSIDIARIES. NEITHER THIS DESIGN NOR ANY INFORMATION CONTAINED IN THIS DRAWING MAY BE REPRODUCED OR DISCLOSED TO OTHERS WITHOUT THE EXPRESS WRITTEN CONSENT OF ALLIANT INC. AND ITS SUBSIDIARIES.		DESIGNED BY: DSW		DATE: 12/19/24				W132N10611 Grant Drive Germantown, WI 53022 © 2026 Alliant Inc.	
DECIMAL	.XX ± .25 .XXX ± .10							KDRG45LE01		Type 1, Inductor Drawing	
FRACTIONAL	± 1/32	C	7426	107610-3 to 107610-15	4/3/2026	DSW		SCALE: 1/4"		DIN. NO. 107610-15D	
ANGULAR	± 1°	B	6903	Update Drawing	12/19/2024	DSW				SHT. 1 OF 1	
		NO	ECO	REVISION	DATE	BY					