



Ground Lug.
See IOM Manual, Part# 30895
Table S2/0, Wire Size And Torque.

Suggested
Customer Wire Entrance
Bottom Of Enclosure.
See Note: 6
(Non Removeable Panel)

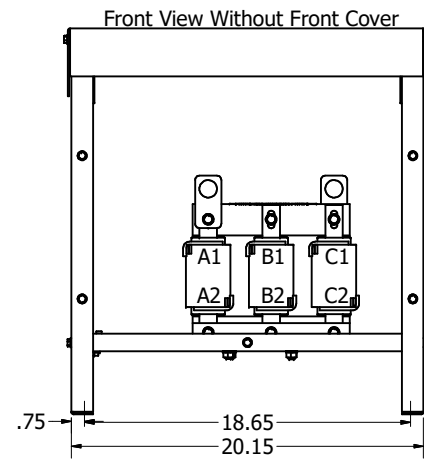

Enclosure, UL Label

Product Label

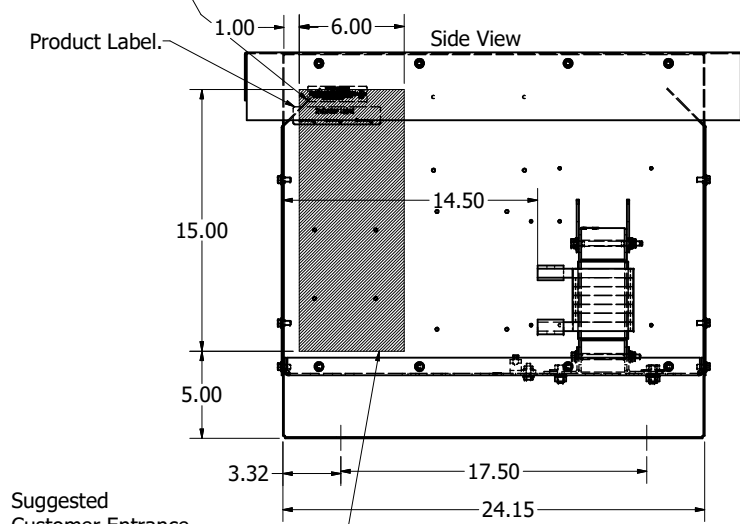


Suggested
Customer Entrance
Either Side Of Enclosure.
See Note: 6
(Non Removeable Panel)

(Customer Connections)
Markings On Coils
For Reference Only.

For Electrical Information See: **KDRG3L, KDRG31P, KDRG47L, KDRG1P**

Notes:

1. KDR Lug Kits sold separately. Contact TCI.
2. UL file number: cULus Listed File E116124.
3. KDR Drive Inductors Comply With The Thermal and Altitude Standards Set Forth by NEMA ST20-1992.
4. KDR IOM Manual Part Number 30895
5. Material(s) Shall be RoHS Compliant
6. Customer Is Responsible For Installation To Meet All National And Local Electrical Codes.

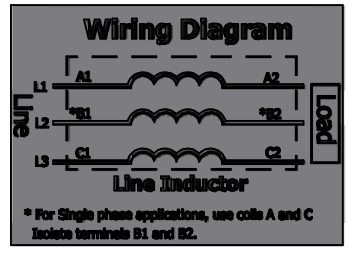

DIMENSIONS IN INCHES (EXCEPT AS NOTED) TOLERANCES (EXCEPT AS NOTED) DECIMAL: .XX ± .25 .XXX ± .10 FRACTIONAL: ± 1/32 ANGULAR: ± 1°		THE INFORMATION AND DESIGN CONTAINED IN THIS DRAWING ARE CONFIDENTIAL AND THE PROPRIETARY PROPERTY OF ALLIANT INC. AND ITS SUBSIDIARIES. NEITHER THIS DESIGN NOR ANY INFORMATION CONTAINED IN THIS DRAWING MAY BE REPRODUCED OR DISCLOSED TO OTHERS WITHOUT THE EXPRESS WRITTEN CONSENT OF ALLIANT INC. AND ITS SUBSIDIARIES.		DESIGNED BY: DSW	DATE: 4/24/18		W132N10611 Grant Drive Germantown, WI 53022 © 2026 Alliant Inc.
B	7426	Remove KDRG45HER3	3/30/26	DSW	KDR G Frame Enclosed Type 3R, Inductor Drawing		
A		Combined Drawings	04/24/26	DSW	SCALE: 1/5	DRN NO: 107618-3DG	SIZE: C
NO	ECO	REVISION	DATE	BY	1/5	107618-3DG	SHT. 1 OF 1