


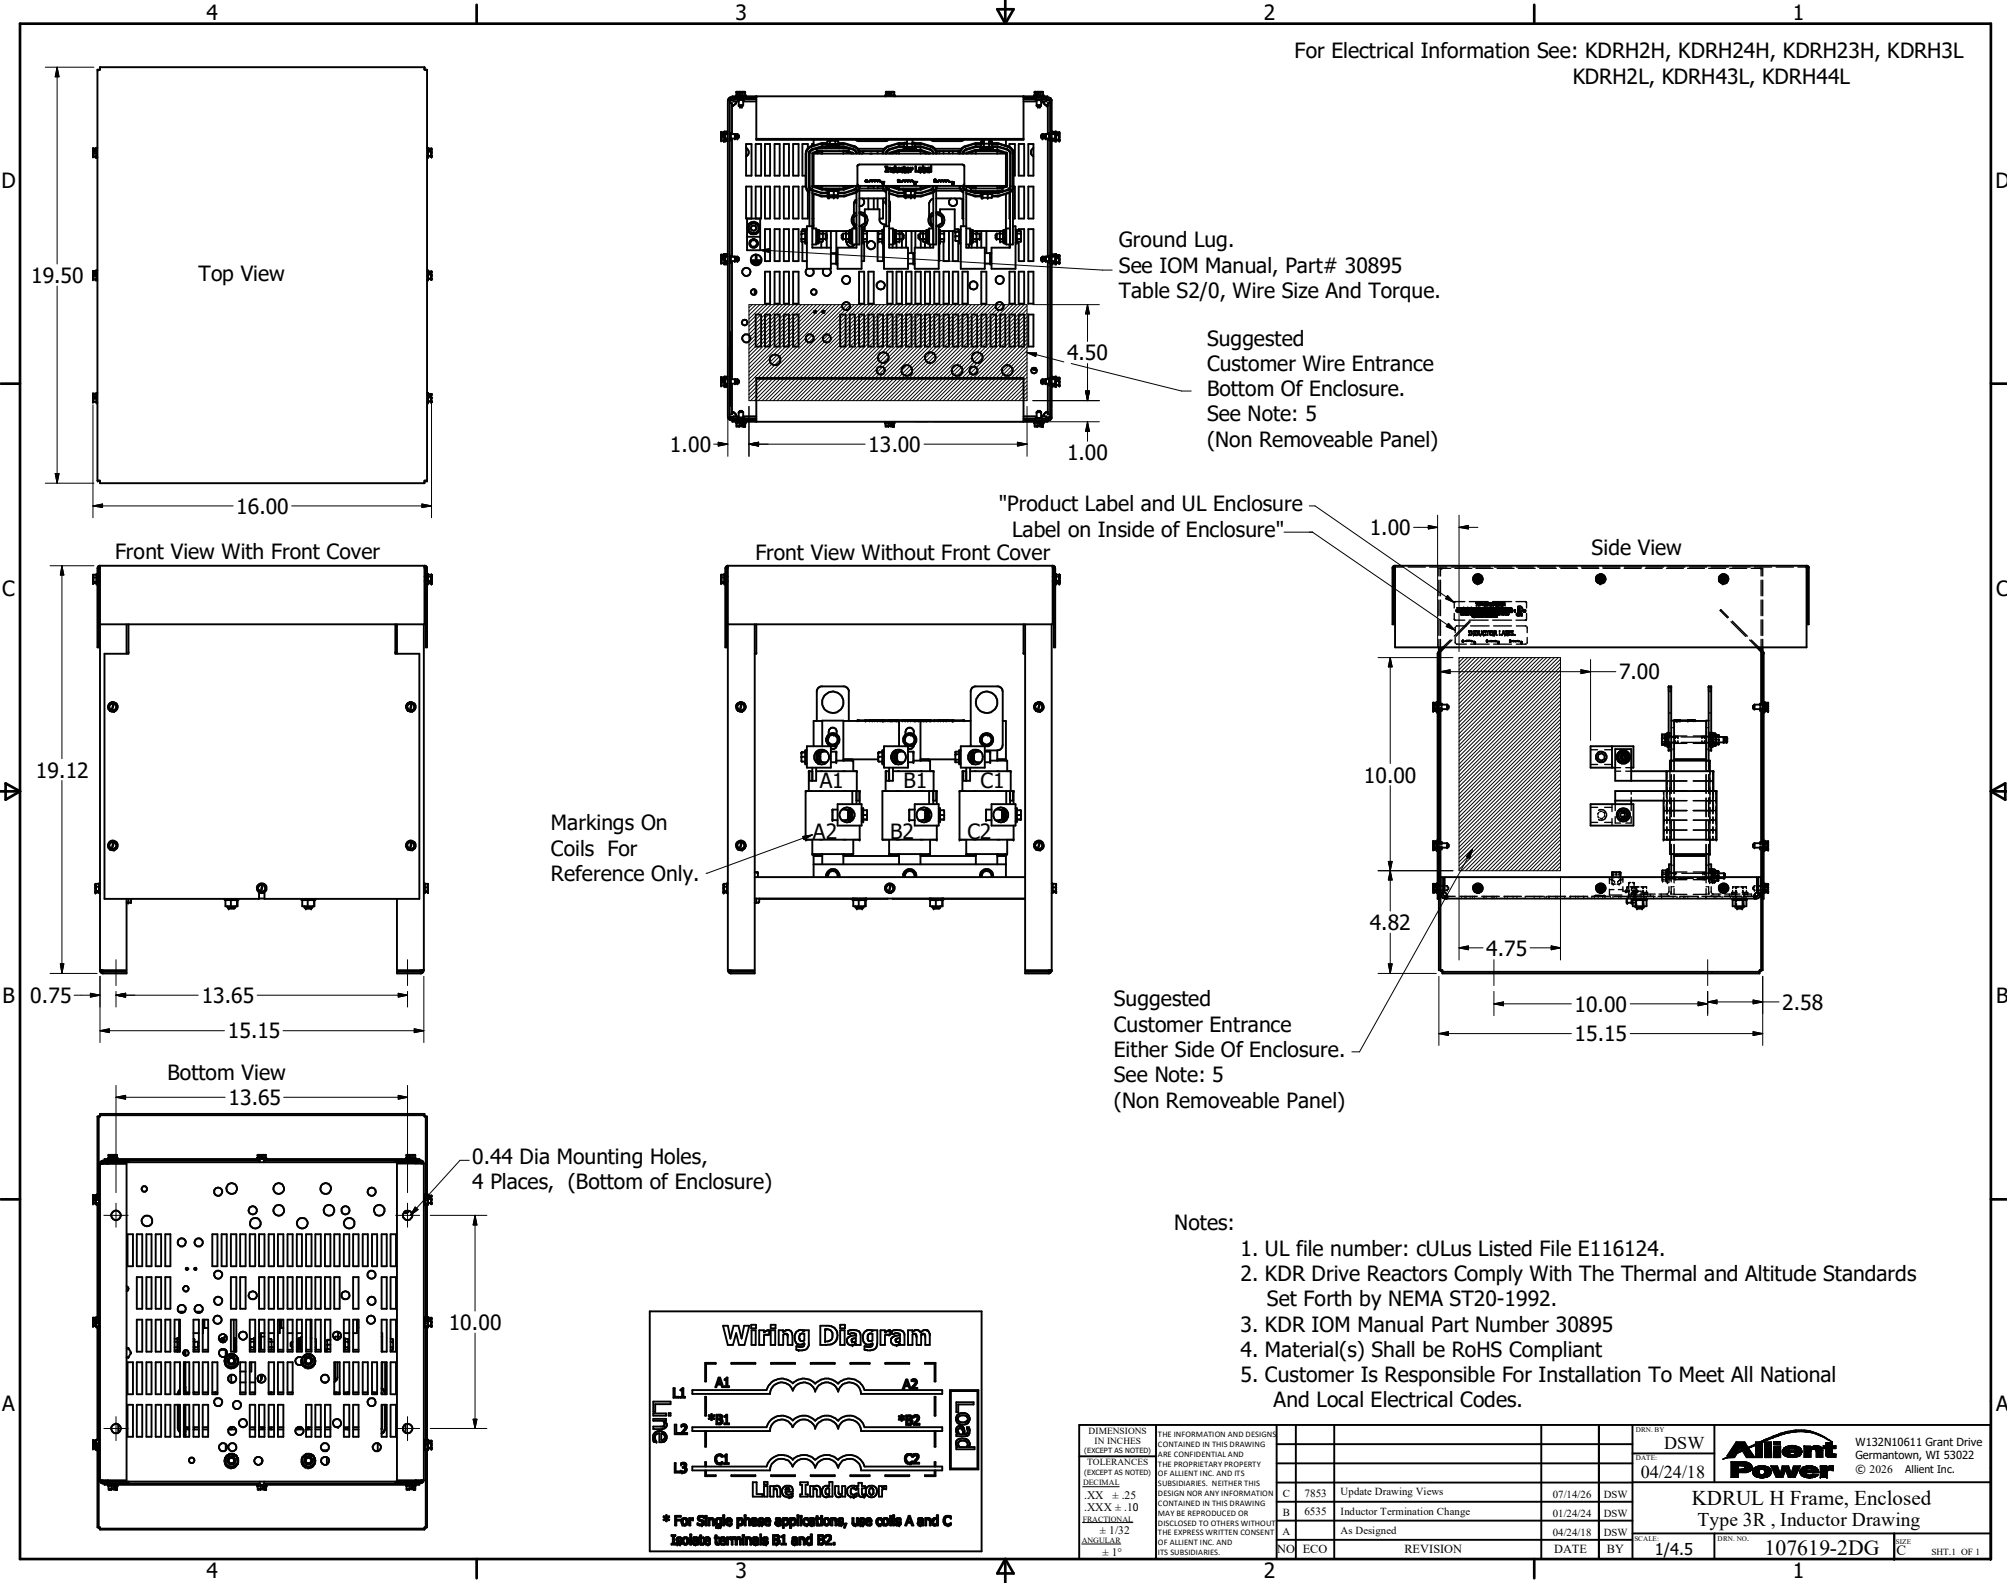


Ground Lug.
See IOM Manual, Part# 30895
Table S2/0, Wire Size And Torque.

Suggested
Customer Wire Entrance
Bottom Of Enclosure.
See Note: 5
(Non Removeable Panel)

"Product Label and UL Enclosure
Label on Inside of Enclosure"

Suggested
Customer Entrance
Either Side Of Enclosure.
See Note: 5
(Non Removeable Panel)

- Notes:
1. UL file number: cULus Listed File E116124.
 2. KDR Drive Reactors Comply With The Thermal and Altitude Standards Set Forth by NEMA ST20-1992.
 3. KDR IOM Manual Part Number 30895
 4. Material(s) Shall be RoHS Compliant
 5. Customer Is Responsible For Installation To Meet All National And Local Electrical Codes.

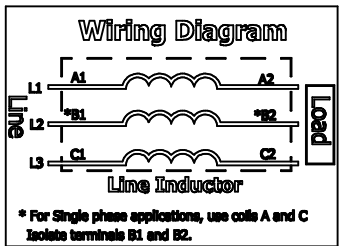

DIMENSIONS IN INCHES (EXCEPT AS NOTED) TOLERANCES (EXCEPT AS NOTED) DECIMAL XX ± .25 XXX ± .10 FRACTIONAL ± 1/32 ANGULAR ± 1°		THE INFORMATION AND DESIGNS CONTAINED IN THIS DRAWING ARE CONFIDENTIAL AND THE PROPRIETARY PROPERTY OF ALLIANT INC. AND ITS SUBSIDIARIES. NEITHER THIS DESIGN NOR ANY INFORMATION CONTAINED IN THIS DRAWING MAY BE REPRODUCED OR DISCLOSED TO OTHERS WITHOUT THE EXPRESS WRITTEN CONSENT OF ALLIANT INC. AND ITS SUBSIDIARIES.		DESIGNED BY DSW DATE 04/24/18		DRAWN BY DSW DATE 04/24/18		CHECKED BY DSW DATE 04/24/18		APPROVED BY DSW DATE 04/24/18		SCALE 1/4.5		SHEET NO. 107619-2DG		SHEET 1 OF 1	
C		7853		Update Drawing Views		07/14/26		DSW									
B		6535		Inductor Termination Change		01/24/24		DSW									
A				As Designed													
NO		ECO		REVISION													



KDRUL H Frame, Enclosed
Type 3R, Inductor Drawing

W132N10611 Grant Drive
Germantown, WI 53022
© 2026 Alliant Inc.