
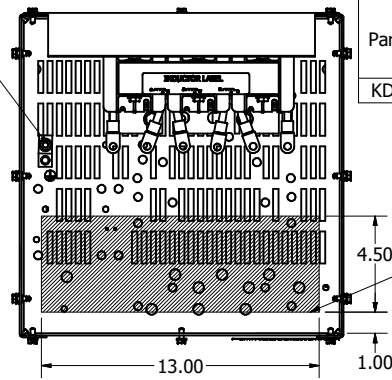


Ground Lug.
See IOM Manual, Part# 30895
Table S2/0, Wire Size And Torque.



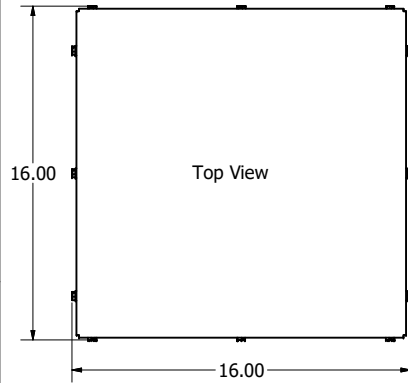


Suggested
Customer Wire Entrance
Bottom Of Enclosure.
See Note: 5
(Non Removeable Panel)


480 Rated Voltage, 600 Max Voltage, High Z, Impedance.								
Part Number	Horsepower (HP)	Motor Amps (A)	Maximum Amps (A)	Inductance (uH)	Weight (LBS)	Losses (W)	Terminal Hole Size (Inches)	Available Lug Kit
KDRF2HE01	60	77	77	408	63	226	0.313	SLK10

Front View With Front Cover

Front View Without Front Cover

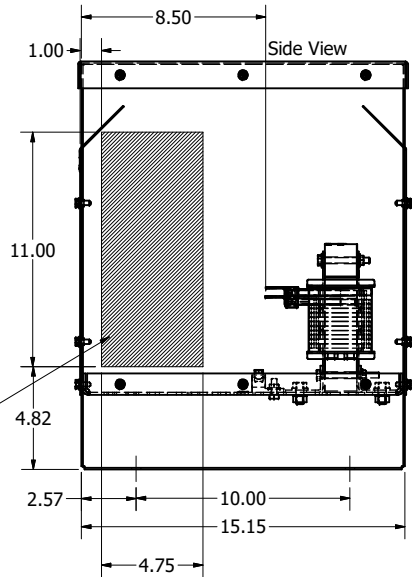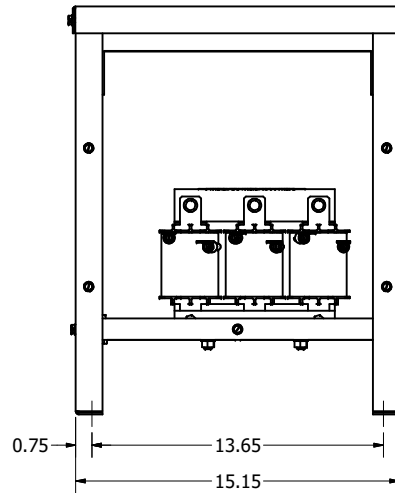
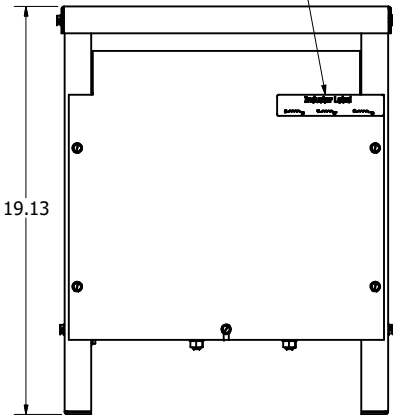


Suggested
Customer Wire Entrance
Either Side Of Enclosure.
See Note: 5
(Non Removeable Panel)

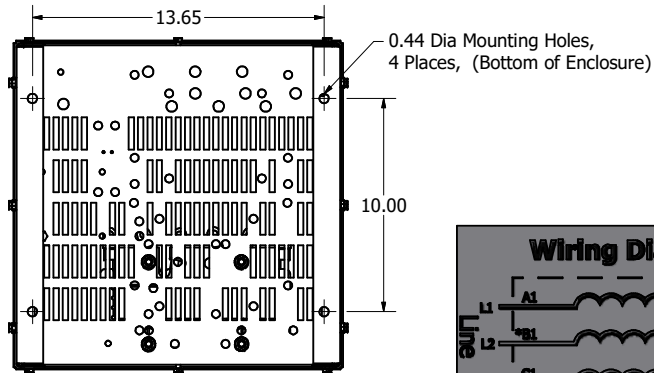

0.44 Dia Mounting Holes,
4 Places, (Bottom of Enclosure)

Markings On
Coil For
Reference Only.

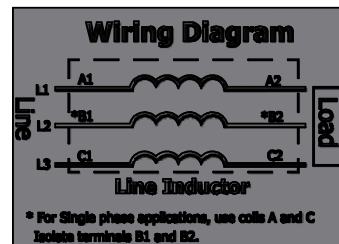

Notes:

1. UL file number: cULus Listed File E116124.
2. KDR Drive Inductors Comply With The Thermal and Altitude Standards Set Forth by NEMA ST20-1992.
3. KDR IOM Manual Part Number 30895
4. Material(s) Shall be RoHS Compliant
5. Customer Is Responsible For Installation To Meet All National And Local Electrical Codes.

DIMENSIONS IN INCHES (EXCEPT AS NOTED) TOLERANCES (EXCEPT AS NOTED) DECIMAL XX ± .25 XXX ± .10 FRACTIONAL ± 1/32 ANGULAR ± 1°		THE INFORMATION AND DESIGNS CONTAINED IN THIS DRAWING ARE CONFIDENTIAL AND THE PROPRIETARY PROPERTY OF ALLIENT INC. AND ITS SUBSIDIARIES. NEITHER THIS DESIGN NOR ANY INFORMATION CONTAINED IN THIS DRAWING MAY BE REPRODUCED OR DISCLOSED TO OTHERS WITHOUT THE EXPRESS WRITTEN CONSENT OF ALLIENT INC. AND ITS SUBSIDIARIES.		DESIGNED BY DSW DATE 01/16/19		DRAWN BY DSW DATE 01/16/19		CHECKED BY DSW DATE 01/16/19		APPROVED BY DSW DATE 01/16/19		SCALE 1:4.5		SHEET 1 OF 1	
C	7560	Update title block		6/22/26	DSW										
B	5018	Terminal On Inductor Bent		01/03/20	DSW										
A	4608	Terminal Block To Ring Lugs		01/16/19	DSW										
NO	ECO	REVISION													

W132N10611 Grant Drive
Germantown, WI 53022
© 2026 Allient Inc.

KDRF2HE01
Type 1 Enclosure

107989-1DG