


(Customer Connections)  
Markings On Terminal Block  
For Reference Only.

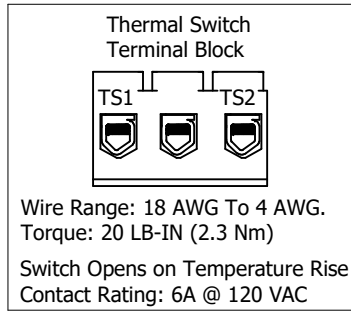

Wire Range: 18 AWG To 4 AWG.  
Torque: 20 LB-IN (2.3 Nm)

Switch Opens on Temperature Rise  
Contact Rating: 6A @ 120 VAC

Wire Range: 1- 4 AWG. Torque : 35 LBS-IN (3.95 Nm)  
6- 14 AWG. Torque : 30 LBS-IN (3.39 Nm)  
16- 20 AWG. Torque : 25 LBS-IN (2.28 Nm)  
22 AWG. Torque : 20 LBS-IN (2.26 Nm)




TCI Part Number	Rated Amps (A)	Rated Voltage (V)	Hz	---uH ±5%	Approx Weight (LBS)
KTRMG45A	45	480	60	1060	50
KTRMG35C	35	600	60	1710	50

TCI, LLC  
Germanstown, WI  
www.tranecol.com  
800-824-8282

KTR Drive Reactor  
KTRMG --- (Rated Amps) Or (Rating Amps)  
3 PH, 60/60Hz, 600V Max. ---Max.  
40C Amb Max, 155C Max.

(800) 824-8282 • tranecol.com

UL SA CE

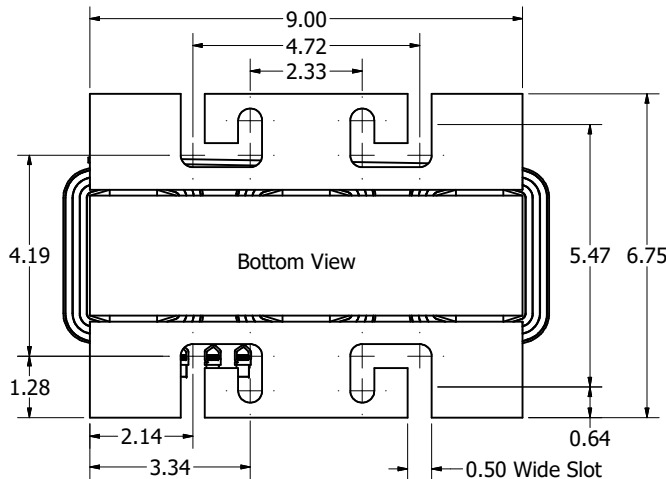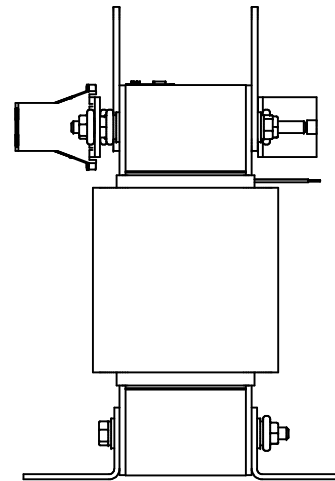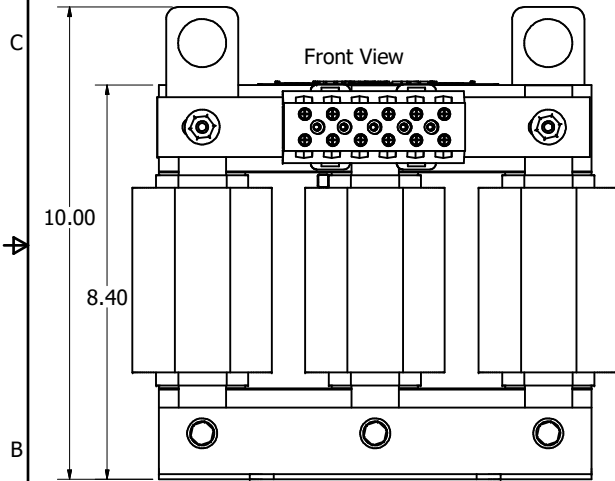

Material(s) Shall be RoHS Compliant

THE INFORMATION AND DESIGNS CONTAINED IN THIS DRAWING ARE CONFIDENTIAL AND THE PROPRIETARY PROPERTY OF ALLIED MOTION TECHNOLOGIES INC. AND ITS SUBSIDIARIES. NEITHER THIS DESIGN NOR ANY INFORMATION CONTAINED IN THIS DRAWING MAY BE REPRODUCED OR DISCLOSED TO OTHERS WITHOUT THE EXPRESS WRITTEN CONSENT OF ALLIED MOTION TECHNOLOGIES INC. AND ITS SUBSIDIARIES.				TOLERANCES (EXCEPT AS NOTED)		W132N10611 Grant Drive Germanstown, WI 53022 © 2021 TCI, LLC An <i>Official Motion Systems Company</i>	
B	5657, Add Lift Rings	7/12/2021	DSW	DECIMAL	.XX ±.25 .XXX ±.10	KTRMG G Frame, Terminal Block	
A	Combined Drawings, Added T/S	06/25/19	JRN	FRACTIONAL	± 1/16	Reactor Drawing	
NO	REVISION	DATE	BY	ANGULAR	± 1°	DRN BY: JRN	DATE: 06/25/19
						SCALE: 1/2	REVISED: 06/25/19
						108079DG	
						SHT. 1 OF 1	