

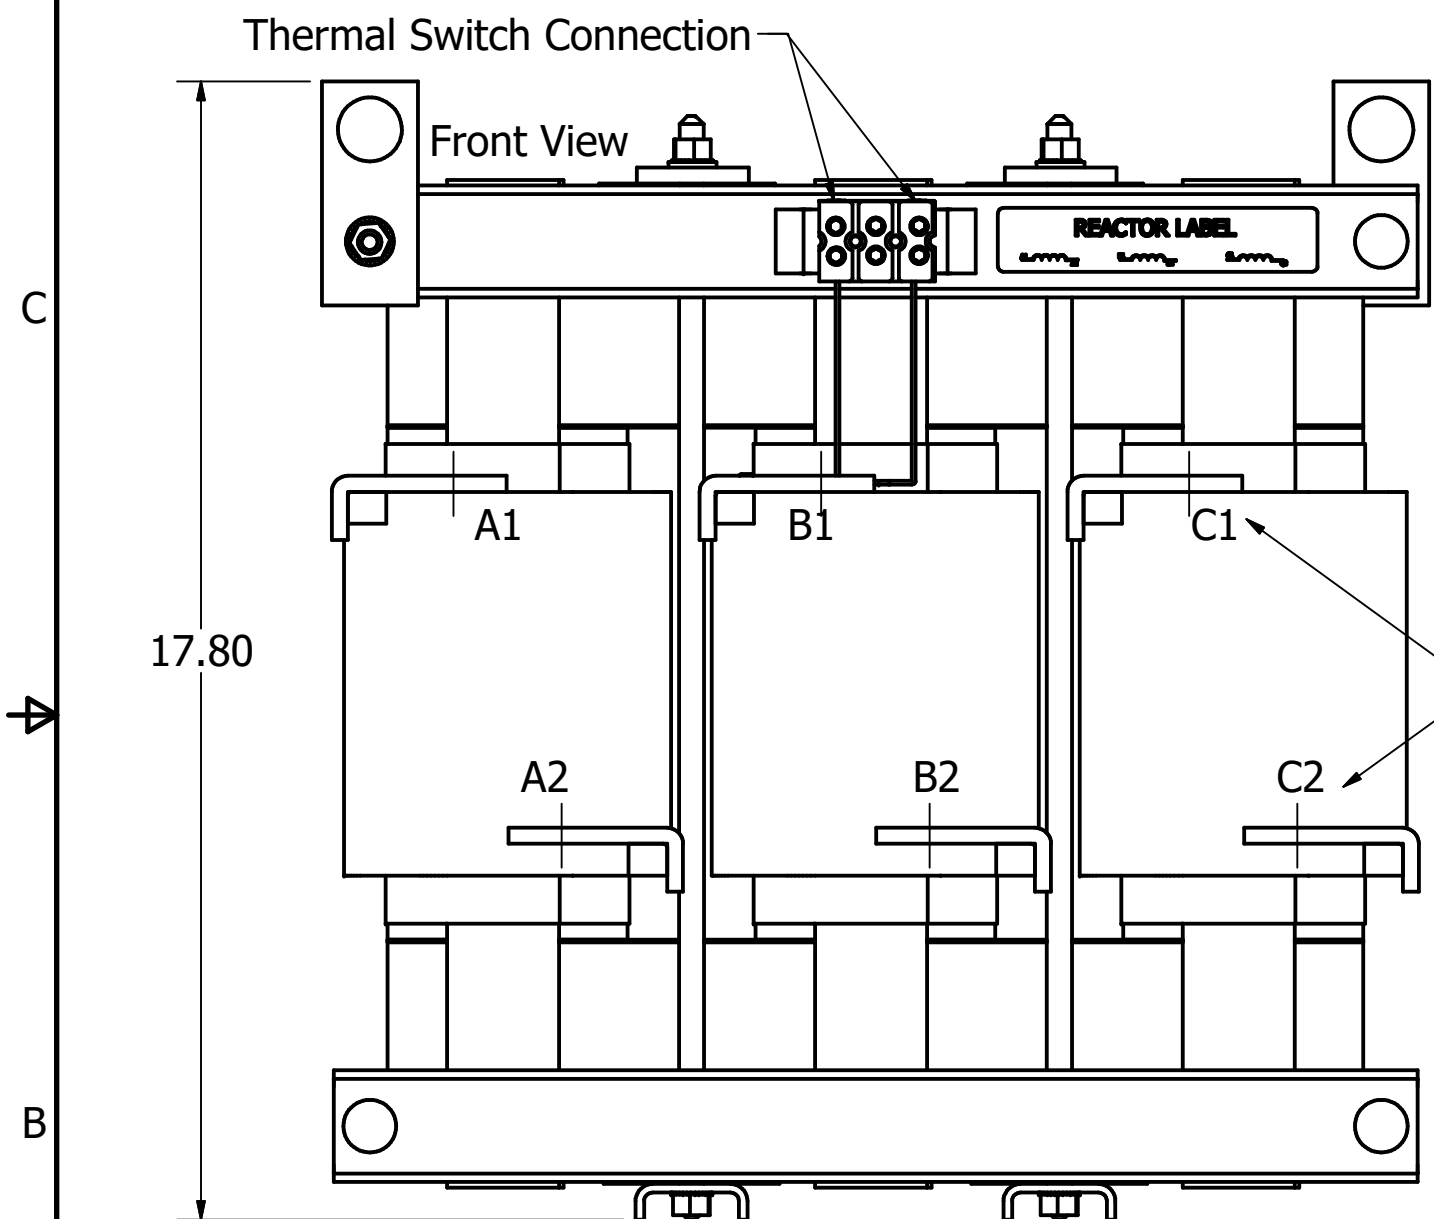
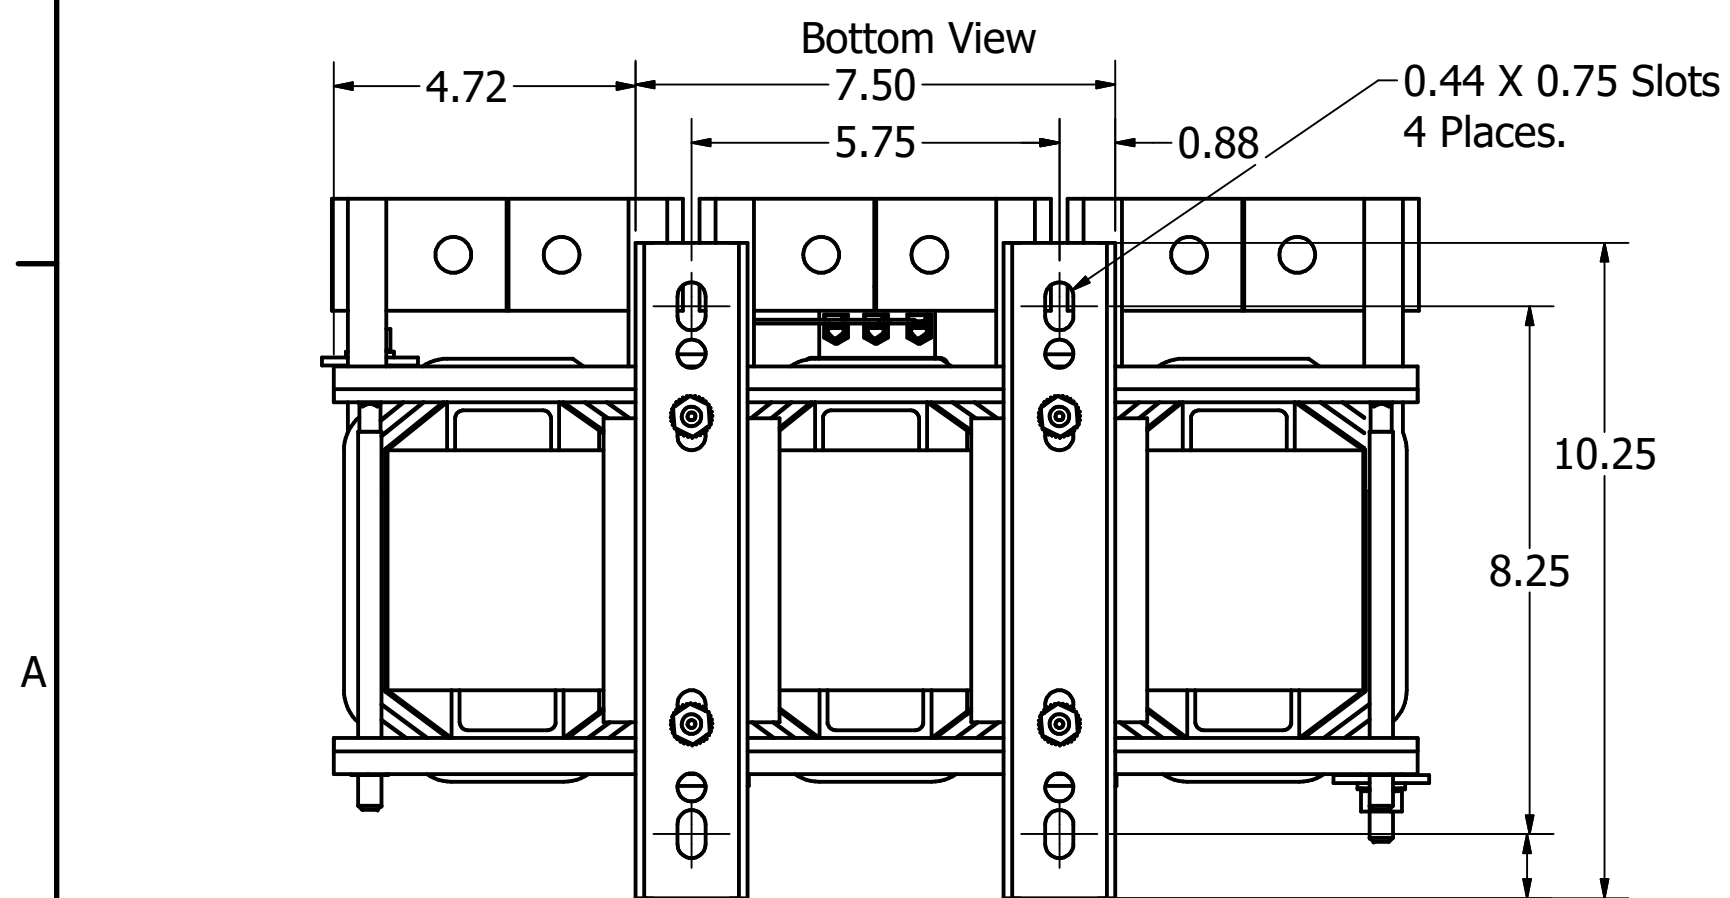


| TCI Part Number | Rated Amps (A) | Rated Voltage (V) | Hz | ---uH ±5% | Approx Weight (LBS) | Terminal Hole Size (In) |
|-----------------|----------------|-------------------|----|-----------|---------------------|-------------------------|
| KTRMG250A       | 250            | 480               | 60 | 191       | 275                 | 0.44                    |
| KTRMG305A       | 305            | 480               | 60 | 157       | 285                 | 0.44                    |
| KTRMG362A       | 362            | 480               | 60 | 132       | 295                 | 0.56                    |
| KTRMG250C       | 250            | 600               | 60 | 239       | 275                 | 0.44                    |
| KTRMG305C       | 305            | 600               | 60 | 196       | 285                 | 0.44                    |

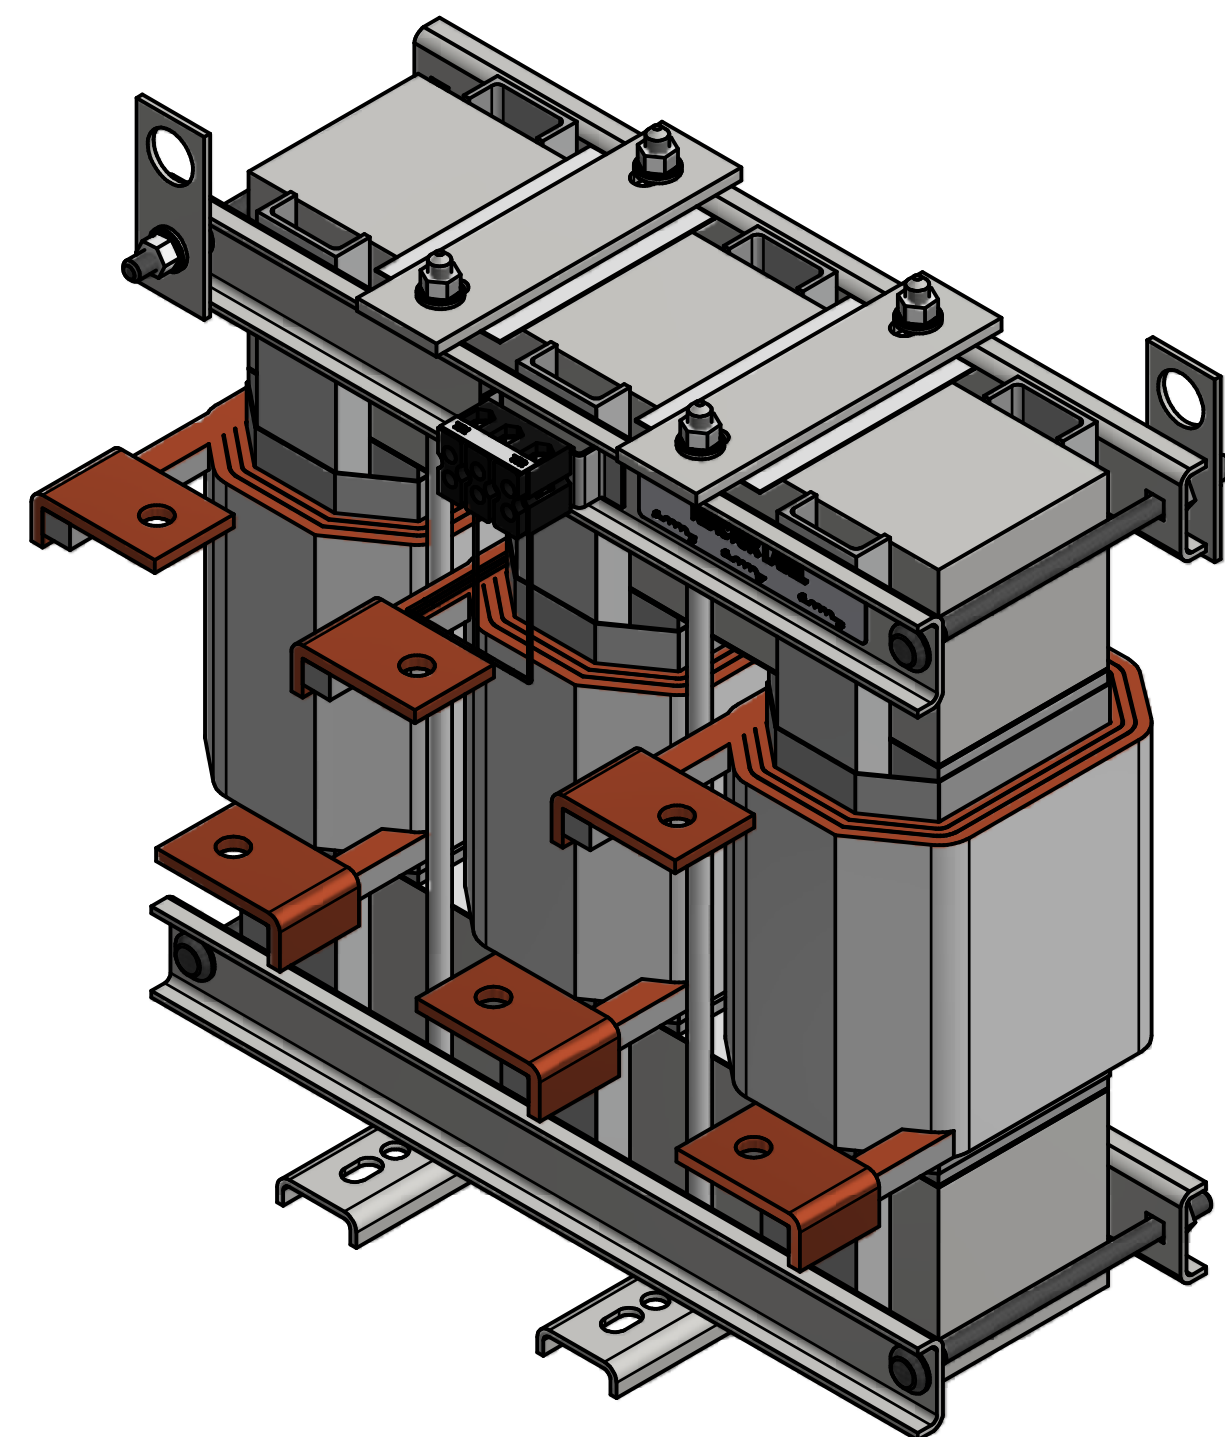

Terminal Hole  
6 Places

Markings on coil  
for reference only.

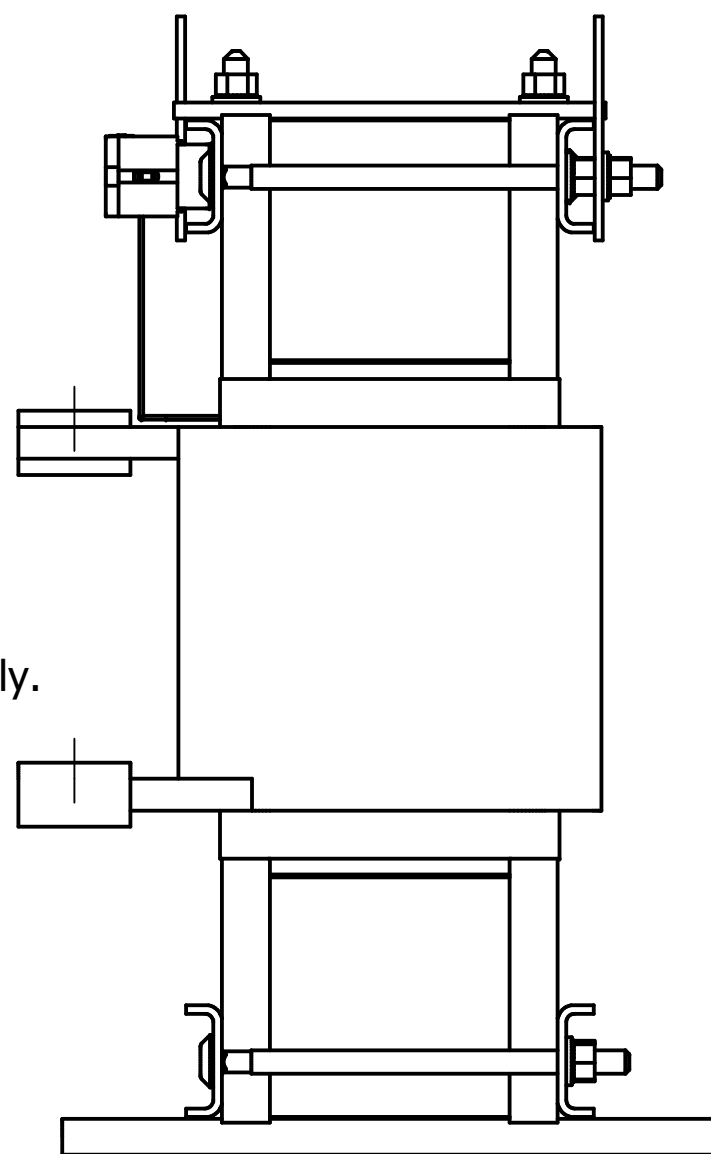

**TCI**  
TCI, LLC  
Germentown, WI  
www.transcoll.com  
800-824-8282

(800) 824-8282 • transcoll.com

KDR Drive Reactor  
KTRMG— (Motor Amps) Or (Rating Amps)  
3 PH, 50/60Hz, 600V Max. —Max.  
40C Amb Max, 155C Rise.

UL SA CE

A1 A2 B1 B2 C1 C2

Customer Is Responsible For Installation to  
Meet All National And Local Electrical Codes.

Material(s) Shall be RoHS Compliant

|  |          |                        |          |   |   |  |
|--|----------|------------------------|----------|---|---|--|
| THE INFORMATION AND DESIGNS CONTAINED IN THIS DRAWING ARE CONFIDENTIAL AND THE PROPRIETARY PROPERTY OF ALLIED MOTION TECHNOLOGIES INC. AND ITS SUBSIDIARIES. NEITHER THIS DESIGN NOR ANY INFORMATION CONTAINED IN THIS DRAWING MAY BE REPRODUCED OR DISCLOSED TO OTHERS WITHOUT THE EXPRESS WRITTEN CONSENT OF ALLIED MOTION TECHNOLOGIES INC. AND ITS SUBSIDIARIES. |          |                        |          | TOLERANCES (EXCEPT AS NOTED)<br>DECIMAL | <b>TCI</b><br>An Allied Motion Company<br>W132N10611 Grant Drive<br>Germentown, WI 53022<br>© 2022 TCI, LLC |  |
|  |          |                        |          | .XX ± .03<br>.XXX ± .010                |   |  |
|  | B        | 5525 KTRMG200C Removed | 03/01/21 | JRN                                     | FRACTIONAL<br>± 1/32  | KTRMG X Frame, Copper Bus<br>Reactor Drawing |
|  | A        | As Designed            | 05/10/19 | JRN                                     | ANGULAR<br>± 1°   |  |
| NO   | REVISION | DATE                   | BY       | SCALE: 1/2                              | DRN BY: JRN DATE: 05/10/19<br>APRVD: 108096DG<br>SIZE: C SHT. 1 OF 1  |  |