
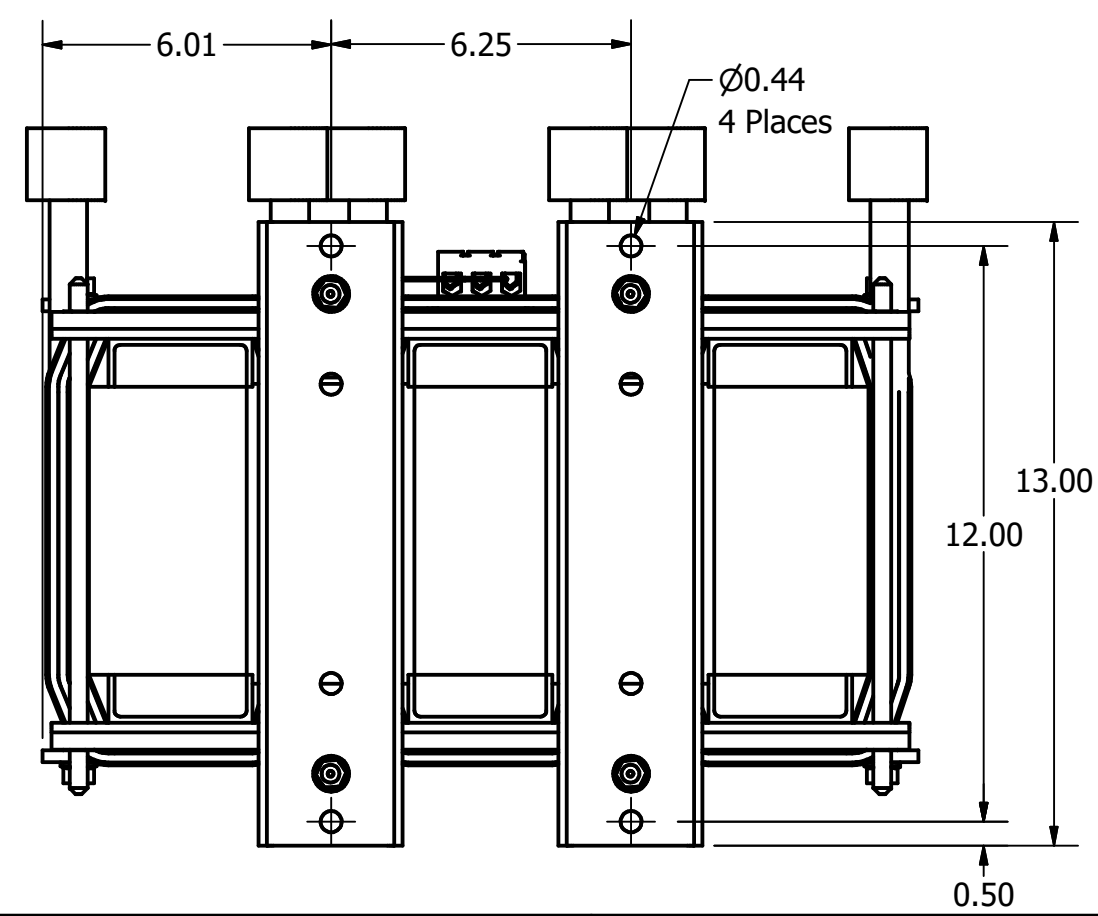
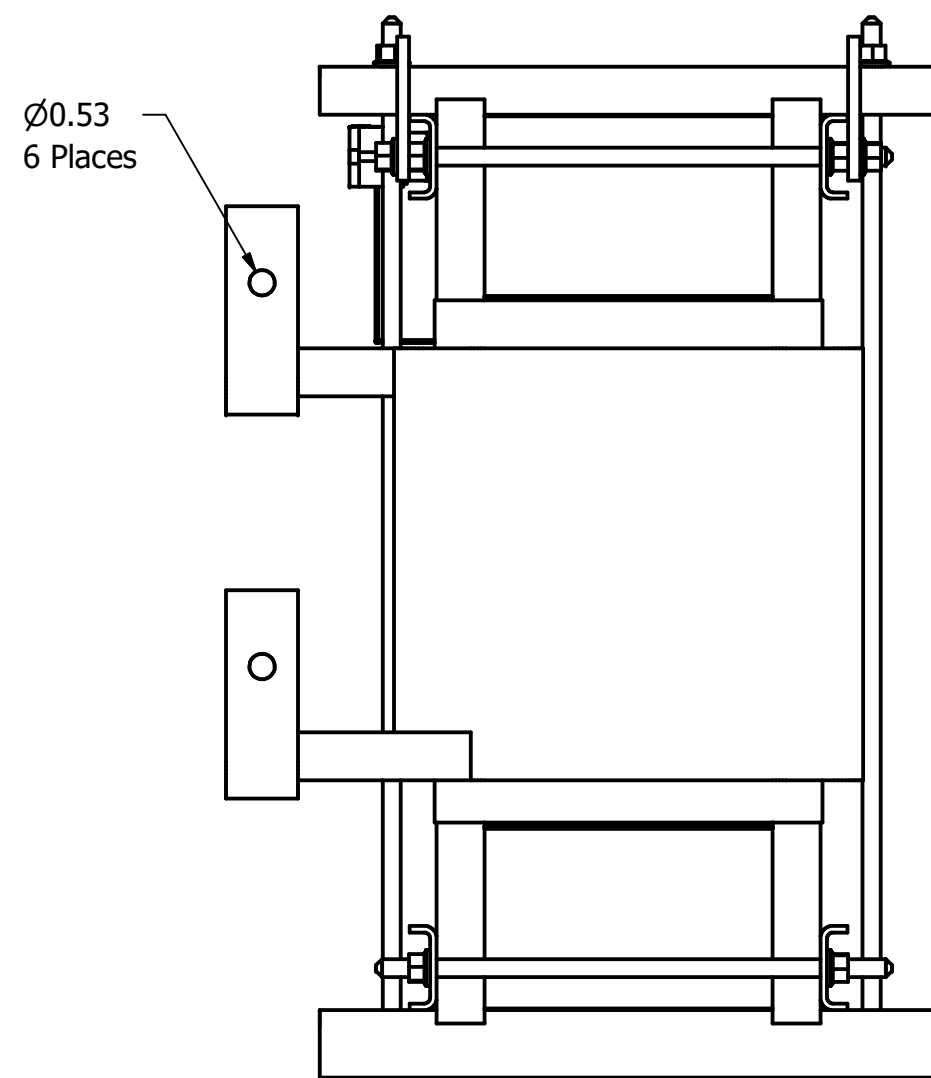
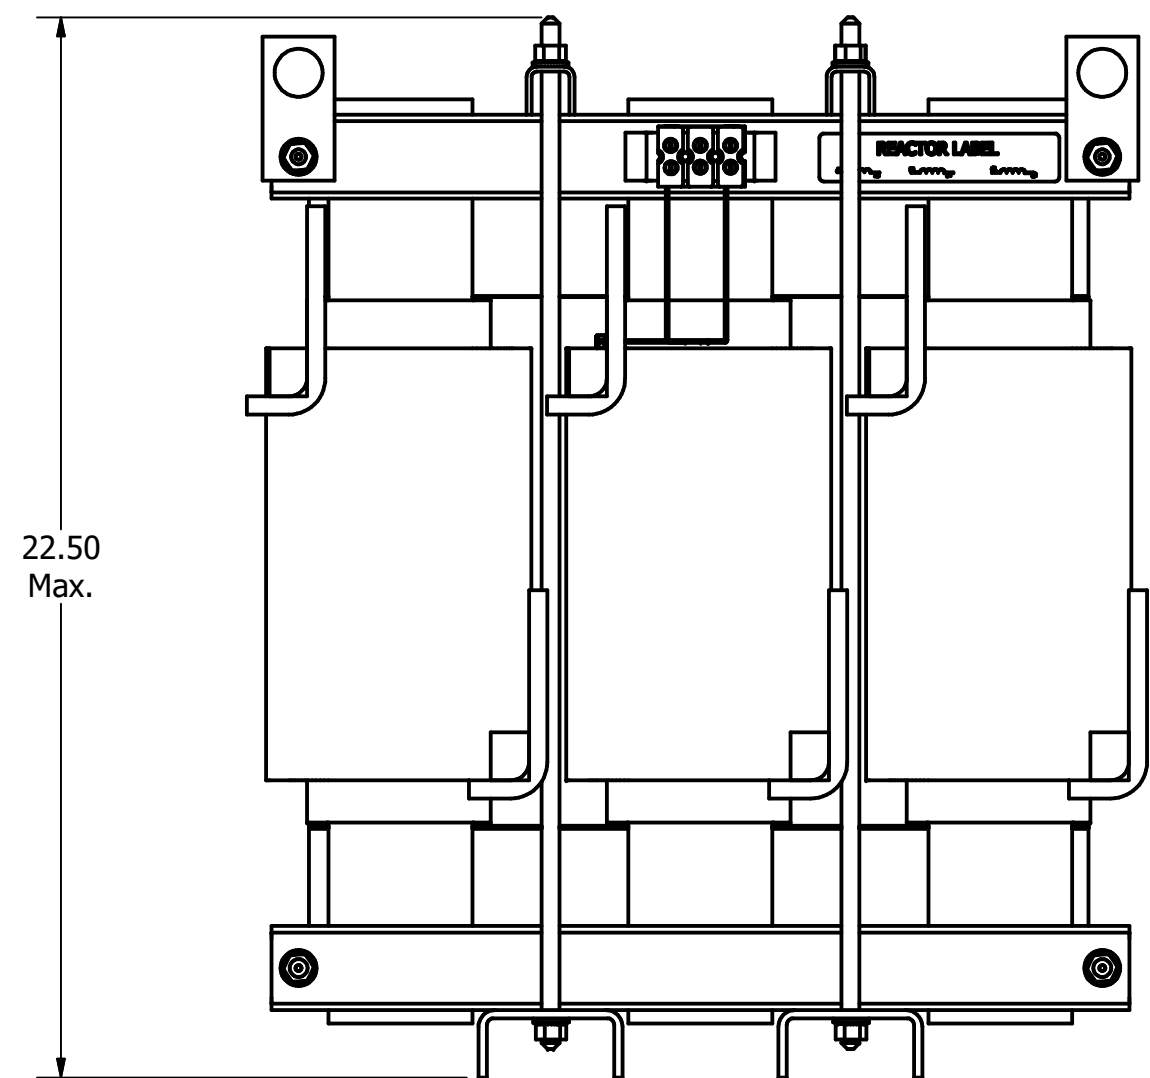
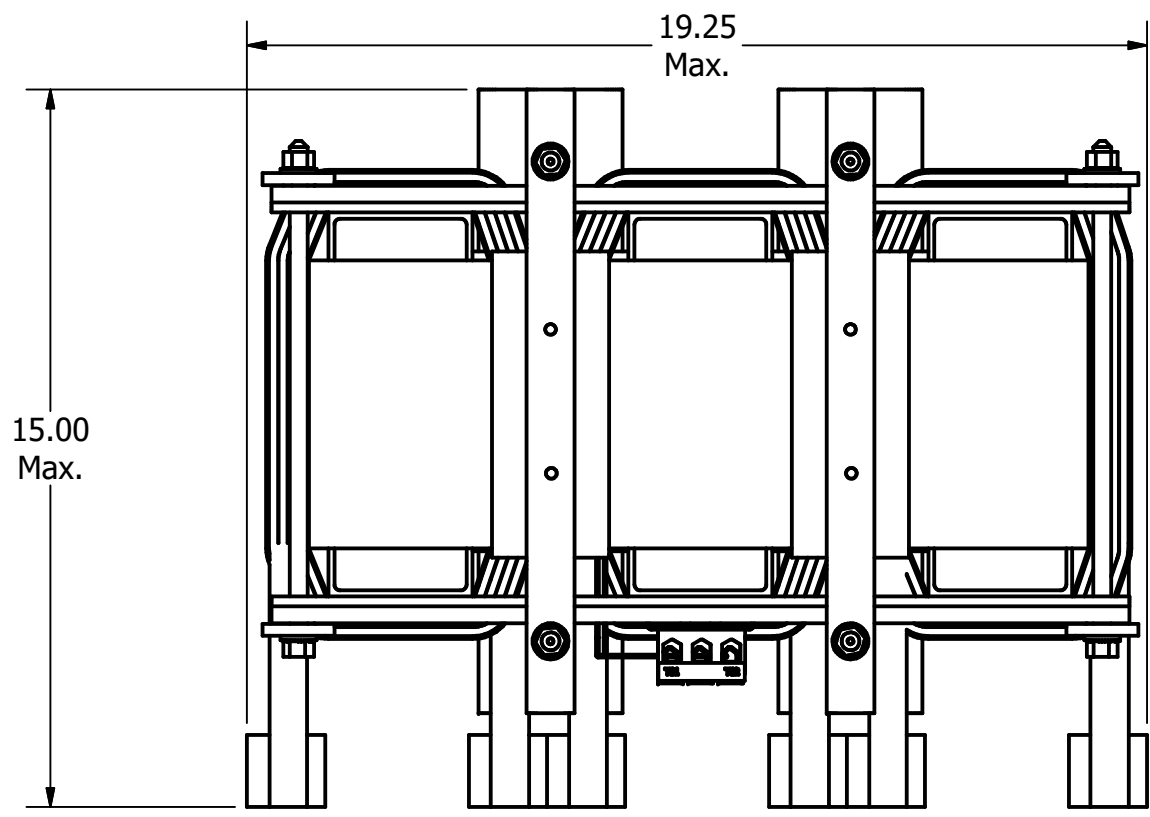
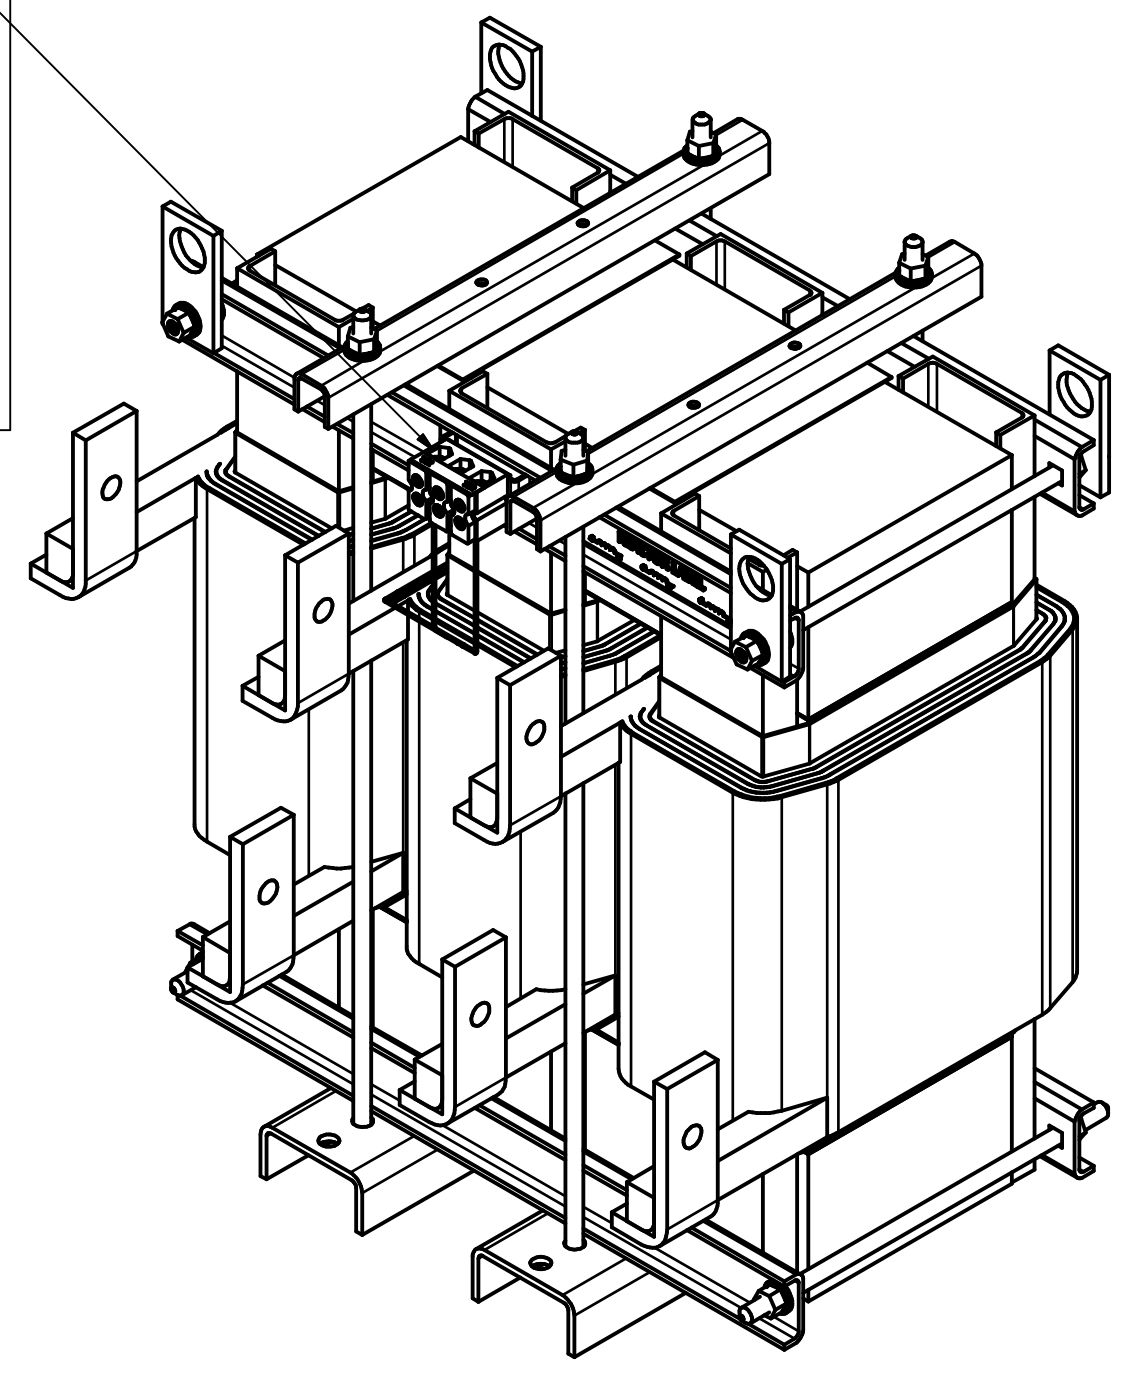


TCI Part Number	Rated Amps (A)	Rated Voltage (V)	Hz	---uH ±5%	Approx Weight (LBS)
KTRMG750A	750	480	60	64	565

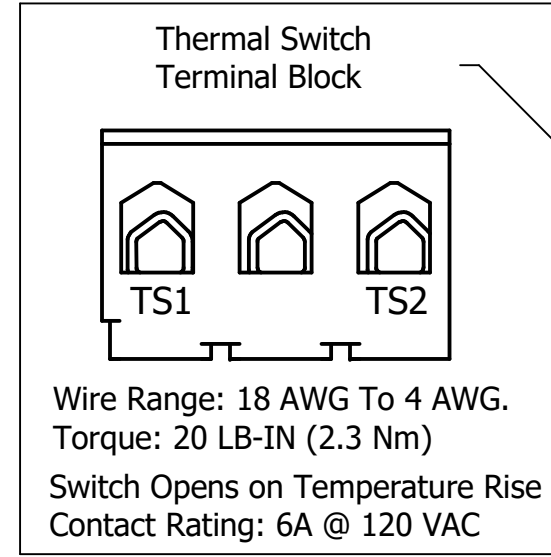

**TCI, LLC**  
 Germantown, WI  
 www.transcoll.com  
 800-824-8282

**(800) 824-8282 • transcoll.com**

**KDR Drive Reactor**  
 KTRMG— (Motor Amps) Or (Rating Amps)  
 3 PH, 50/60Hz, 600V Max. —Max.  
 40C Amb Max, 155C Rise.

Customer Is Responsible For Installation to Meet All National And Local Electrical Codes.

Material(s) Shall be RoHS Compliant

TCI, LLC CLAIMS PROPRIETARY RIGHTS IN THE MATERIAL HEREIN DISCLOSED. IT IS SUPPLIED WITHOUT PREJUDICE TO ANY PATENT RIGHTS OF TCI AND MAY NOT BE REPRODUCED OR USED TO MANUFACTURE ANYTHING SHOWN THEREIN WITHOUT WRITTEN PERMISSION FROM TCI.				TOLERANCES (EXCEPT AS NOTED) DECIMAL .XX ± .25 .XXX ± .10 FRACTIONAL ± 1/16 ANGULAR ± 1°		W132 N10611 Grant Drive Germantown, WI 53022 <b>KTRMG Y Frame, Copper Bus</b> Reactor Drawing	
A	As Designed	10/22/19	JRN	DRN BY JRN	DATE 10/22/19	108097-4DG	SCALE 1/3
NO	REVISION	DATE	BY	SCALE 1/3	APRVD:	SIZE C	SHT. 1 OF 1