
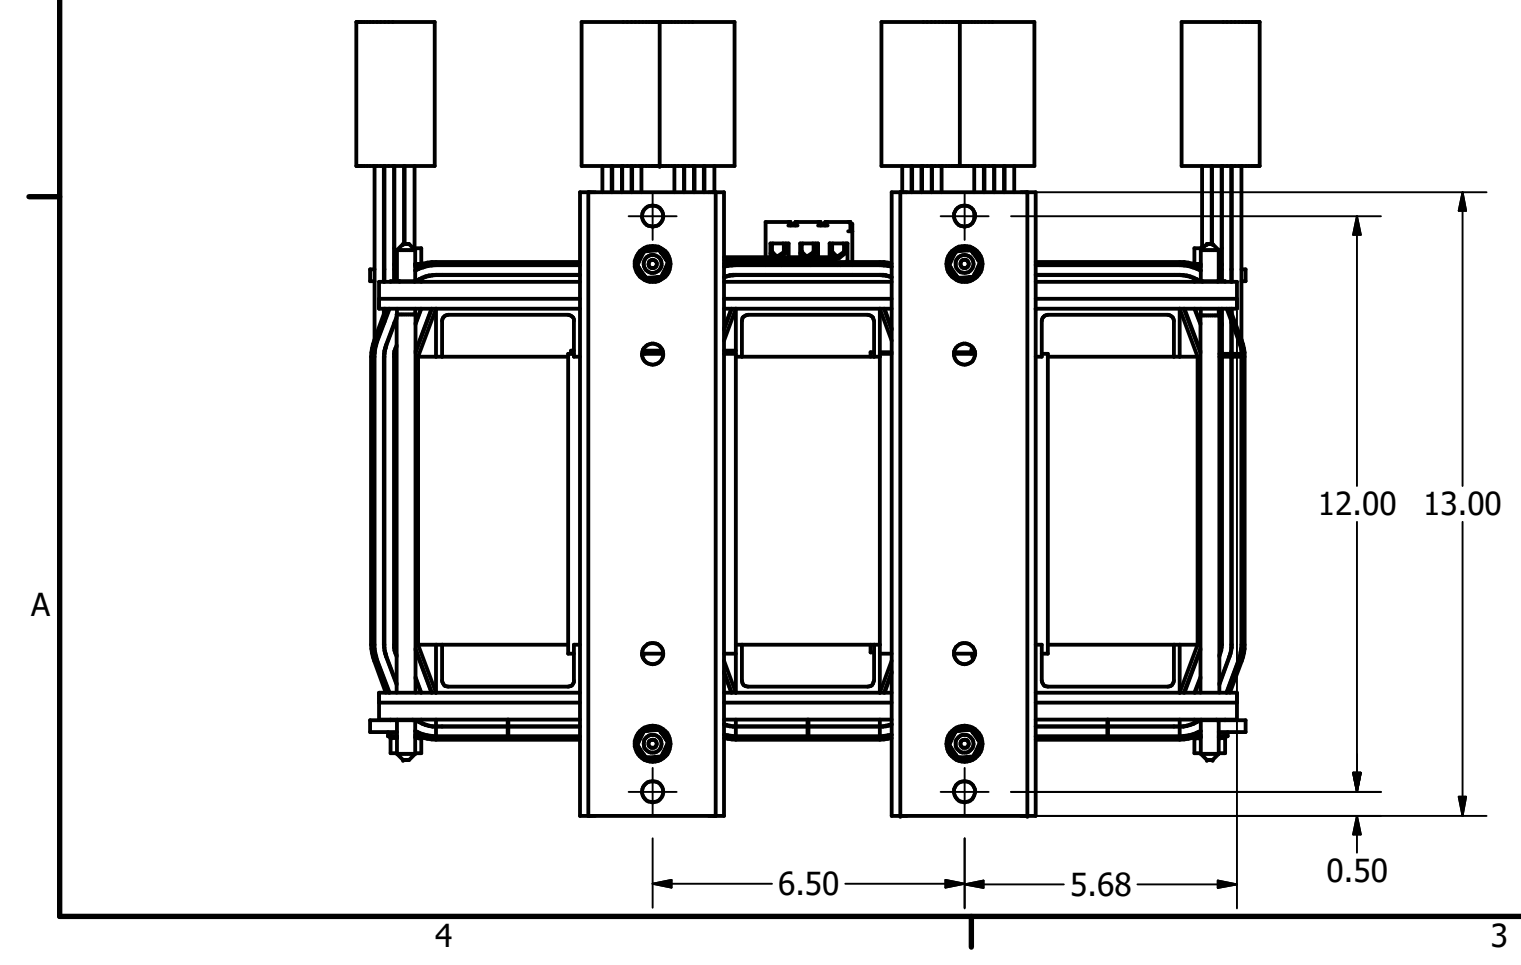
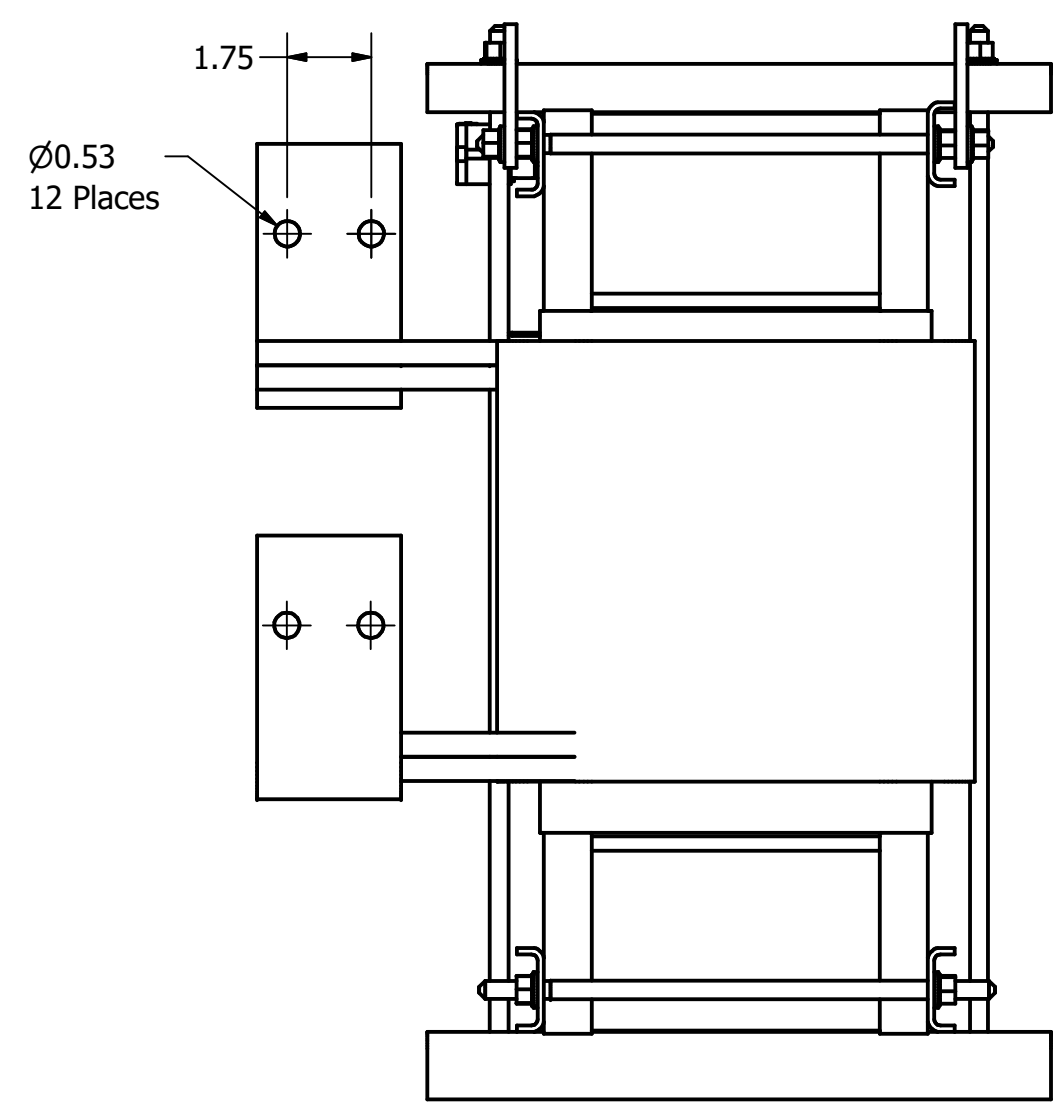
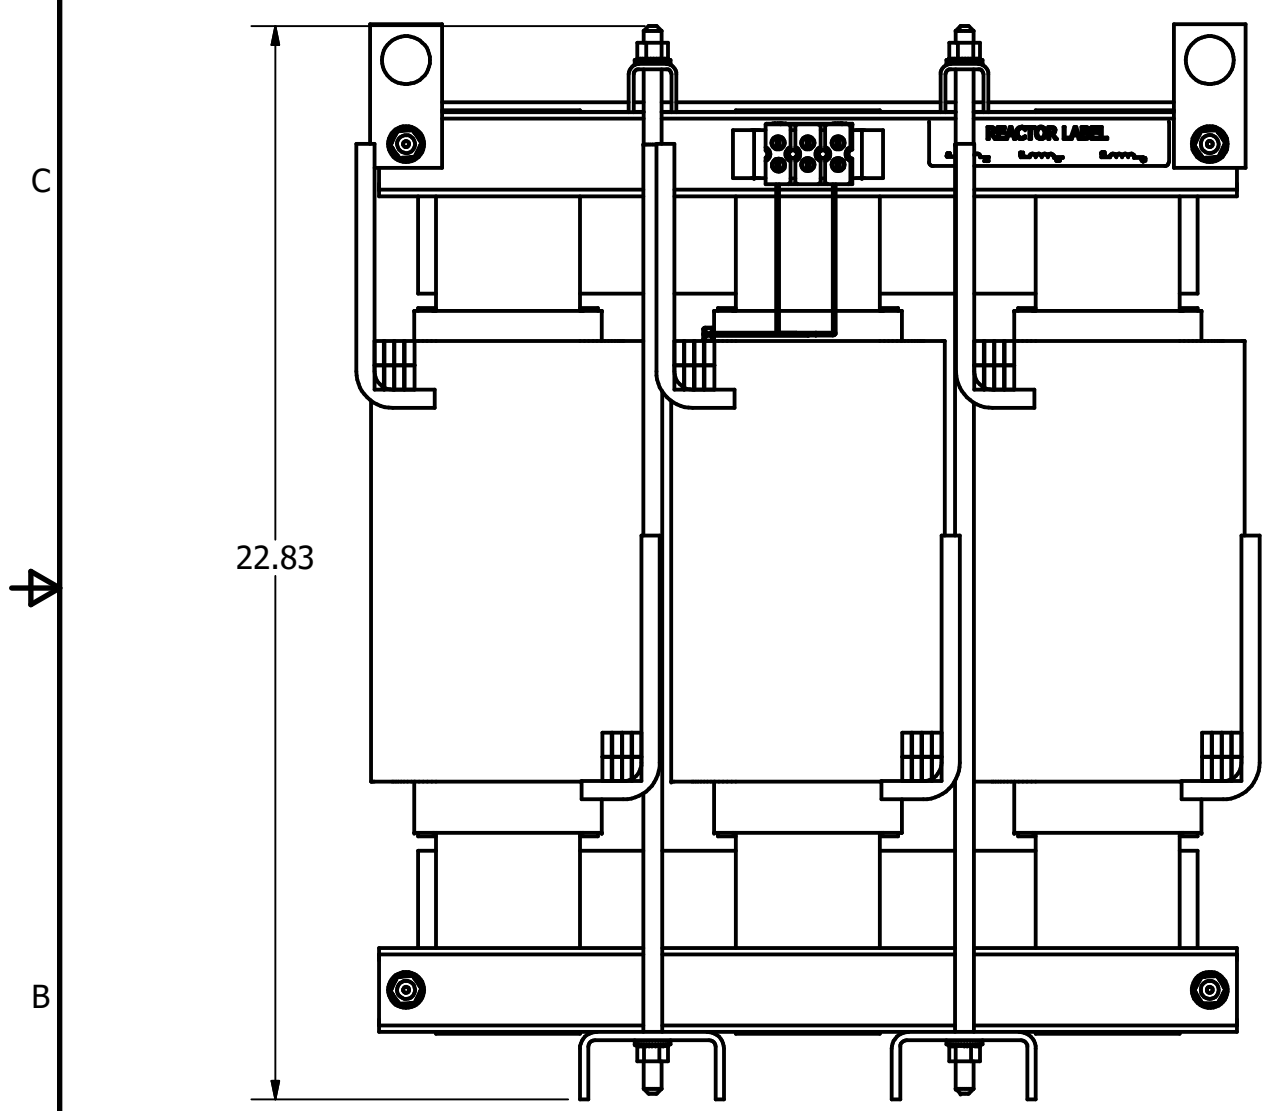
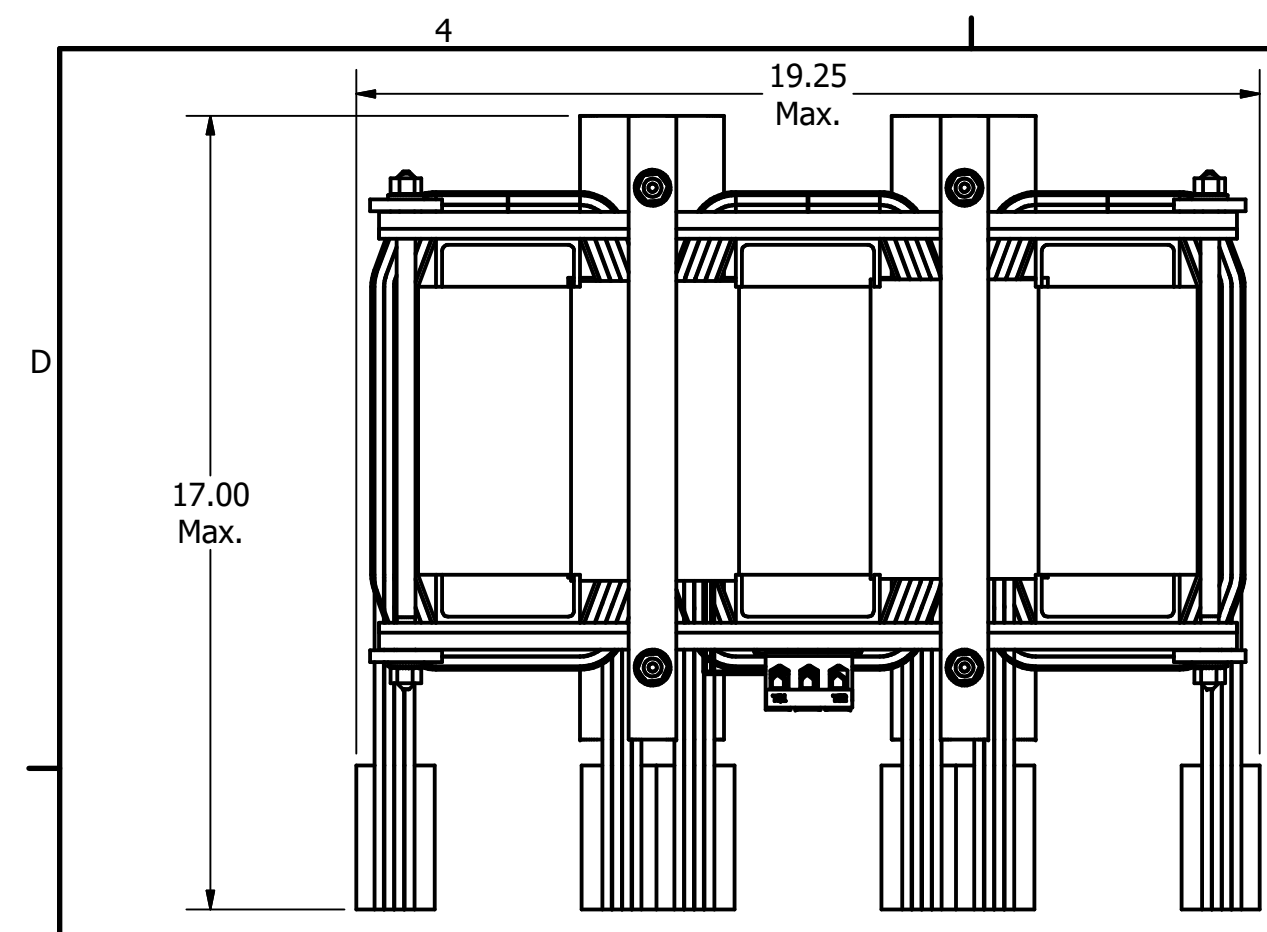
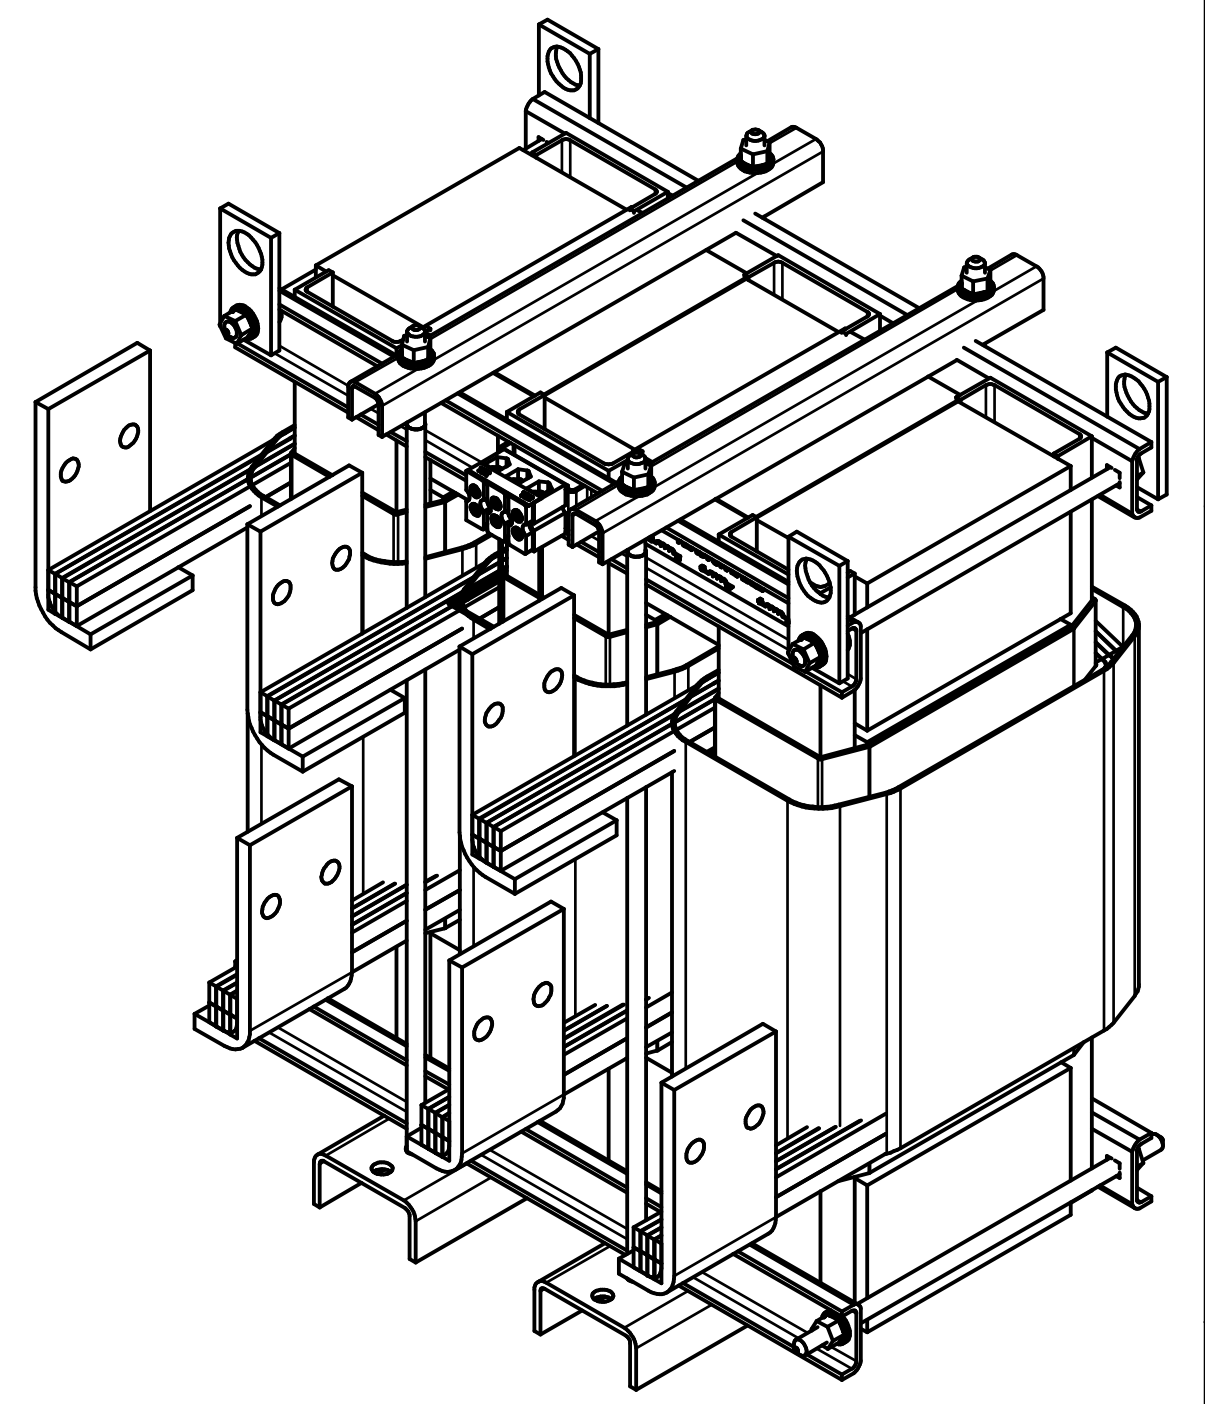


TCI Part Number	Rated Amps (A)	Rated Voltage (V)	Hz	---uH ±5%	Approx Weight (LBS)
KTRMG850A	850	480	60	57	575

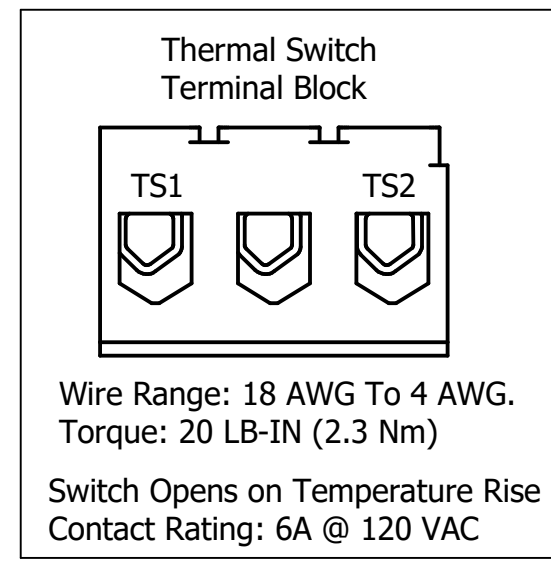

TCI, LLC
 Germantown, WI
 www.transcoll.com
 800-824-8282

(800) 824-8282 • transcoll.com

KDR Drive Reactor
 KTRMG— (Motor Amps) Or (Rating Amps)
 3 PH, 50/60Hz, 600V Max. —Max.
 40C Amb Max, 155C Res.

TCI, LLC CLAIMS PROPRIETARY RIGHTS IN THE MATERIAL HEREIN DISCLOSED. IT IS SUPPLIED WITHOUT PREJUDICE TO ANY PATENT RIGHTS OF TCI AND MAY NOT BE REPRODUCED OR USED TO MANUFACTURE ANYTHING SHOWN THEREIN WITHOUT WRITTEN PERMISSION FROM TCI.				TOLERANCES (EXCEPT AS NOTED) DECIMAL .XX ± .25 .XXX ± .10 FRACTIONAL ± 1/16 ANGULAR ± 1°		Material(s) Shall be RoHS Compliant	
A As Designed		01/29/20	JRN	W132 N10611 Grant Drive Germantown, WI 53022		Sinewave Reactor KTRMG850A, 480V, 700HP	
NO REVISION		DATE	BY	DRN BY: JRN	DATE: 01/29/20	108097-6DG	
				SCALE: 1/4	APRVD:	SIZE: C	SHT. 1 OF 1

Customer Is Responsible For Installation to Meet All National And Local Electrical Codes.