
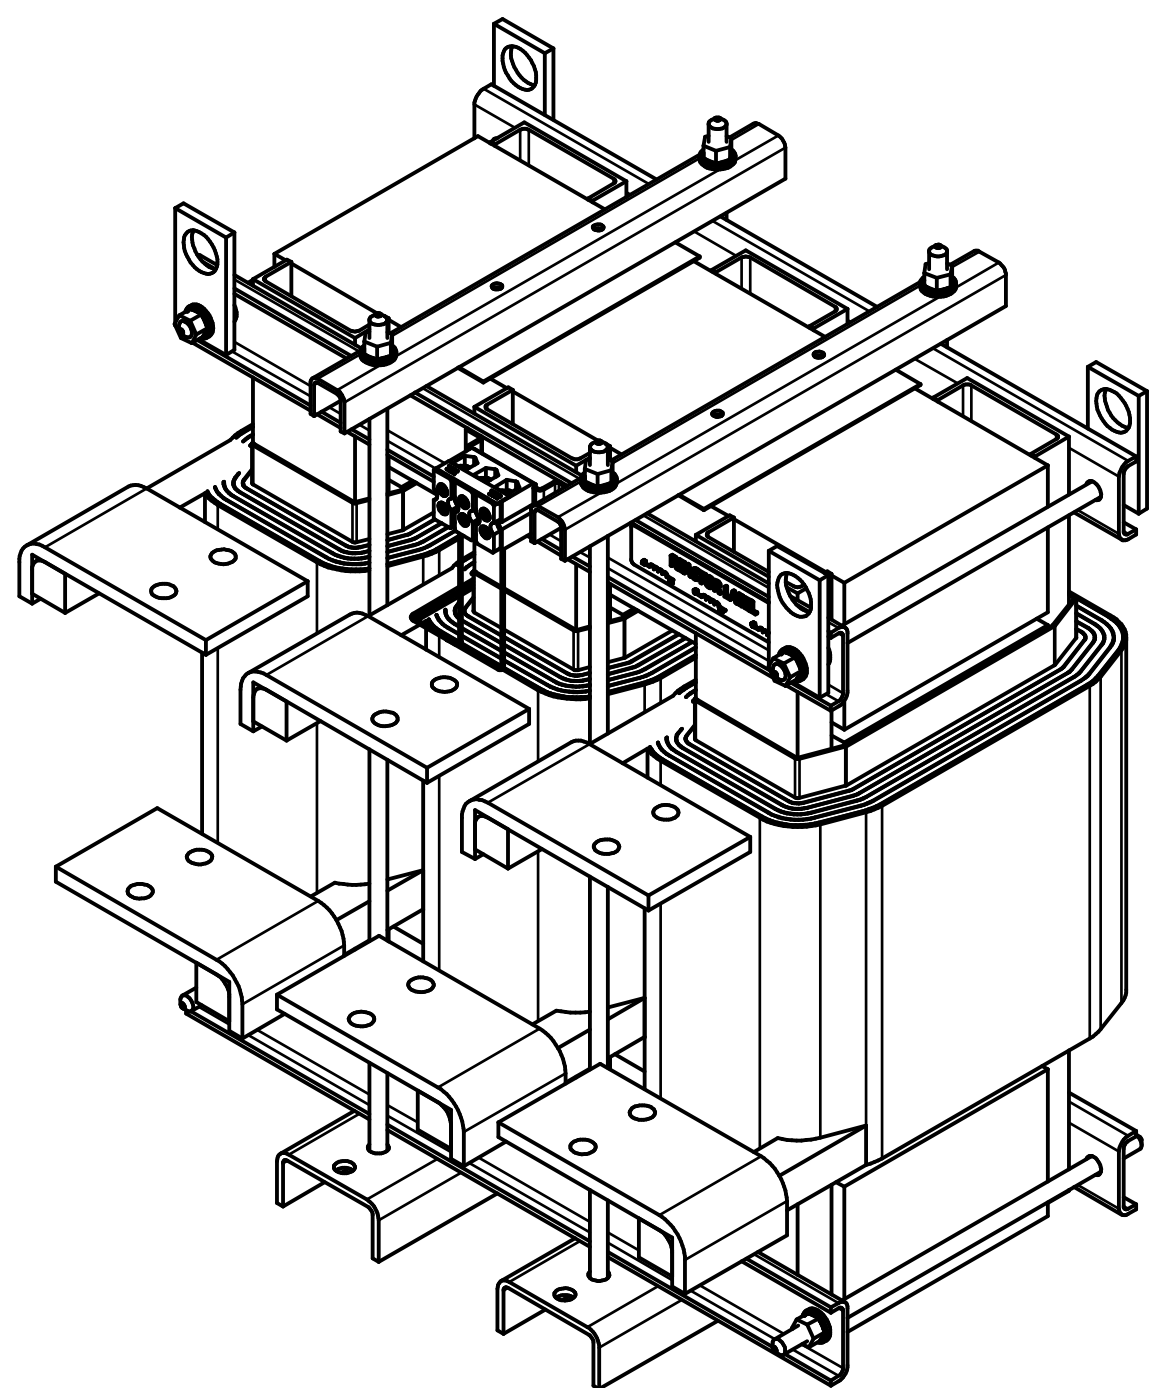
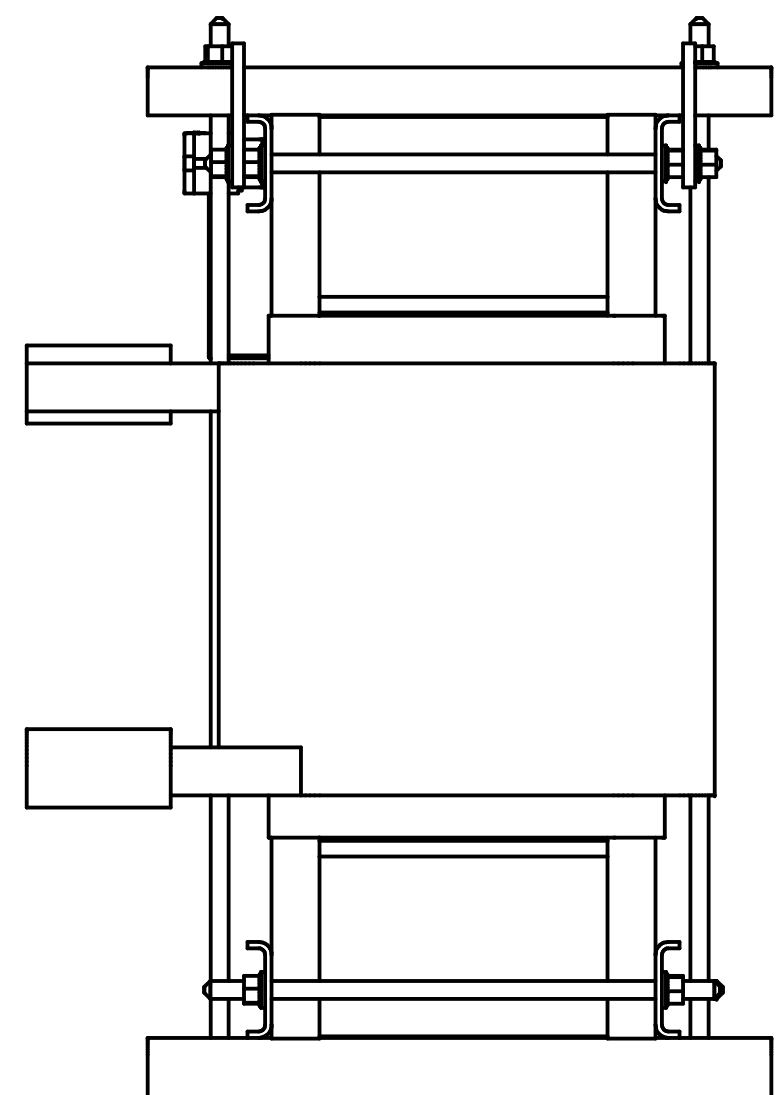


TCI Part Number	Amps (A)	Rated Voltage (V)	Hz	---uH ±5%	Approx Weight (LBS)
KTRMG960A	972	480	60	50	652

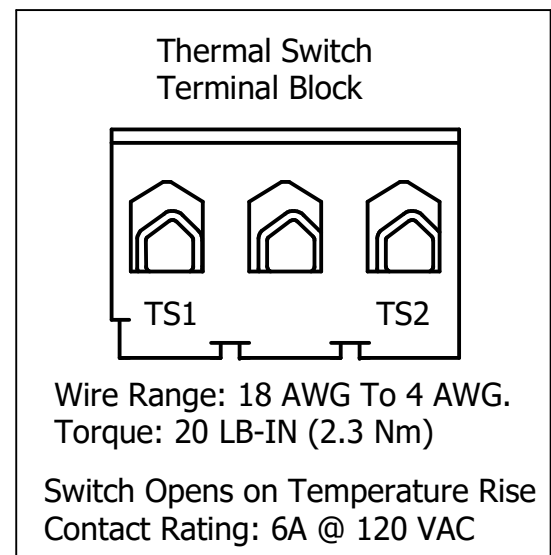

TCI, LLC
 Germantown, WI
 www.transcoll.com
 800-824-8282

(800) 824-8282 • transcoll.com

KDR Drive Reactor
KTRMG— (Motor Amps) Or (Rating Amps)
3 PH, 50/60Hz, 600V Max. —Max.
40C Amb Max, 155C Res.

TCI, LLC CLAIMS PROPRIETARY RIGHTS IN THE MATERIAL HEREIN DISCLOSED. IT IS SUPPLIED WITHOUT PREJUDICE TO ANY PATENT RIGHTS OF TCI AND MAY NOT BE REPRODUCED OR USED TO MANUFACTURE ANYTHING SHOWN THEREIN WITHOUT WRITTEN PERMISSION FROM TCI.				TOLERANCES (EXCEPT AS NOTED) DECIMAL .XX ± .25 .XXX ± .10 FRACTIONAL ± 1/16 ANGULAR ± 1°	
A As Designed		08/30/19	JRN	Material(s) Shall be RoHS Compliant	
NO REVISION		DATE	BY	TCI W132 N10611 Grant Drive Germantown, WI 53022 Sinewave Reactor KTRMG960A, 480V	
DRN BY JRN		DATE 08/30/19	108097-8DG		SIZE C
SCALE 1/4		APRVD:	SHT. 1 OF 1		SHT. 1 OF 1

Customer Is Responsible For Installation to Meet All National And Local Electrical Codes.