
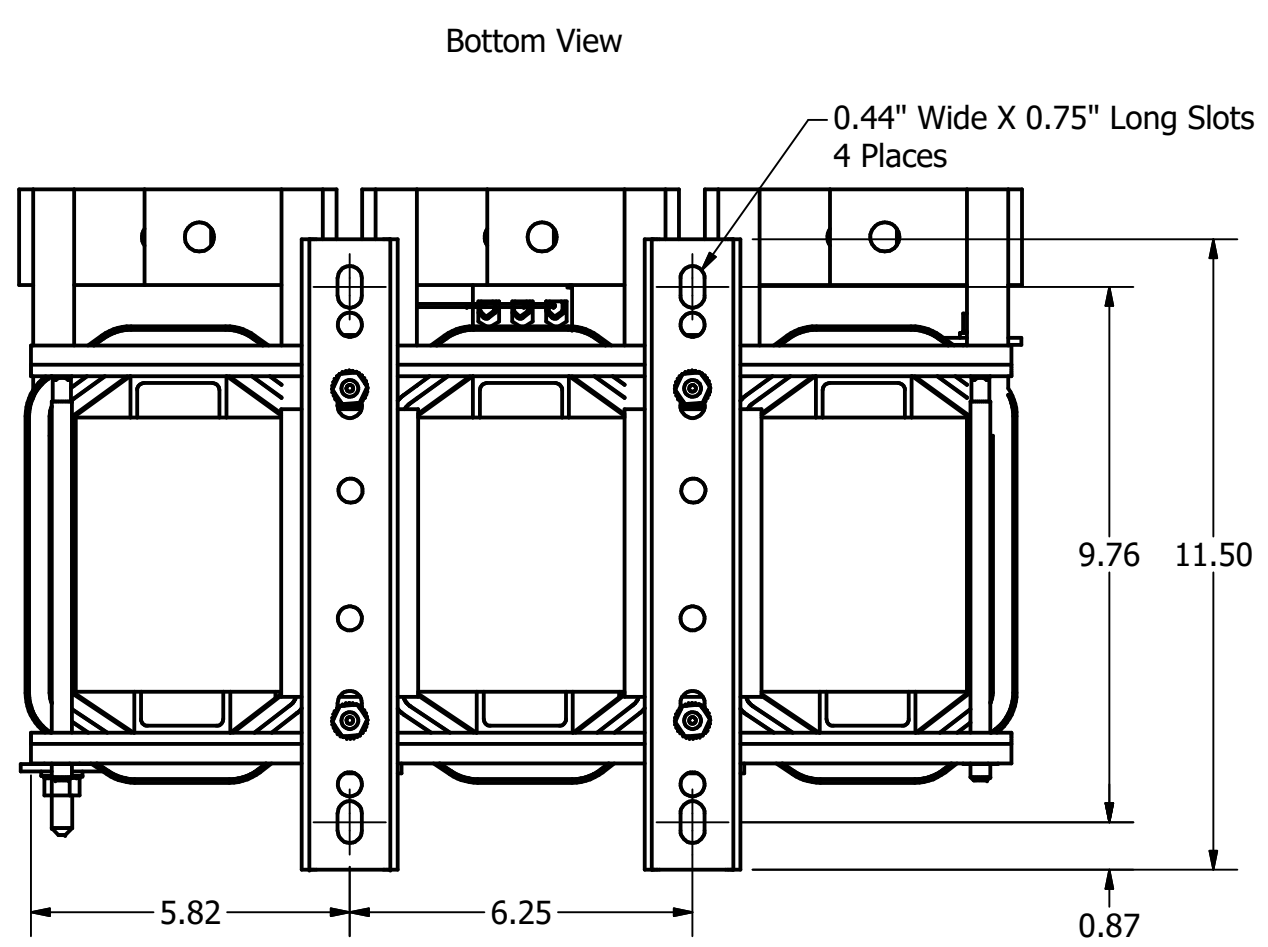
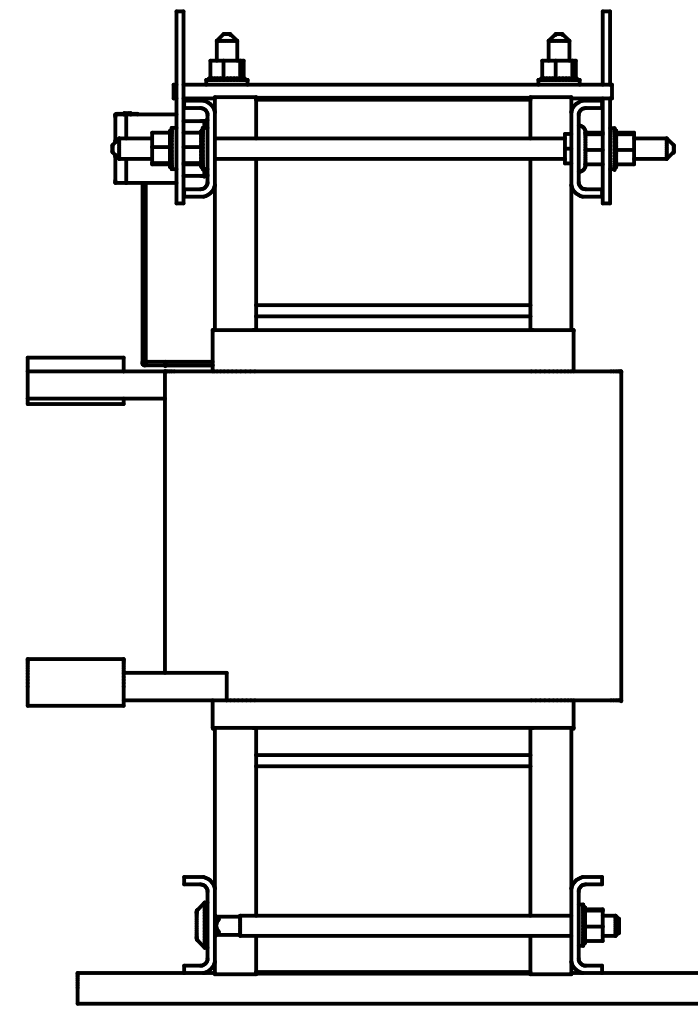
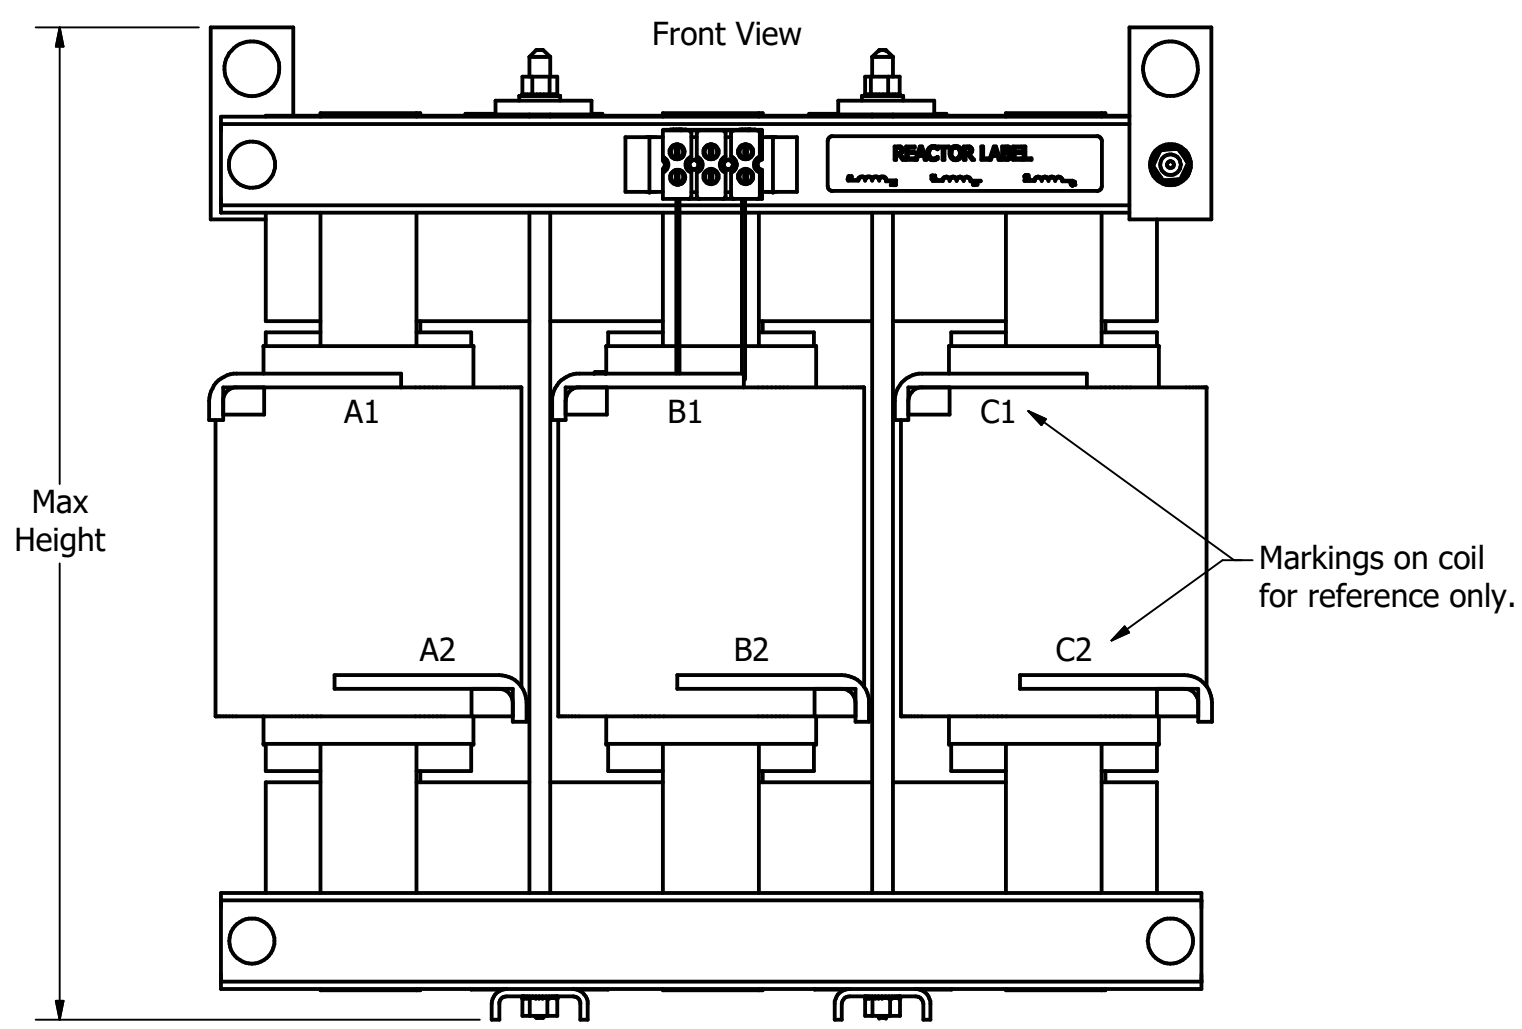
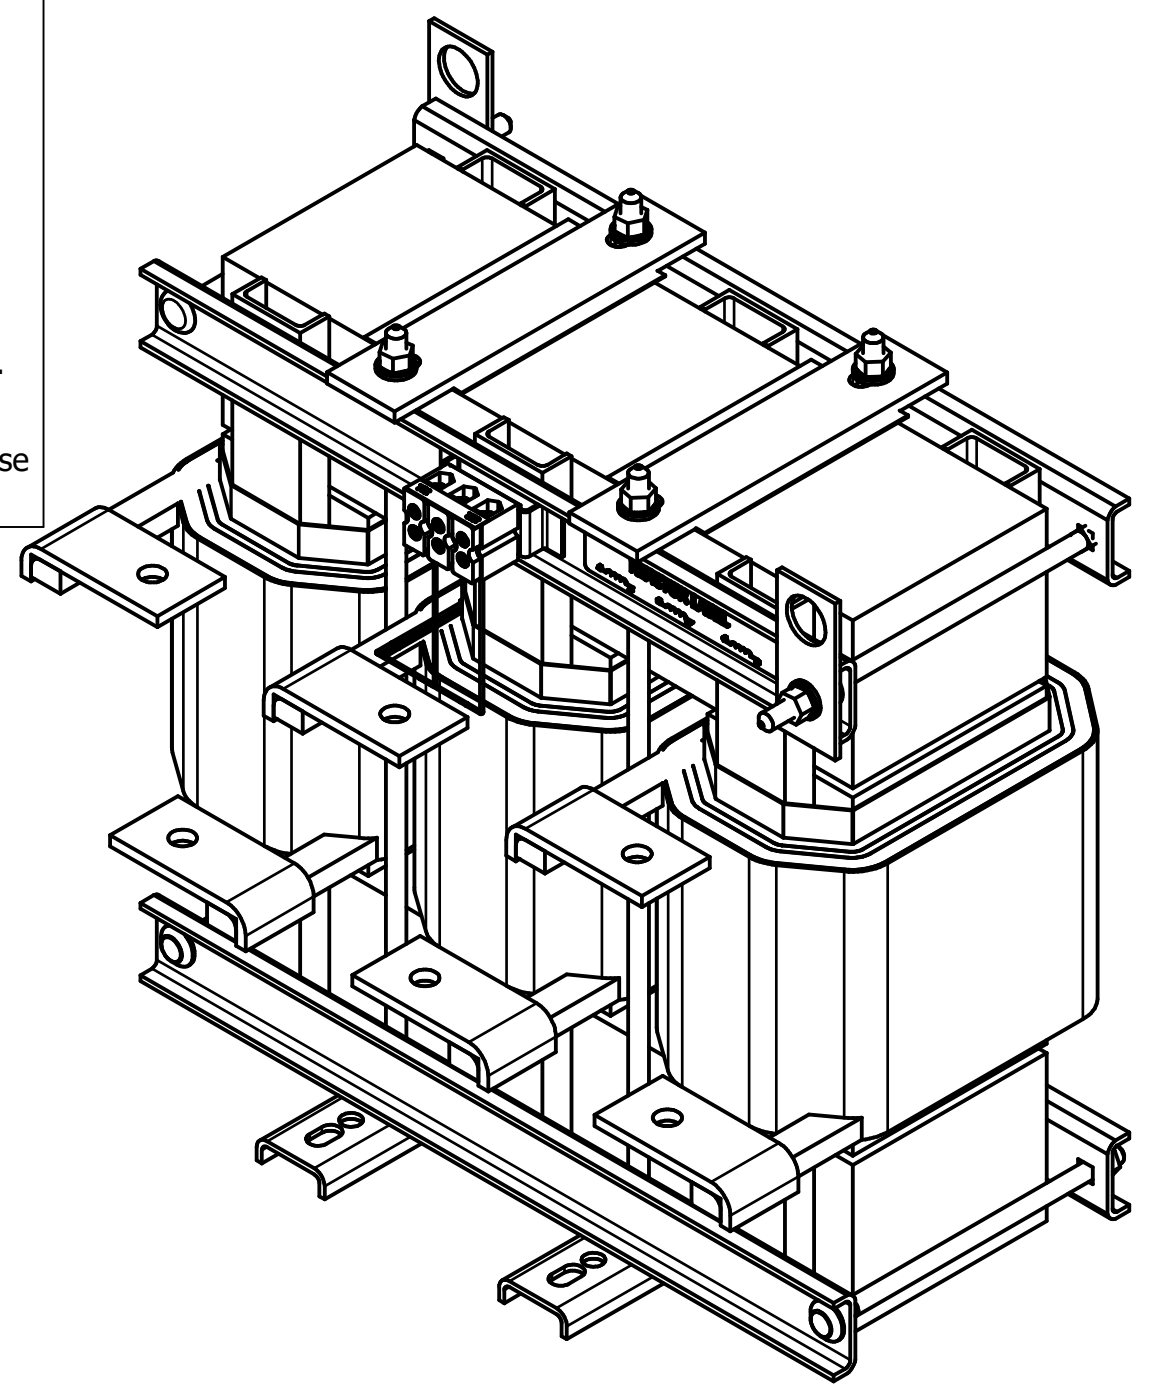
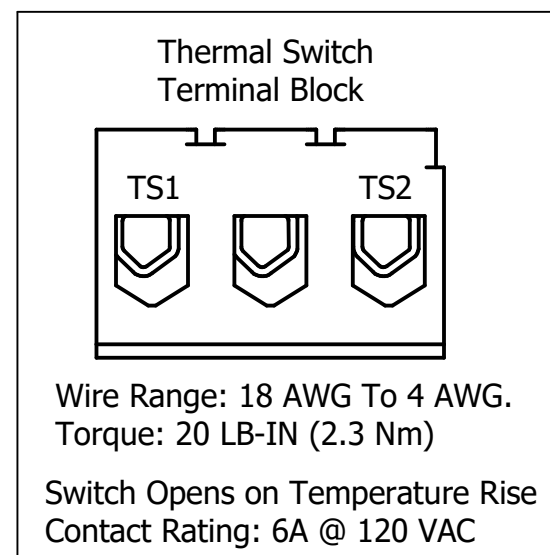


TCI Part Number	Rated Amps (A)	Rated Voltage (V)	Hz	---uH ±5%	Approx Weight (LBS)	Max Height (In)
KTRMG420A	420	480	60	114	400	18.50
KTRMG362C	362	600	60	165	465	22.00
KTRMG420C	420	600	60	142	450	21.50

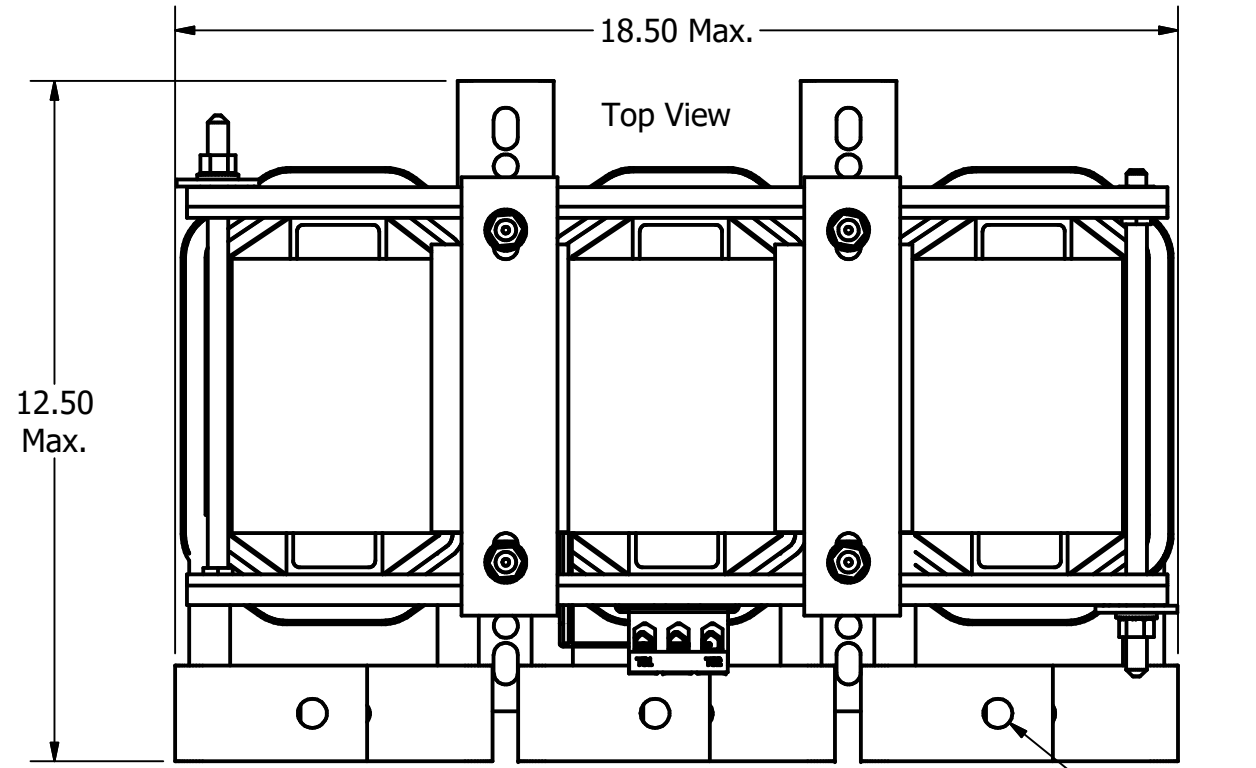

TCI, LLC
Germantown, WI
www.transcoll.com
800-824-8282

(800) 824-8282 • transcoll.com

KDR Drive Reactor
KTRMG— (Motor Amps) Or (Rating Amps)
3 PH, 50/60Hz, 600V Max. —Max.
40C Amb Max, 155C Rise.

Customer Is Responsible For Installation to Meet All National And Local Electrical Codes.

Material(s) Shall be RoHS Compliant

TCI, LLC CLAIMS PROPRIETARY RIGHTS IN THE MATERIAL HEREIN DISCLOSED. IT IS SUPPLIED WITHOUT PREJUDICE TO ANY PATENT RIGHTS OF TCI AND MAY NOT BE REPRODUCED OR USED TO MANUFACTURE ANYTHING SHOWN THEREIN WITHOUT WRITTEN PERMISSION FROM TCI.				TOLERANCES (EXCEPT AS NOTED)	W132 N10611 Grant Drive Germantown, WI 53022 KTRMG Y Frame, Copper Bus Reactor Drawing
				DECIMAL	
				.XX ± .25 .XXX ± .10	
				FRACTIONAL ± 1/16	
A As Designed	09/16/19	JRN	ANGULAR ± 1°	DRN BY JRN	DATE 09/16/19
NO REVISION	DATE	BY		SCALE 1/3.5	APRVD: 108097-9DG
				SIZE C	SHT. 1 OF 1