



| TCI Part Number | Rated Amps (A) | Total Loss (W) | ---mH+/-10% | Weight (LBS) | Terminal Hole Size (Inches) | Available Lug Kit |
|-----------------|----------------|----------------|-------------|--------------|-----------------------------|-------------------|
| KDRG2Q          | 305            | 149            | 0.024       | 65           | 0.56                        | SLK13             |
| KDRG3Q          | 362            | 225            | 0.024       | 65           | 0.56                        | SLK13             |


- Notes: 1. UL file number: cULus Listed File E116124.  
2. V1K Drive Reactors Comply With The Thermal and Altitude Standards Set Forth by NEMA ST20-1992.  
3. V1K IOM Manual Part Number 25316  
4. Material(s) Shall be RoHS Compliant  
5. Customer Is Responsible For Installation To Meet All National And Local Electrical Codes.

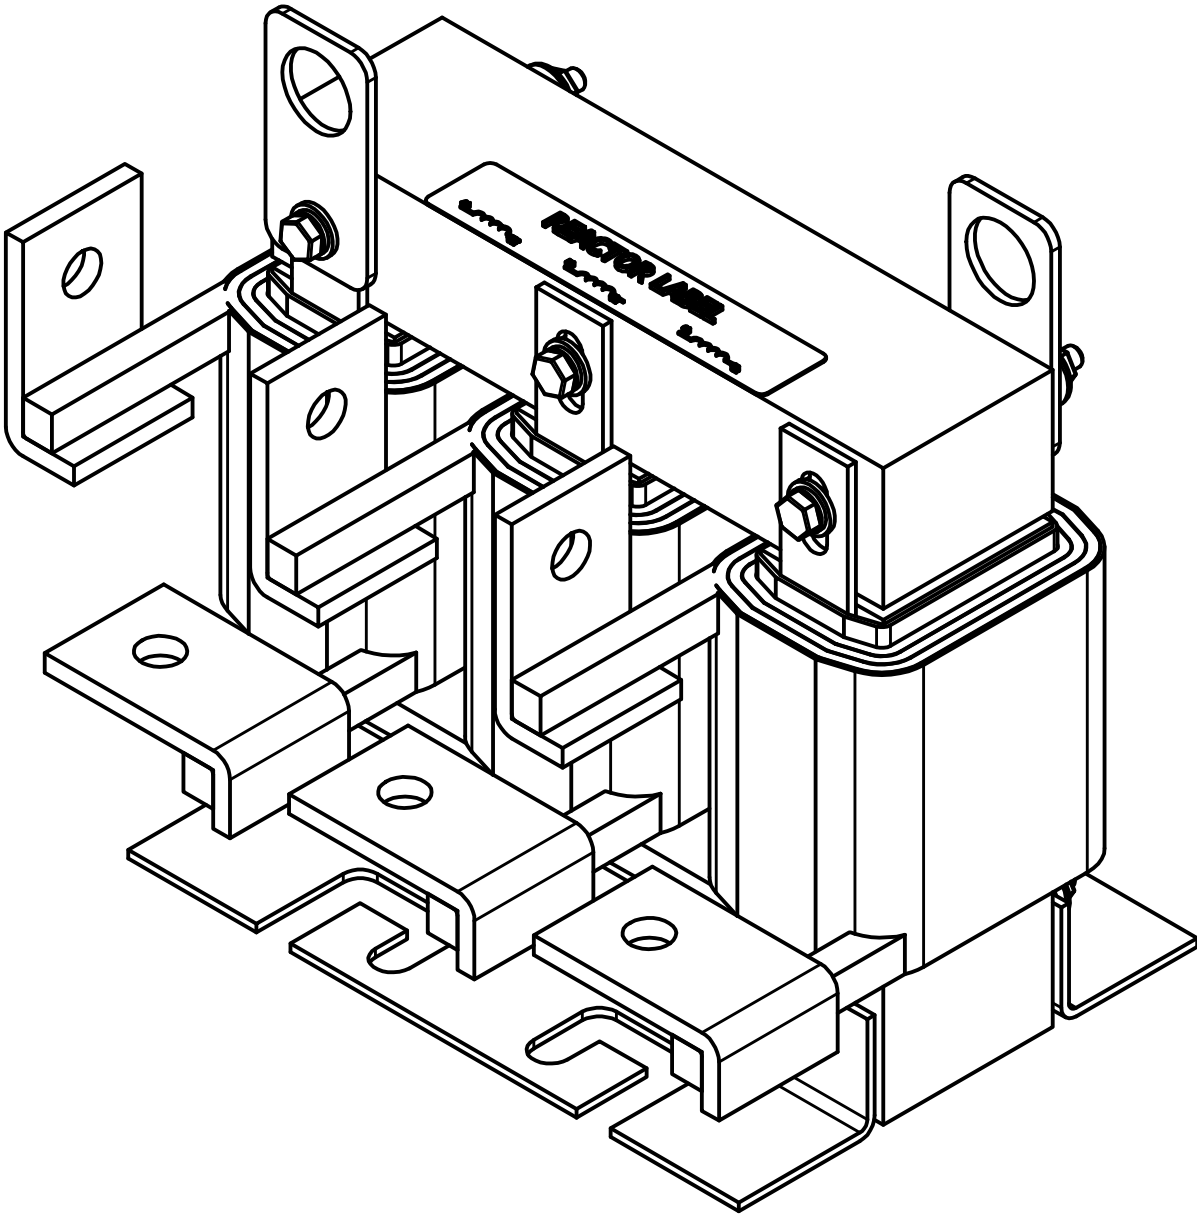

V1K SCHEMATIC

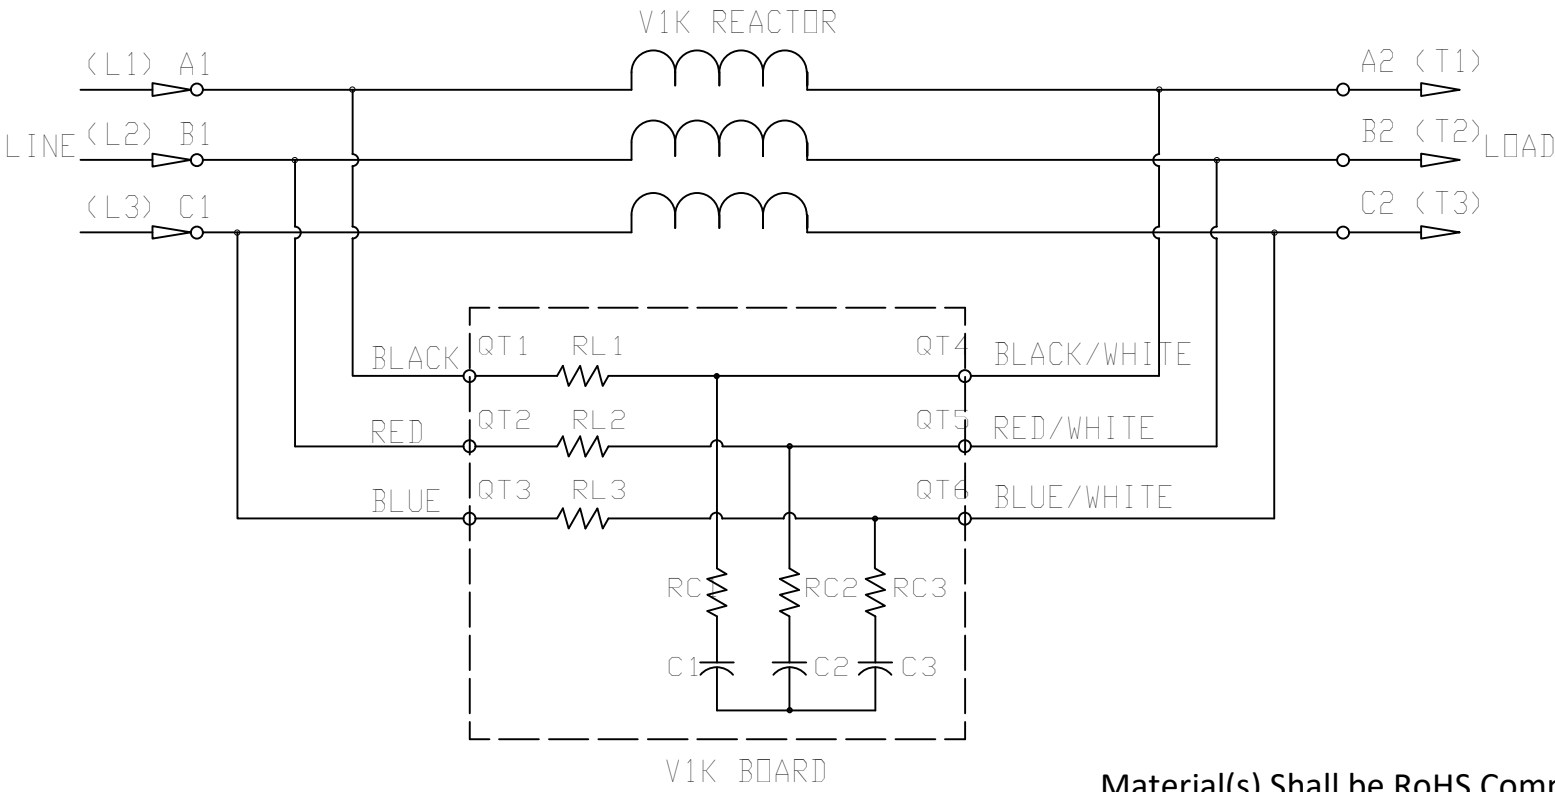

Material(s) Shall be RoHS Compliant

|  |             |            |     |                              |  |  |  |
|--|-------------|------------|-----|------------------------------|--|--|--|
| THE INFORMATION AND DESIGNS CONTAINED IN THIS DRAWING ARE CONFIDENTIAL AND THE PROPRIETARY PROPERTY OF ALLIED MOTION TECHNOLOGIES INC. AND ITS SUBSIDIARIES. NEITHER THIS DESIGN NOR ANY INFORMATION CONTAINED IN THIS DRAWING MAY BE REPRODUCED OR DISCLOSED TO OTHERS WITHOUT THE EXPRESS WRITTEN CONSENT OF ALLIED MOTION TECHNOLOGIES INC. AND ITS SUBSIDIARIES. |             |            |     | TOLERANCES (EXCEPT AS NOTED) |  | <br>W132N10611 Grant Drive<br>Germantown, WI 53022<br>© 2022 TCI, LLC |  |
|  |             |            |     | DECIMAL                      |  |  |  |
|  |             |            |     | .XX ± .25<br>.XXX ± .10      |  |  |  |
|  |             |            |     | FRACTIONAL<br>± 1/32         |  |  |  |
| A  | As Designed | 06/21/2022 | GJS | ANGULAR<br>± 1°              |  | DRN BY: GJS<br>SCALE: 1:2  | DATE: 06/21/2022<br>APRVD: 109188<br>SIZE: C |
| NO REVISION  |             | DATE       | BY  |                              |  | SHT. 1 OF 1  |  |

CUSTOMER IS RESPONSIBLE FOR INSTALLATION TO MEET ALL NATIONAL AND LOCAL ELECTRICAL CODES.