

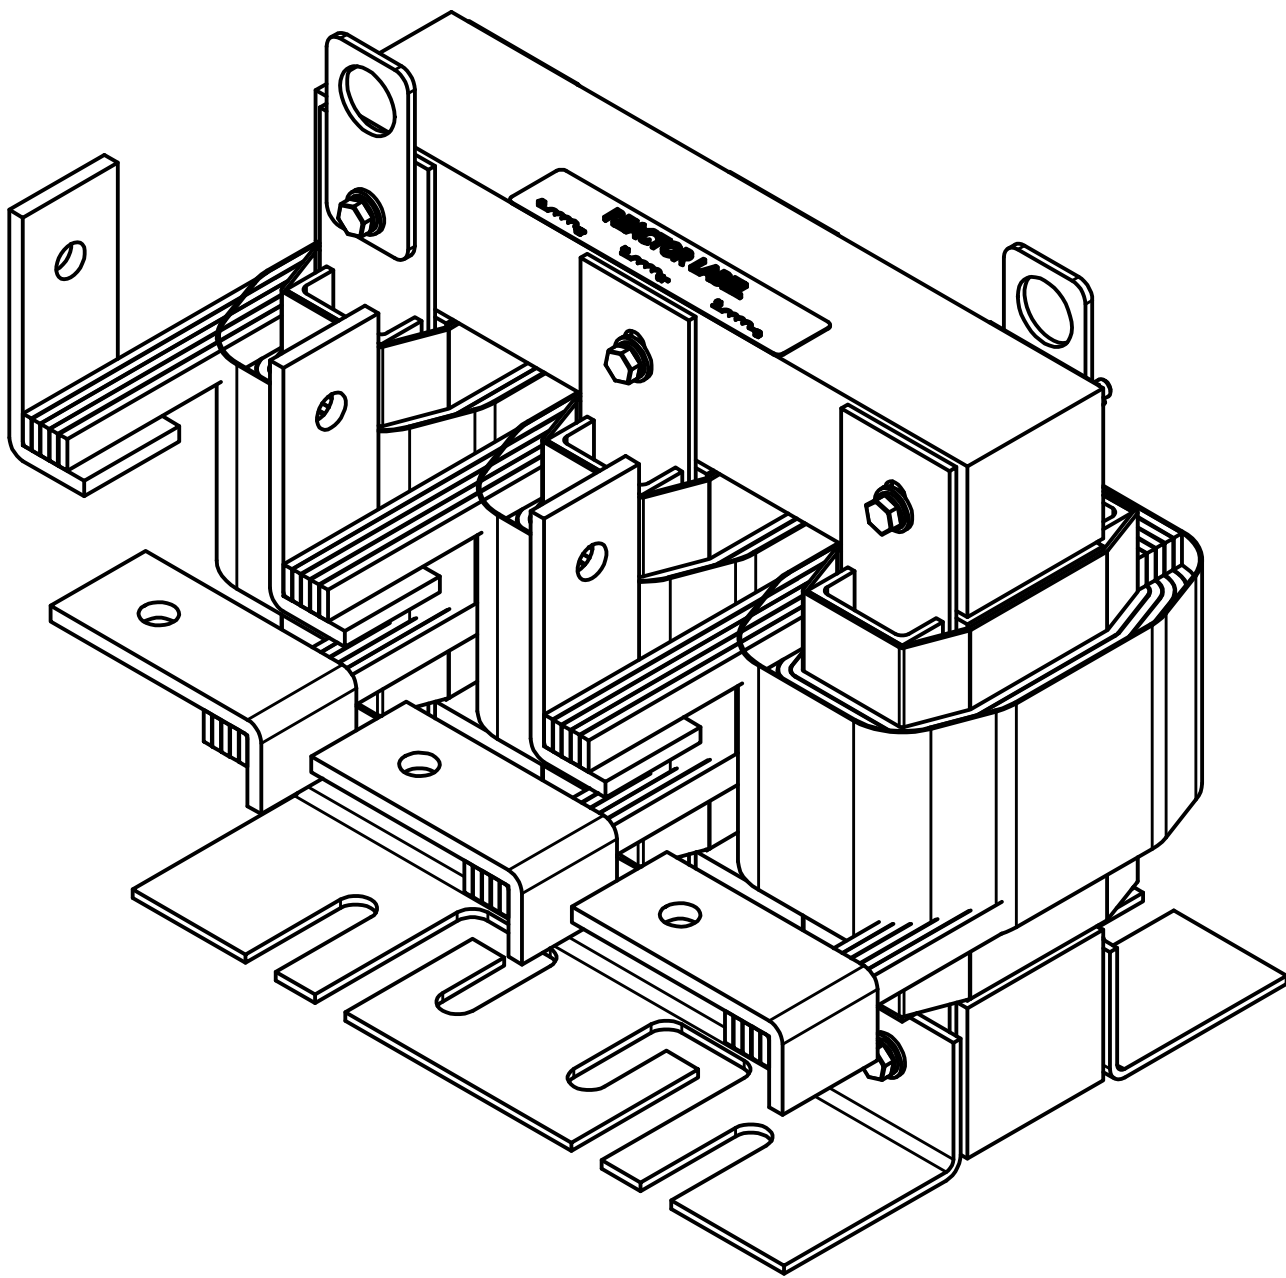
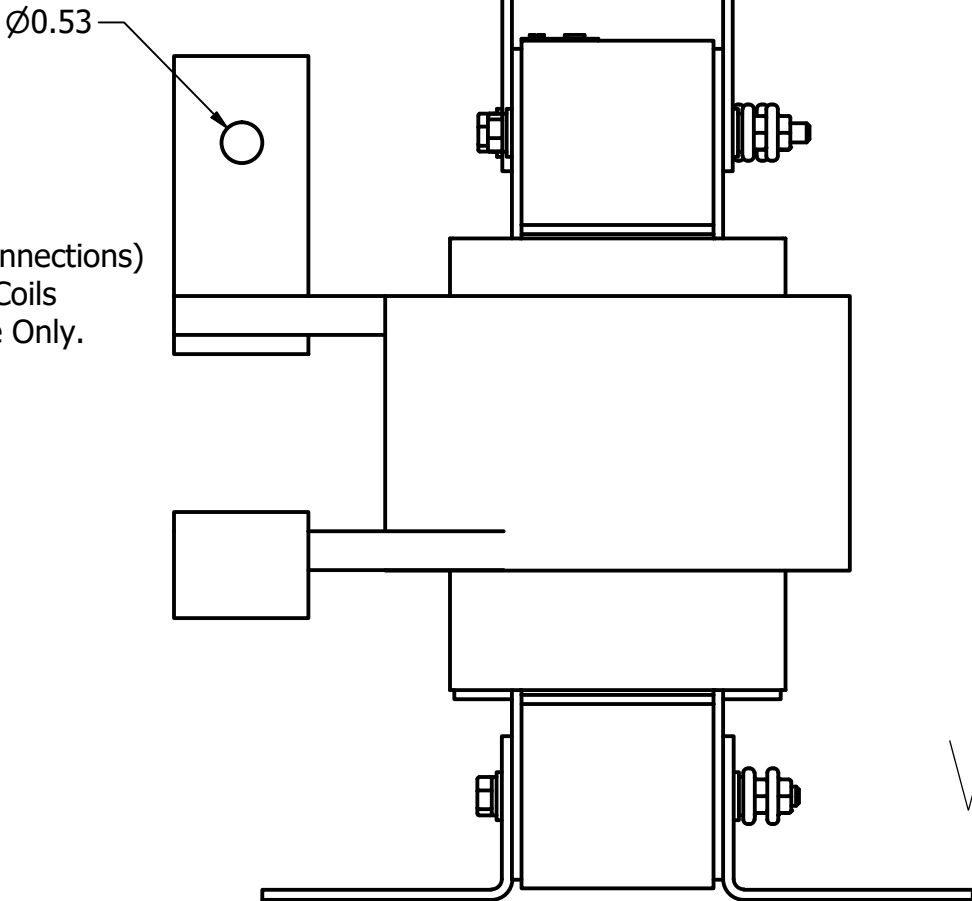
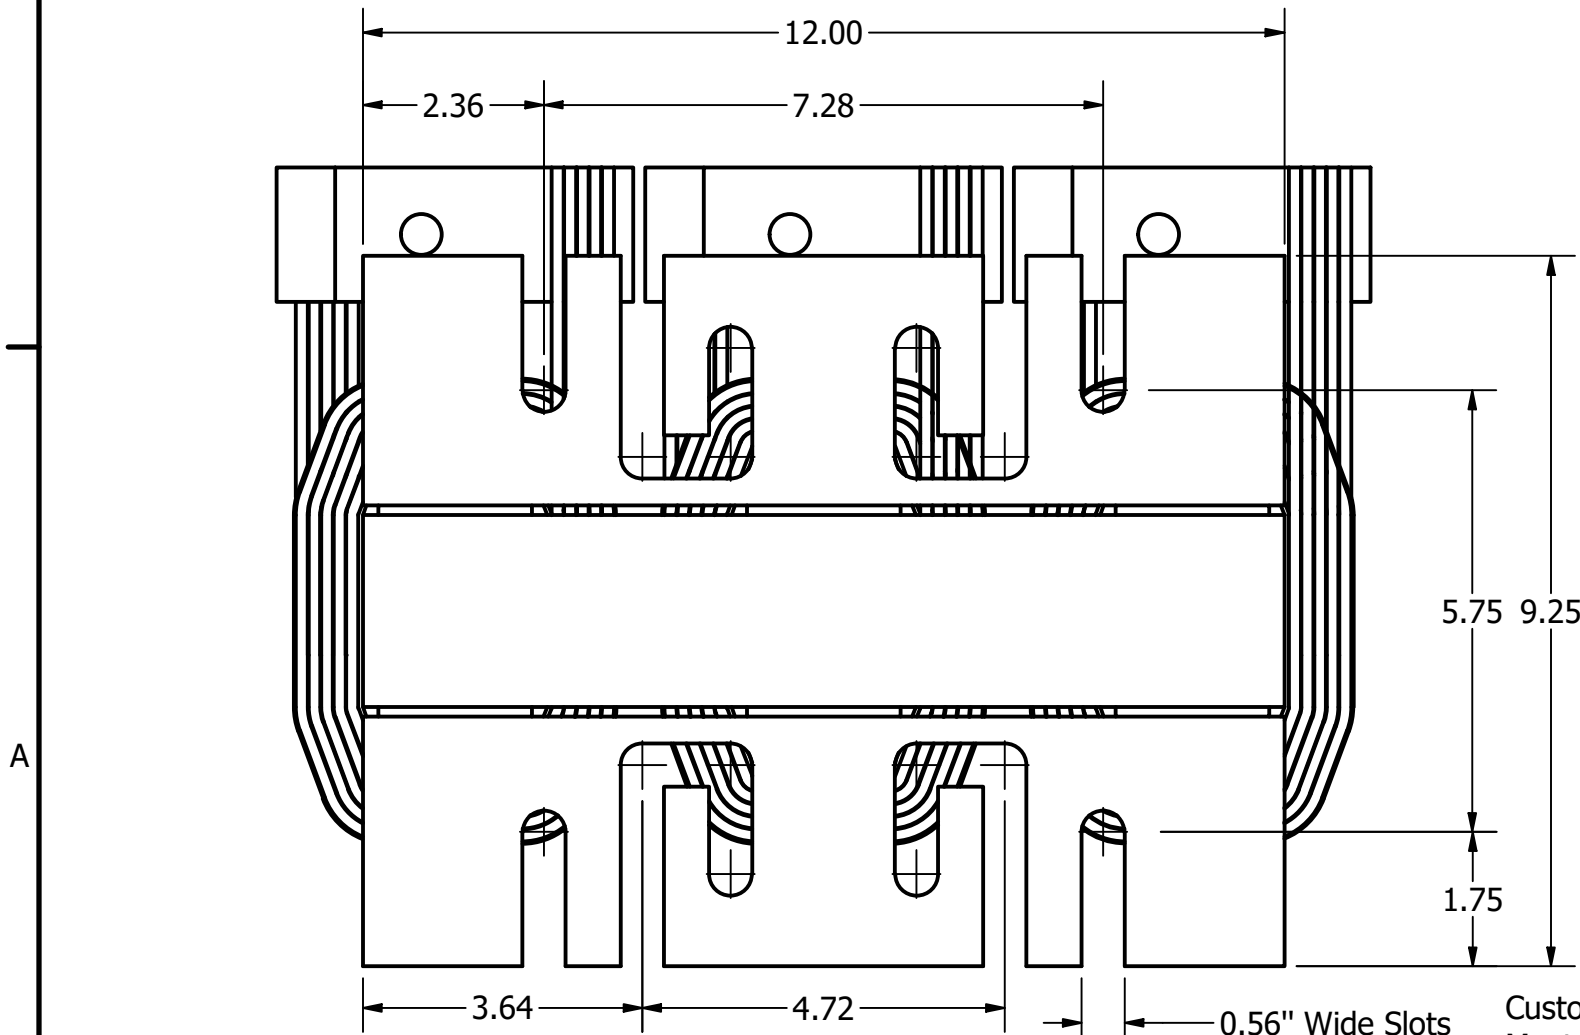
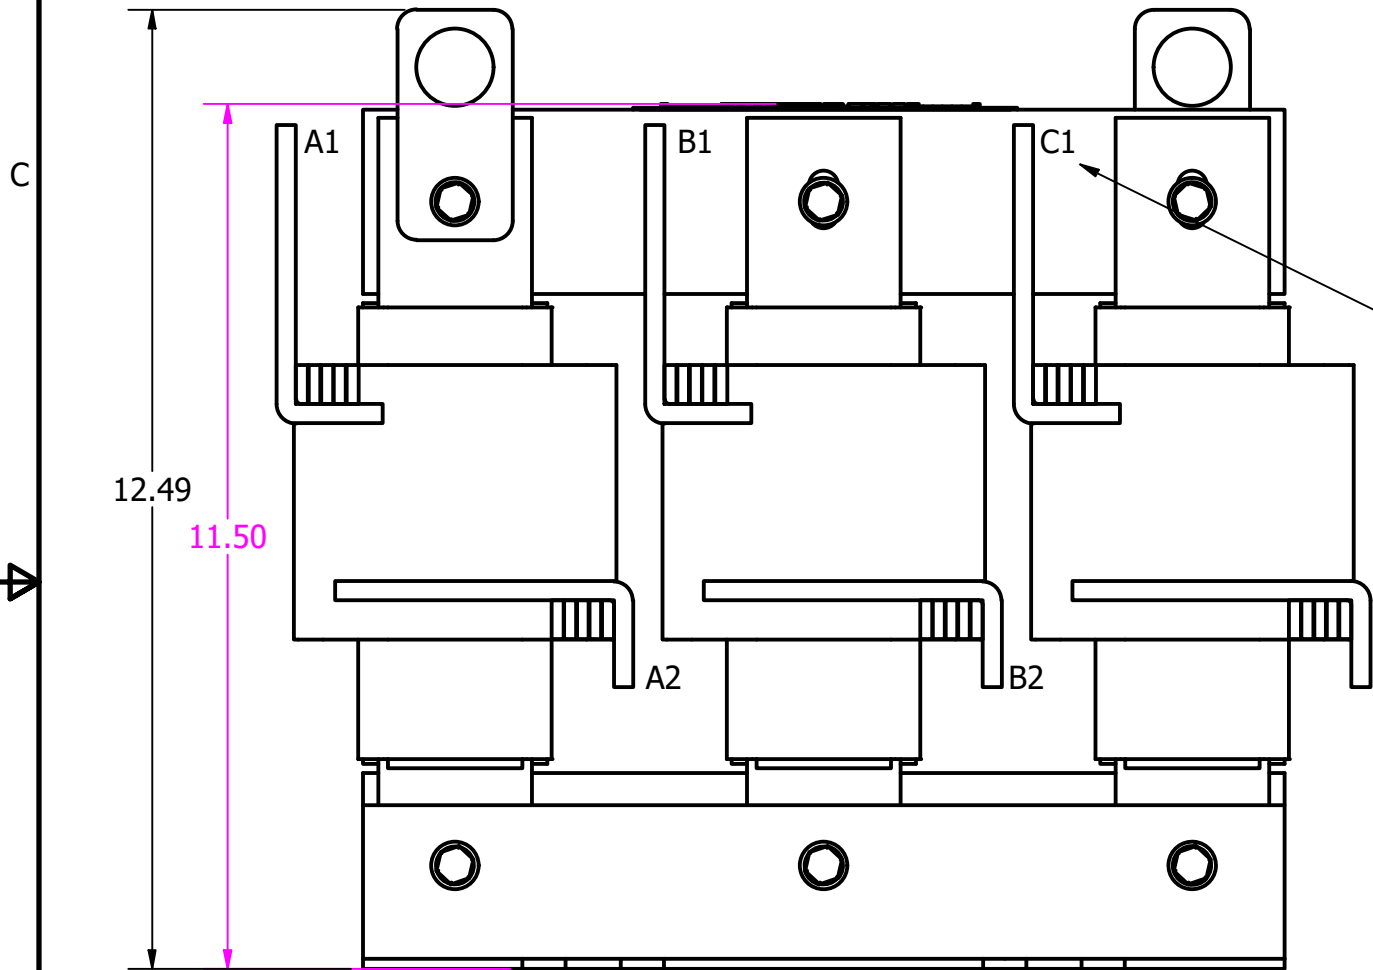


TCI Part Number	Rated Amps (A)	Total Loss (W)	---mH+/-10%	Weight (LBS)	Terminal Hole Size (Inches)	Available Lug Kit
KDRL4Q	600	307	0.0168	120	0.53	SLK14

- Notes: 1. UL file number: cULus Listed File E116124.
2. V1K Drive Reactors Comply With The Thermal and Altitude Standards Set Forth by NEMA ST20-1992.
3. V1K IOM Manual Part Number 25316
4. Material(s) Shall be RoHS Compliant
5. Customer Is Responsible For Installation To Meet All National And Local Electrical Codes.

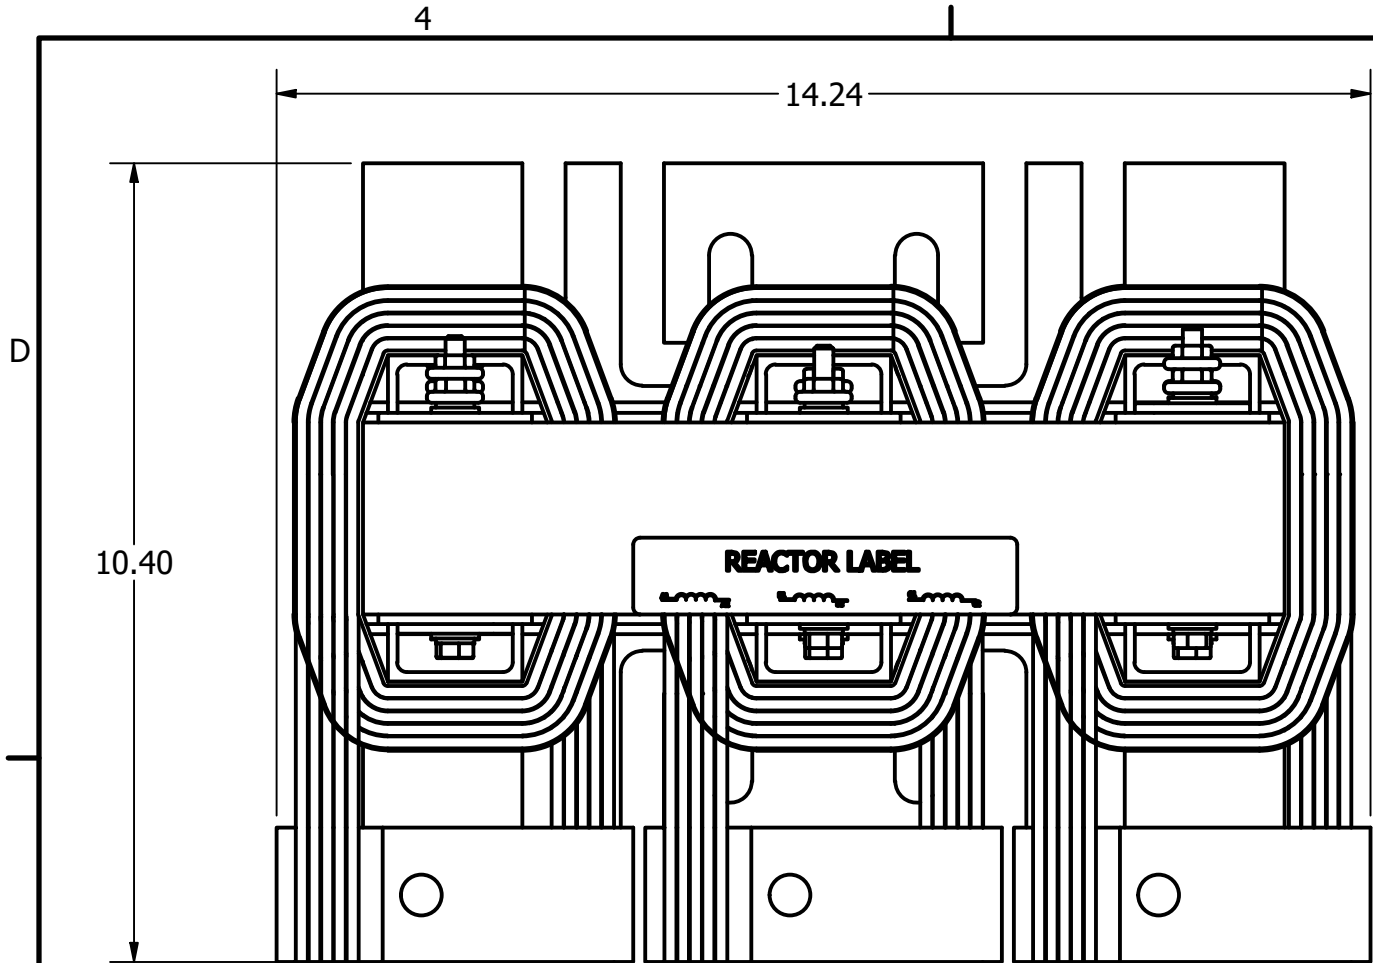

V1K SCHEMATIC

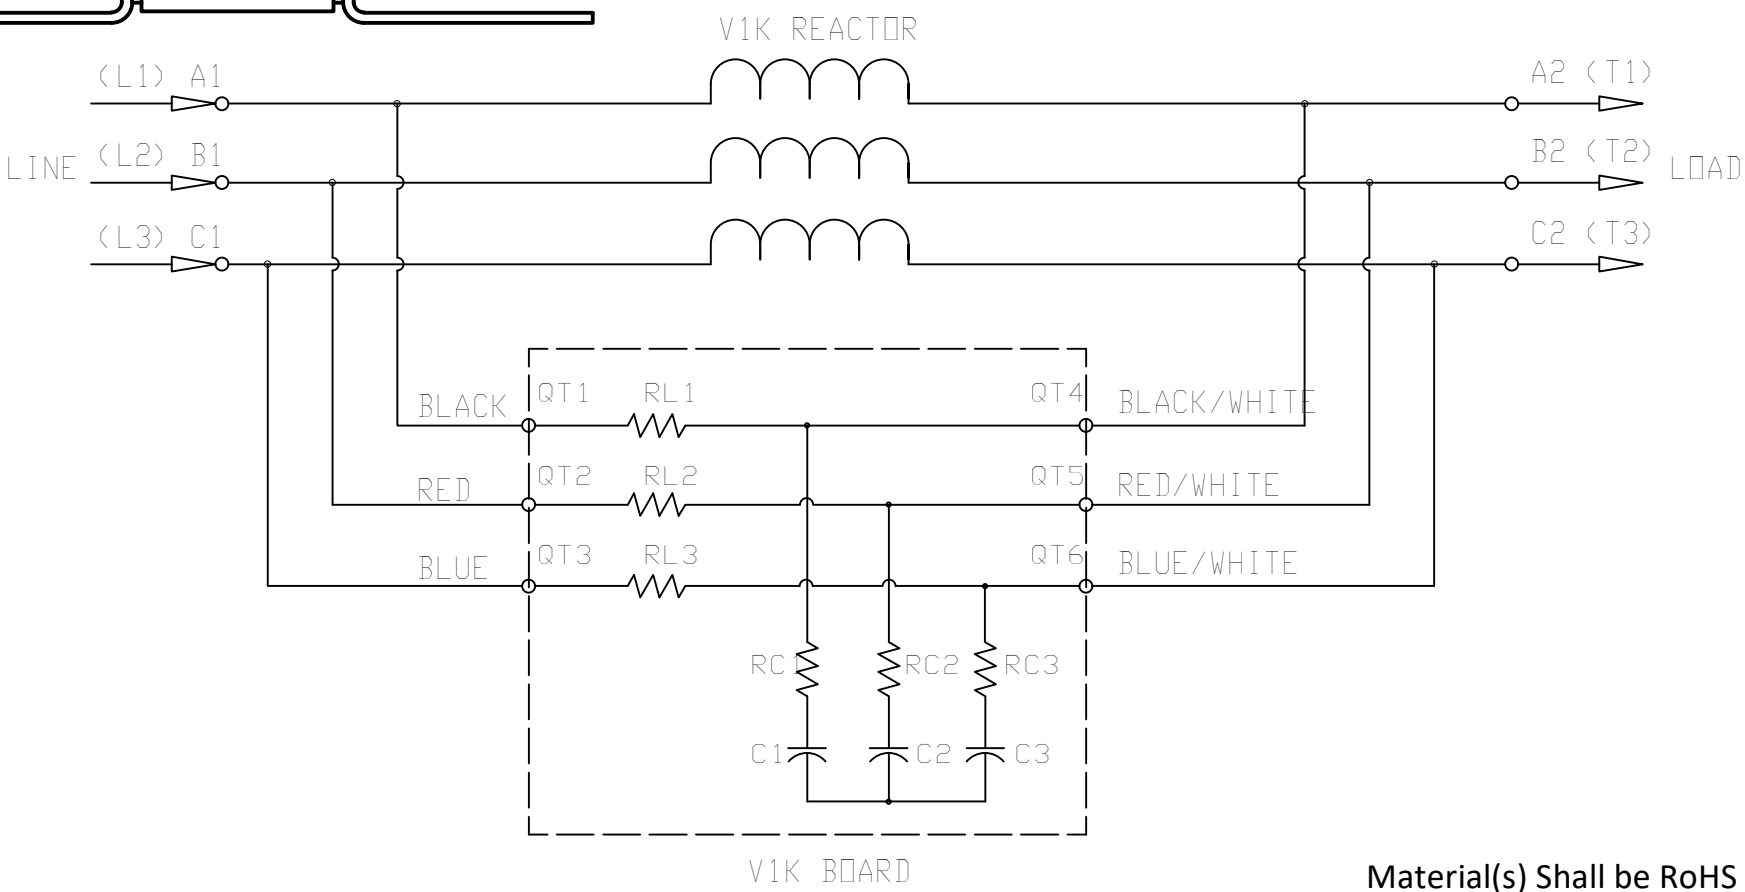

THE INFORMATION AND DESIGNS CONTAINED IN THIS DRAWING ARE CONFIDENTIAL AND THE PROPRIETARY PROPERTY OF ALLIED MOTION TECHNOLOGIES INC. AND ITS SUBSIDIARIES. NEITHER THIS DESIGN NOR ANY INFORMATION CONTAINED IN THIS DRAWING MAY BE REPRODUCED OR DISCLOSED TO OTHERS WITHOUT THE EXPRESS WRITTEN CONSENT OF ALLIED MOTION TECHNOLOGIES INC. AND ITS SUBSIDIARIES.

NO	REVISION	DATE	BY
A	AS DESIGNED	06/21/2022	GJS

TOLERANCES (EXCEPT AS NOTED)
DECIMAL
.XX ± .25
.XXX ± .10
FRACTIONAL
± 1/32
ANGULAR
± 1°

Material(s) Shall be RoHS Compliant

TCI
An Allied Motion Company

W132N10611 Grant Drive
Germantown, WI 53022
© 2022 TCI, LLC

KDR, V1K Output Inductor
600 Amps Max 480V

DRN: BY GJS DATE: 06/21/2022 109190
SCALE: 1:2 APRVD: SIZE C SHT.1 OF 1

Customer Is Responsible For Installation to Meet All National And Local Electrical Codes.