
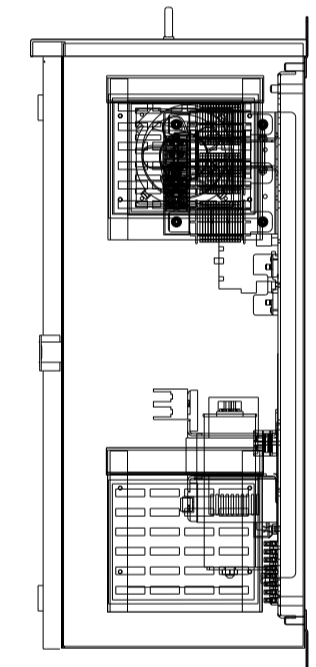
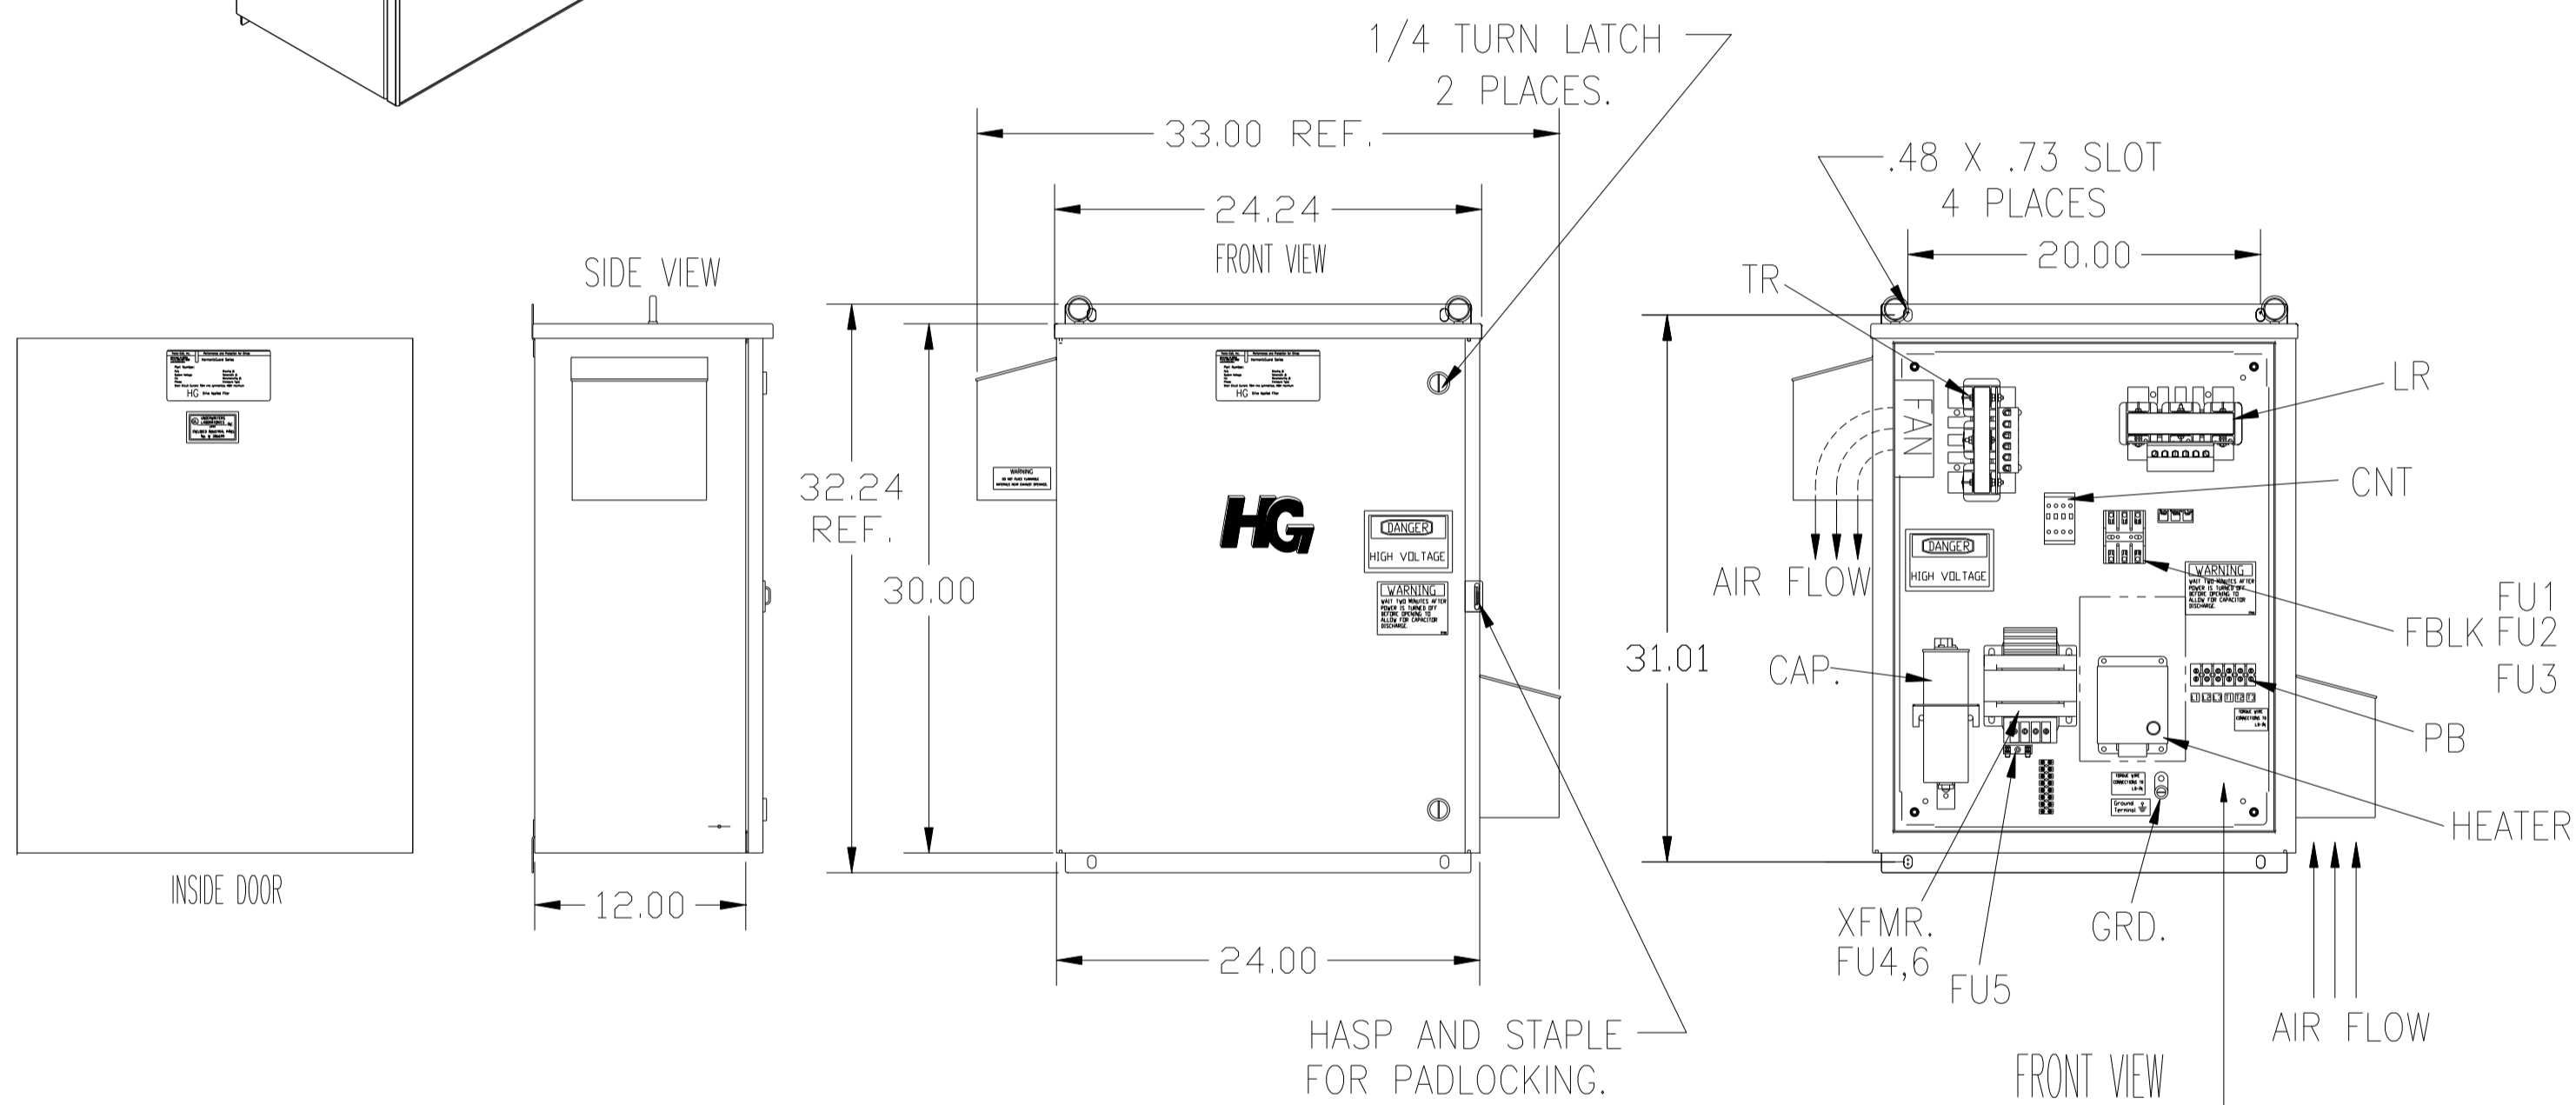
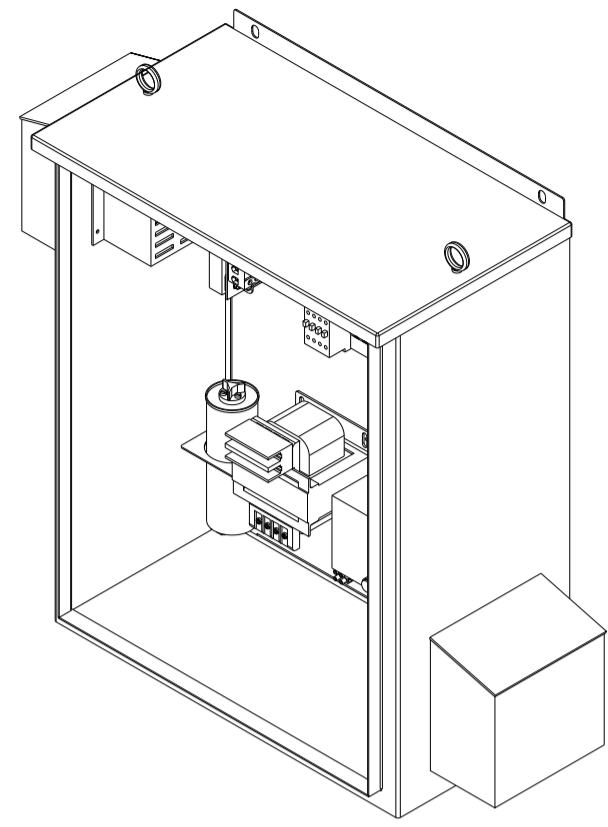


CUSTOMER IS RESPONSIBLE FOR INSTALLATION  
TO MEET ALL NATIONAL AND LOCAL ELECTRICAL CODES.  
NOTE: USE ONLY HUBS OR FITTINGS THAT COMPLY  
WITH UL514B FOR TYPE 3R ENCLOSURES.  
SEE DWG# 26750 FOR SCHEMATIC

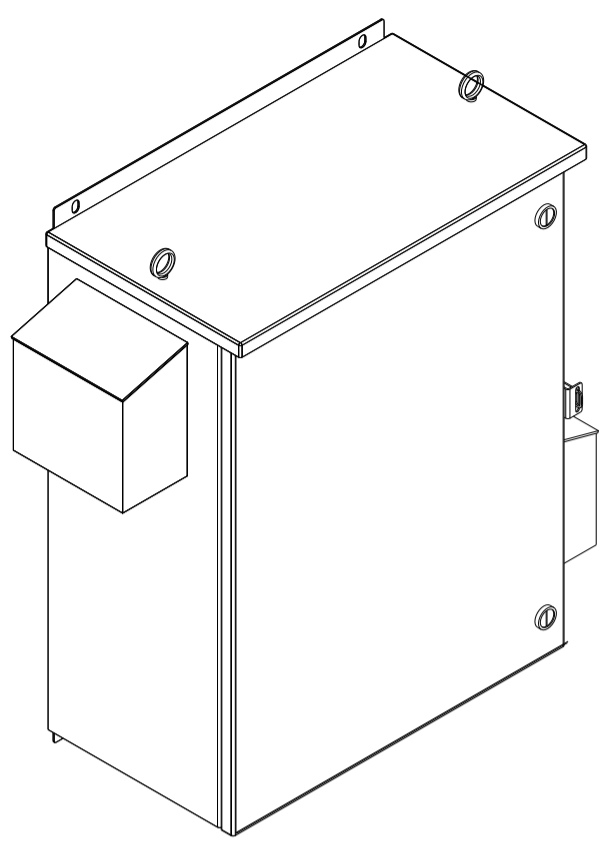

UNIT SPECIFICATIONS:					
KVAR	HARMONIC	VOLT	HZ	PHASE	HP
3	5TH	480	60	3	10
ENCLOSURE		UL TYPE 3R			
COLOR		WHITE			
APPROX.WT. LBS.		113			


SYMBOL	TCI PART NUMBER
LR	KDRE1T
TR	KTR3A65HG
CAP. (3 KVAR)	KCAP3A6A
XFMR.	23896
Fu1, 2, 3	11262
Fu4,6	24009
Fu5	17567
CNT	26739
HEATER (200 WATT)	11638

FRONT VIEW  
WITHOUT DOOR

L1 L2 L3 T1 T2 T3  
SUGGESTED CUSTOMER WIRE ENTRY  
AND EXIT LOCATION

PB-POWER INPUT BLOCK:  
WIRE RANGE-#18 TO #4 AWG.  
TIGHTENING TORQUE 20 IN-LB.

GROUND LUG:  
WIRE RANGE-1/0 TO #14 AWG.  
TIGHTENING TORQUE 200 IN-LB.

				TOLERANCES (EXCEPT AS NOTED)	 7878 N. 86th STREET MILWAUKEE, WI 53224		
				DECIMAL			
				.XX ± .12	HG10AW03STCH, 10HP 480/3/60 UL TYPE 3R		
				.XXX± .06			
				FRACTIONAL ± 1/32	DRN. BY DSW      DATE 8/20/08      DWG. NO. 103721DG SCALE TO FIT      APPRVD. C      SHT. 1 OF 1		
A	2641 ADD EYEBOLTS	10/21/09	DSW	ANGULAR ± 1/2°			
NO	REVISION	DATE	BY				