
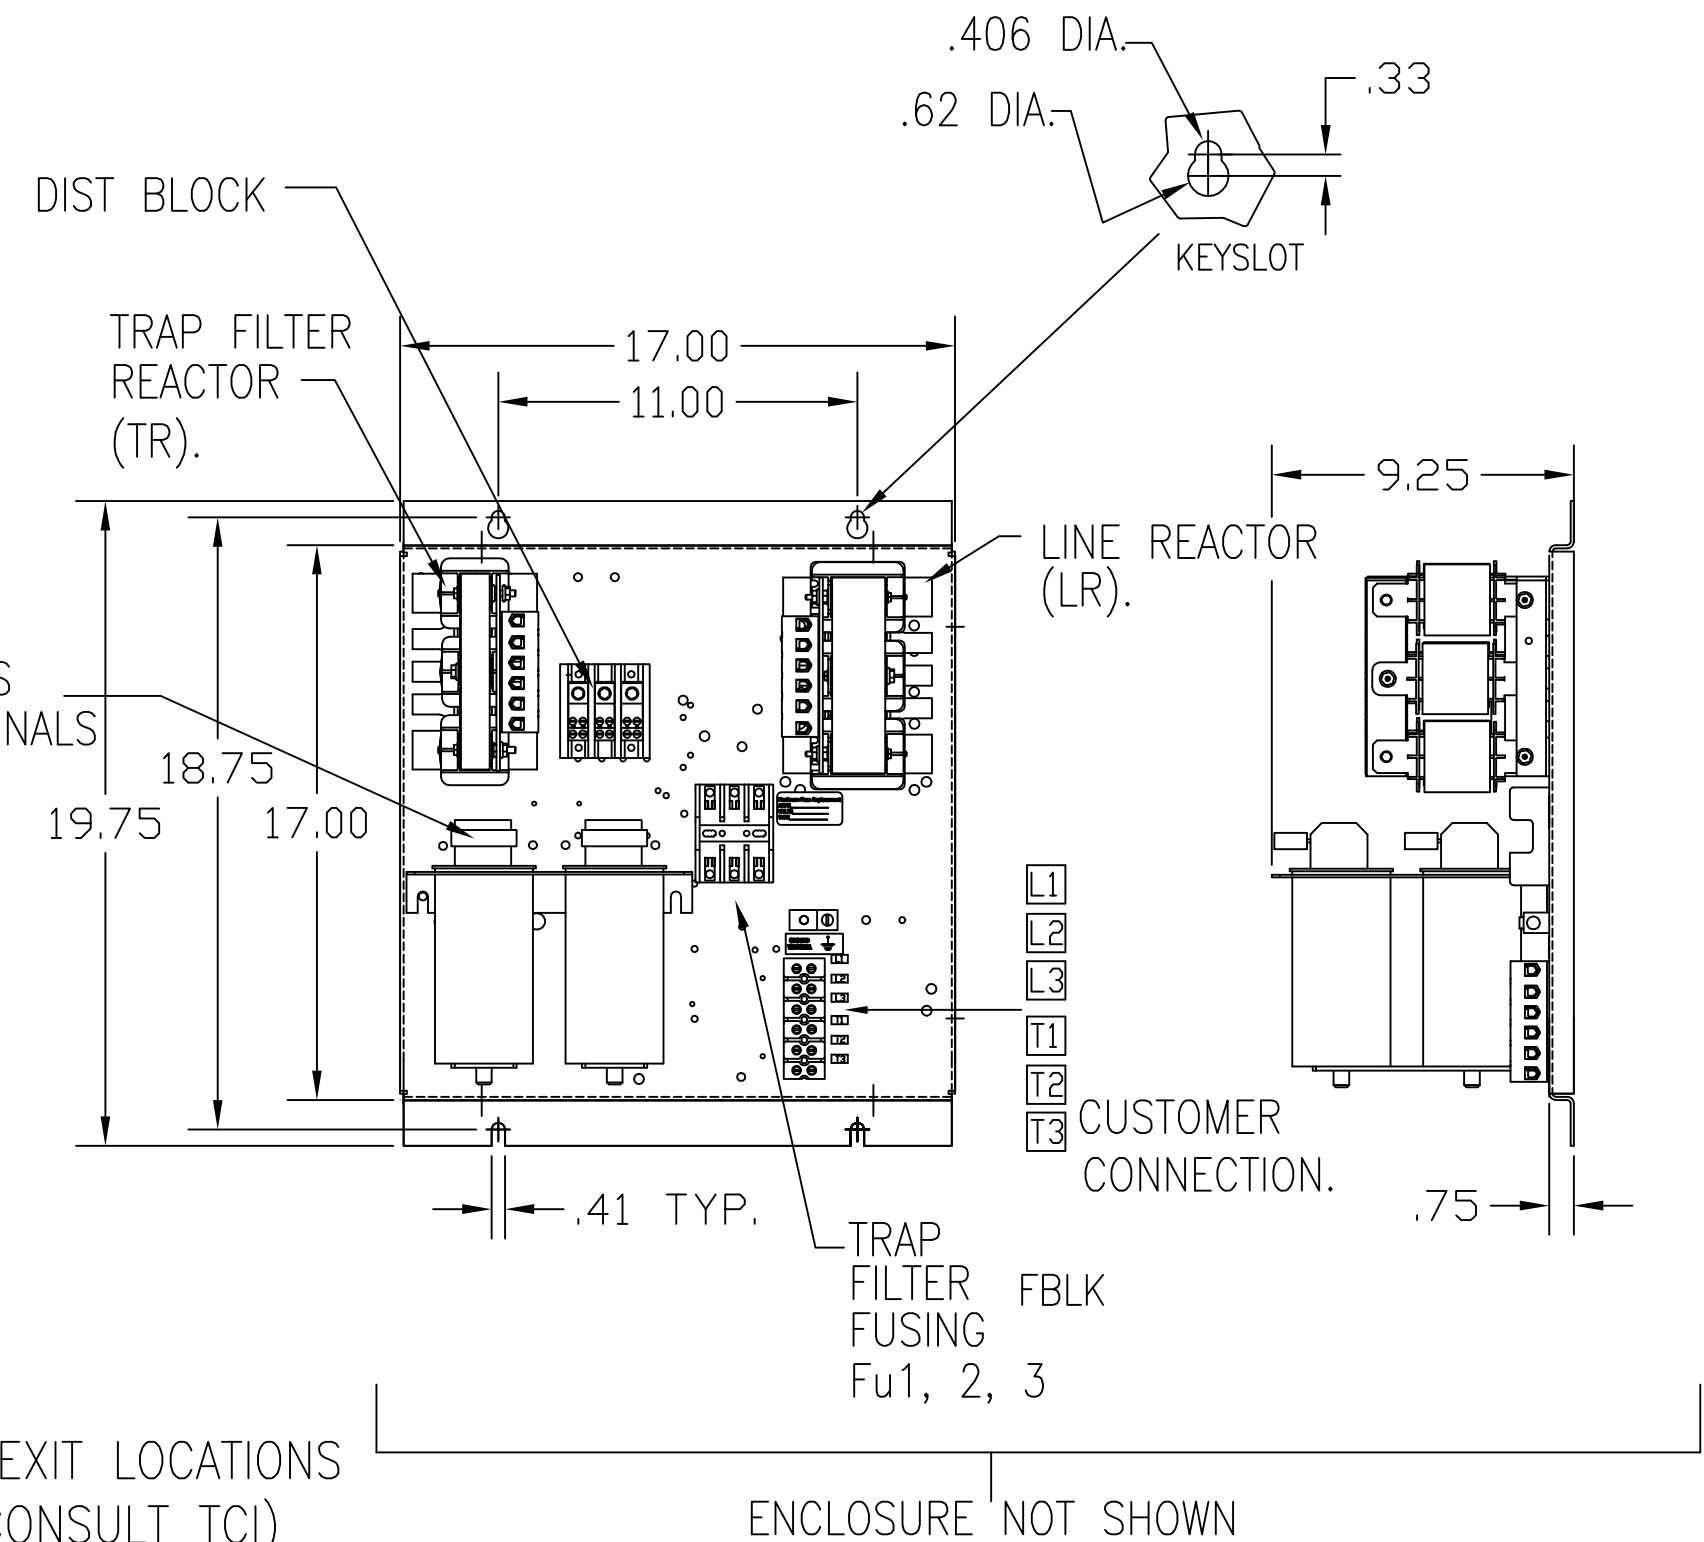
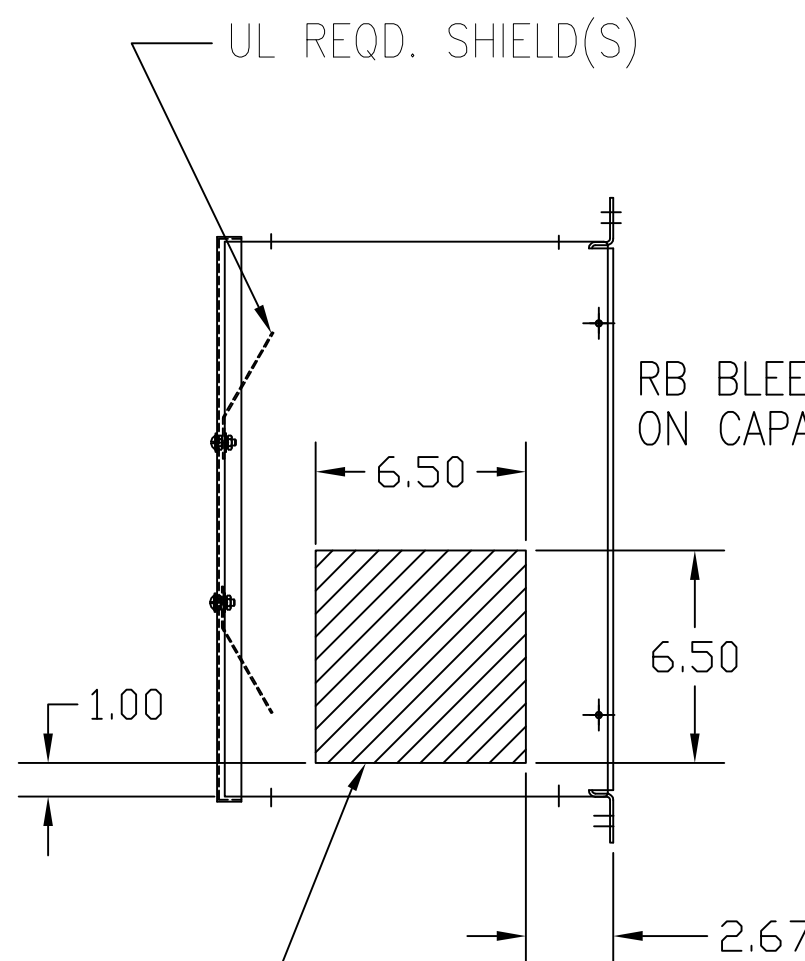
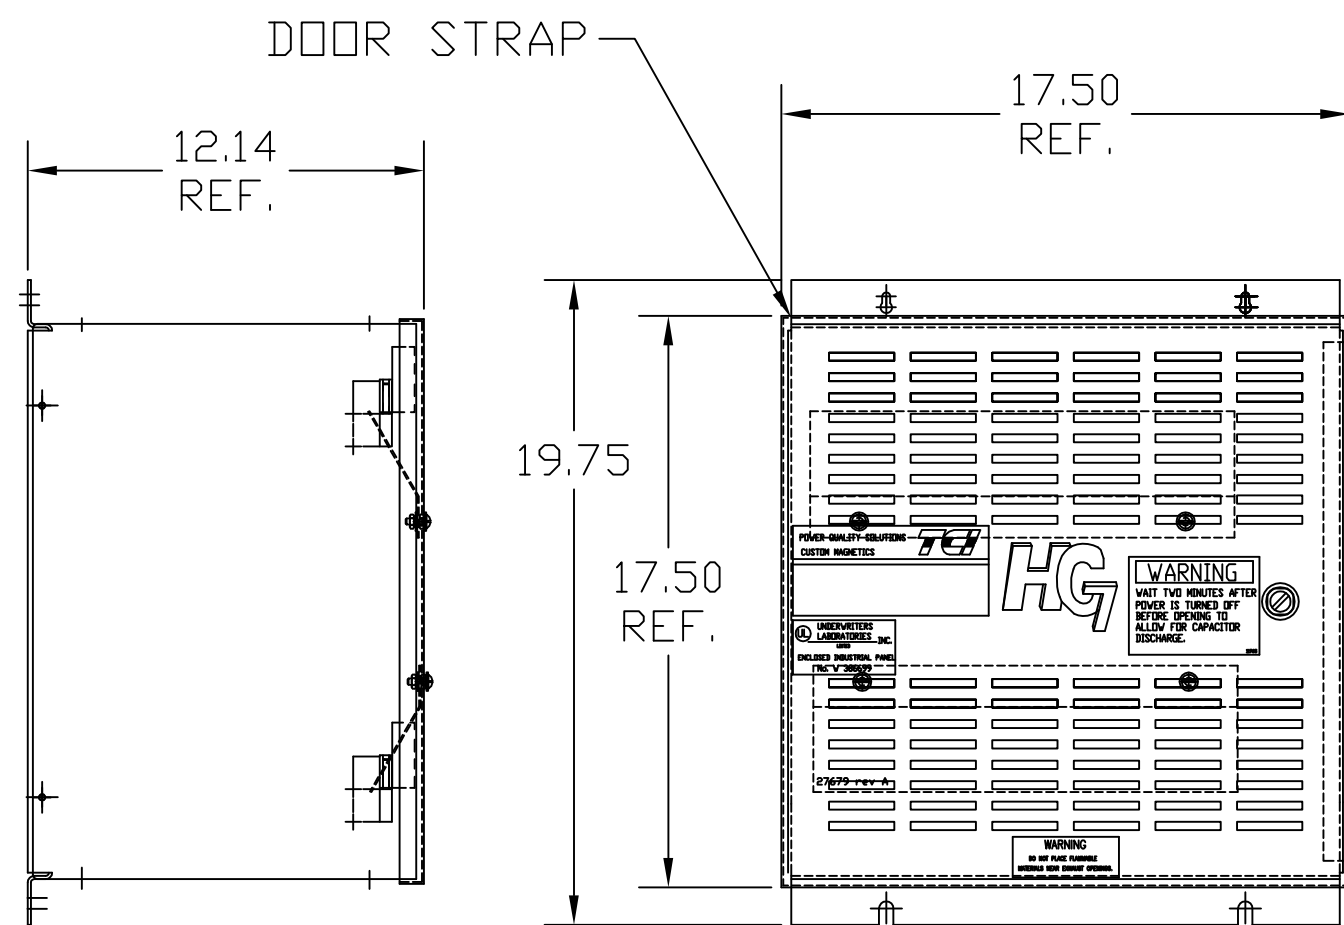



UNIT SPECIFICATIONS:					
KVAR HARMONIC	VOLT	HZ	PHASE	HP	
3	5TH	240	60	3	10
ENCLOSURE	NEMA 1				
APPROX.WT. LBS.	80				

HG10BW01ST	
COMPONENTS	
LINE REACTOR LR	X
TRAP REACTOR TR	X
CAPACITOR CAP	X
TRAP FUSING FU1,2,3	X

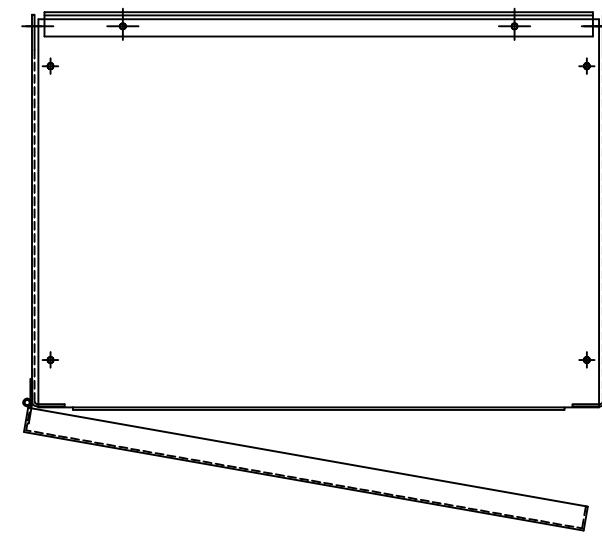

HATCHED AREAS ARE SUGGESTED CUSTOMER WIRE ENTRANCE AND EXIT LOCATIONS (BOTTOM ENTRANCE ALTERNATE-CONSULT TCI)

CUSTOMER CONNECTIONS:  
PB-POWER INPUT BLOCK:  
WIRE RANGE-#18 TO #4 AWG.

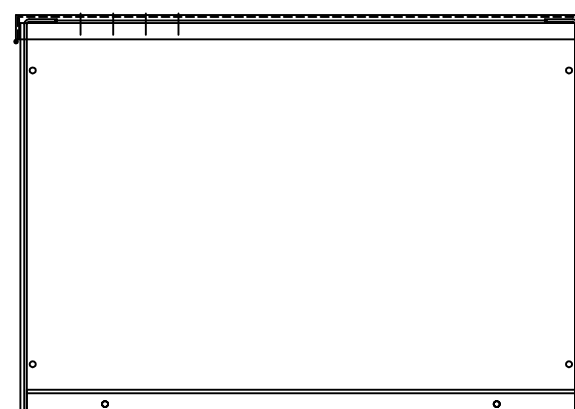


GROUND LUG:  
WIRE RANGE-1/0 TO #14 AWG.

SEE IOM MANUAL FOR WIRE AND TORQUE INFORMATION.

SEE 25178 FOR SCHEMATIC

CUSTOMER IS RESPONSIBLE FOR INSTALLATION TO MEET ALL NATIONAL AND LOCAL ELECTRICAL CODES.

				TOLERANCES (EXCEPT AS NOTED)	 W132 N10611 Grant Drive Germantown, WI 53022
				DECIMAL	
C	2900 CHG TO ASC CAPS	8/20/13	DSW	.XX ± .02	HG10BW01ST, HG7 STANDARD 10HP, 240/3/60, TYPE 1
	RVSD GRD. LUG & SPEC.			.XXX ± .01	
B	2702 RVSD UL SHIELD	3/14/11	RJC	FRACTIONAL ± 1/32	
A	MOVE POWER BLOCK	02/21/06	DSW	ANGULAR ± 1/2°	DRN. BY DSW    DATE 04/19/05    DWG. NO. 102505DG SCALE TO FIT    APRVD.
NO	REVISION	DATE	BY		SHT.1 OF 1