

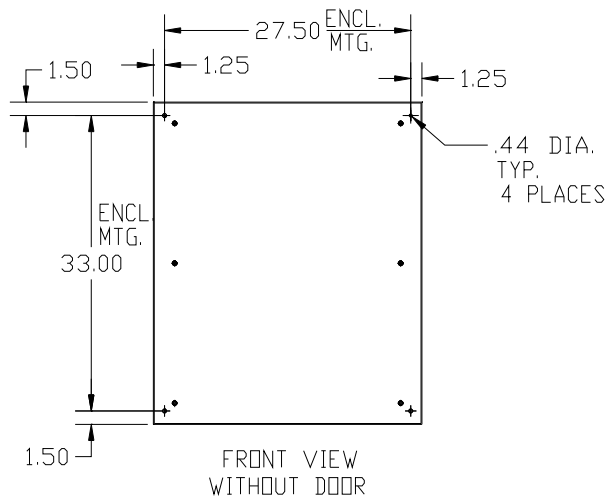
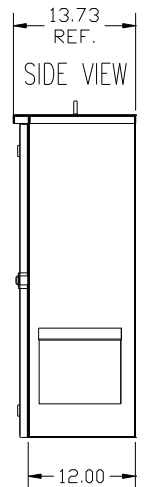
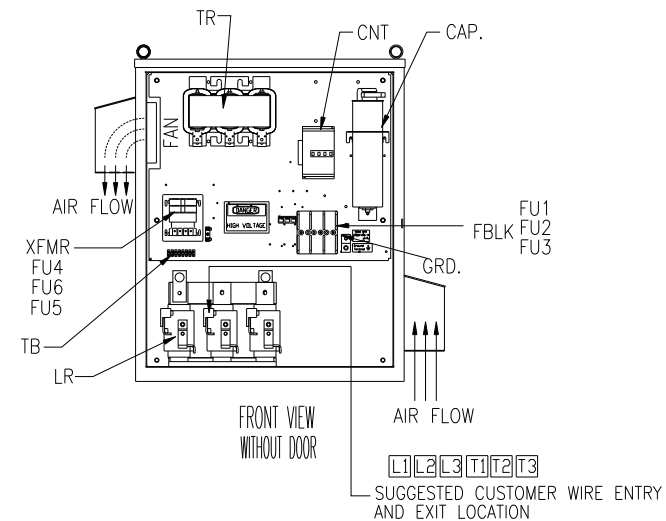
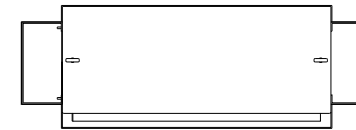
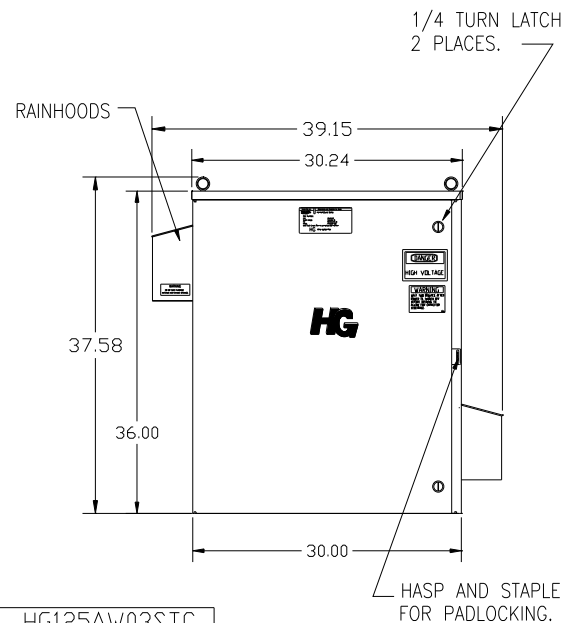


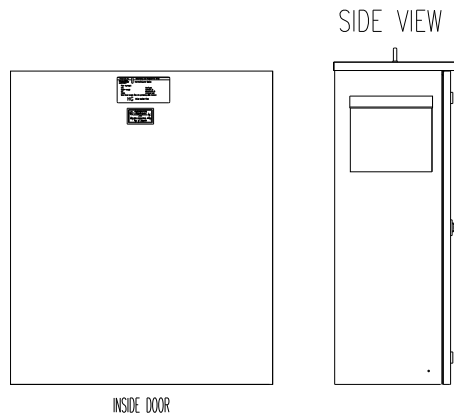

CUSTOMER IS RESPONSIBLE FOR INSTALLATION
TO MEET ALL NATIONAL AND LOCAL ELECTRICAL CODES.

NOTE: USE ONLY HUBS OR FITTINGS THAT COMPLY
WITH UL514B FOR TYPE 3R ENCLOSURES.

SEE DWG# 26753 FOR SCHEMATIC

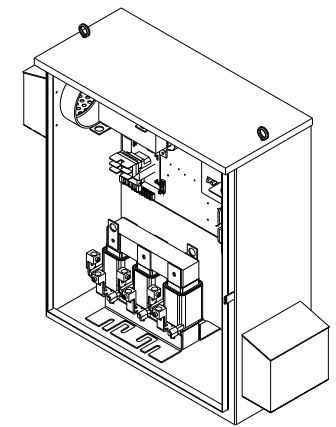

UNIT SPECIFICATIONS:					
KVAR	HARMONIC	VOLT	HZ	PHASE	HP
40	5TH	480	60	3	125
ENCLOSURE	UL TYPE 3R				
COLOR	WHITE				
APPROX.WT. LBS.	291				

HG125AW03STC		
COMPONENTS		
LINE REACTOR	LR	X
TRAP REACTOR	TR	X
CAPACITOR	CAP	X
TRAP FUSING	FU1,2,3	X
TRANSFORMER	XFMR	X
TRANSFORMER FUSING	FU4,6	X
TRANSFORMER FUSING	FU5	X
CONTACTOR	CNT	X

GROUND LUG:
WIRE RANGE- 250MCM-6
TIGHTENING TORQUE 275 IN-LB.

CUSTOMER CONNECTIONS
WIRE RANGE- 250MCM-6
TIGHTENING TORQUE 275 IN-LB.

				TOLERANCES (EXCEPT AS NOTED)		 7878 N. 86th STREET MILWAUKEE, WI 53224	
D	3033 LAYOUT UPDATE	2/11/14	DSW	DECIMAL			
C	2900 CHG TO ASC CAPS	3/15/13	DSW	.XX ±.12		HG125AW03STC, 125HP 480/3/60 UL TYPE 3R	
B	2775 RMVD. EXT. 3R MTG. BRKTS.			.XXX±.06			
	ADDED .44 MTG. HOLE & DIMS.	10/19/11	RJC	FRACTIONAL ± 1/32		DRN BY DSW DATE 8/21/08 DWG. NO. 103676DG SCALE TO FIT APRVD. C SHT. 1 OF 1	
A	2641 ADD EYEBOLTS	10/15/09	DSW	ANGULAR ± 1/2°			
NO	REVISION	DATE	BY				