
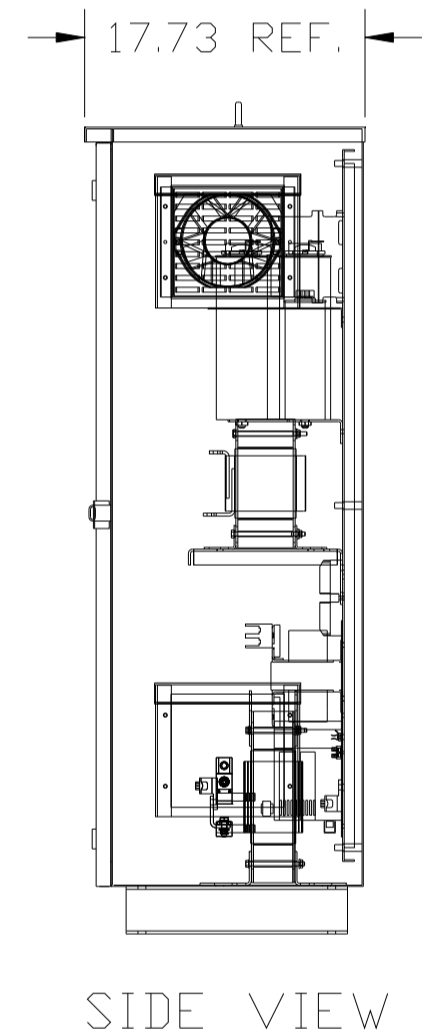
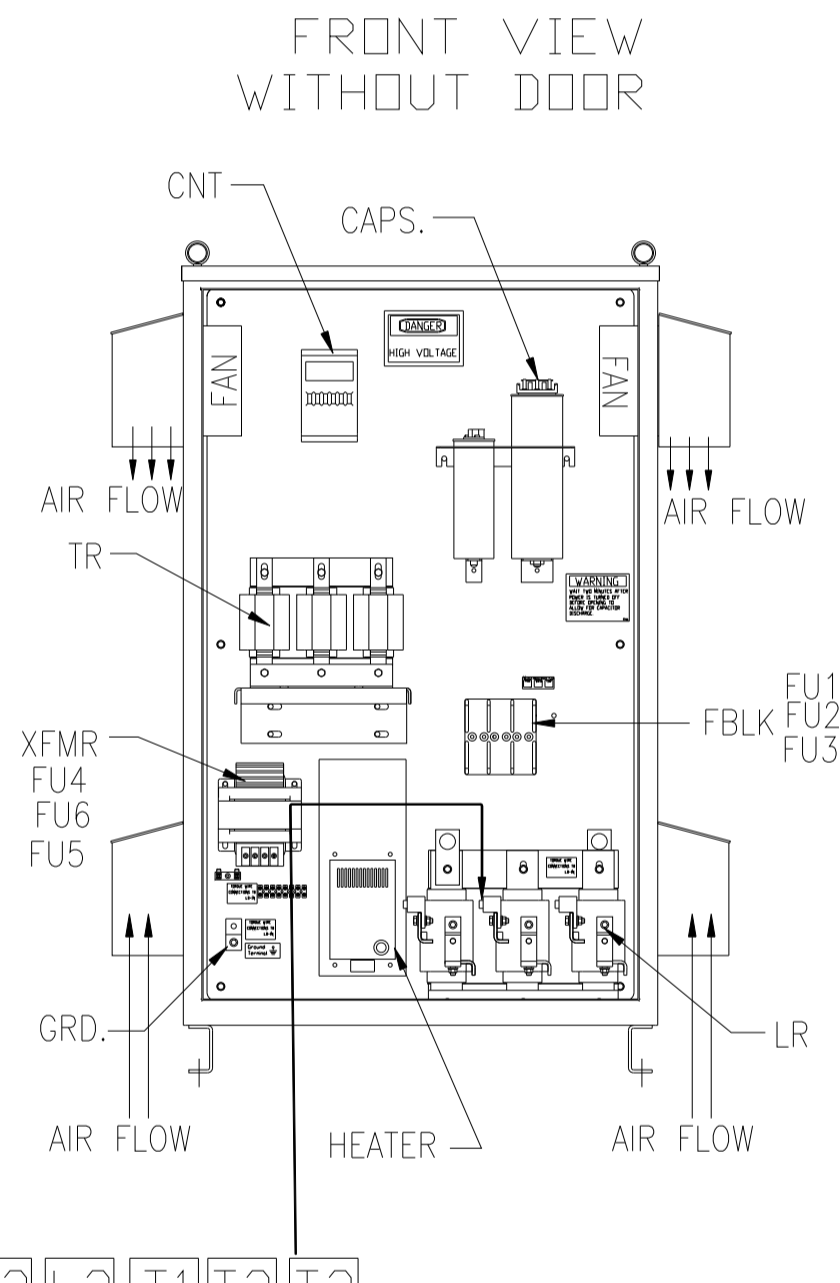
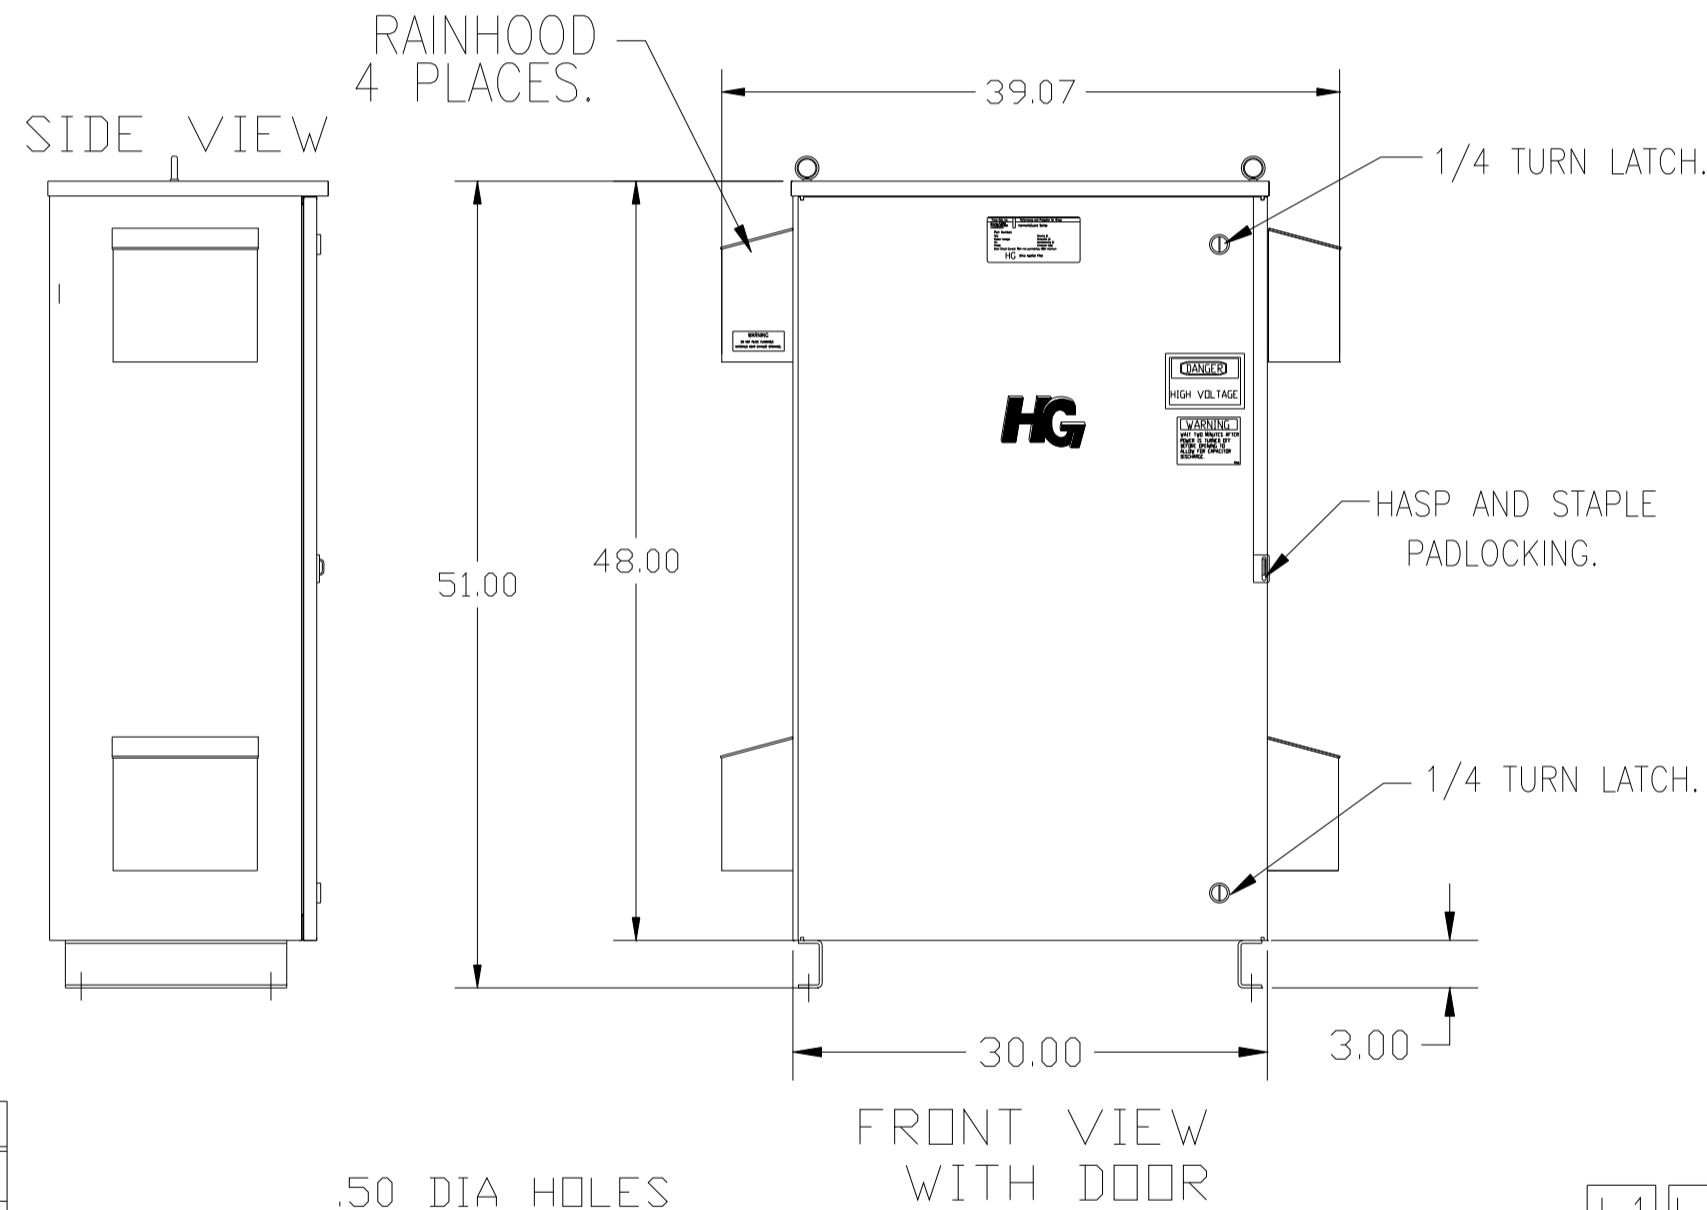


CUSTOMER IS RESPONSIBLE FOR INSTALLATION TO MEET ALL NATIONAL AND LOCAL ELECTRICAL CODES.

NOTE: USE ONLY HUBS OR FITTINGS THAT COMPLY WITH UL514B FOR TYPE 3R ENCLOSURES.

SEE DWG# 26751 FOR SCHEMATIC

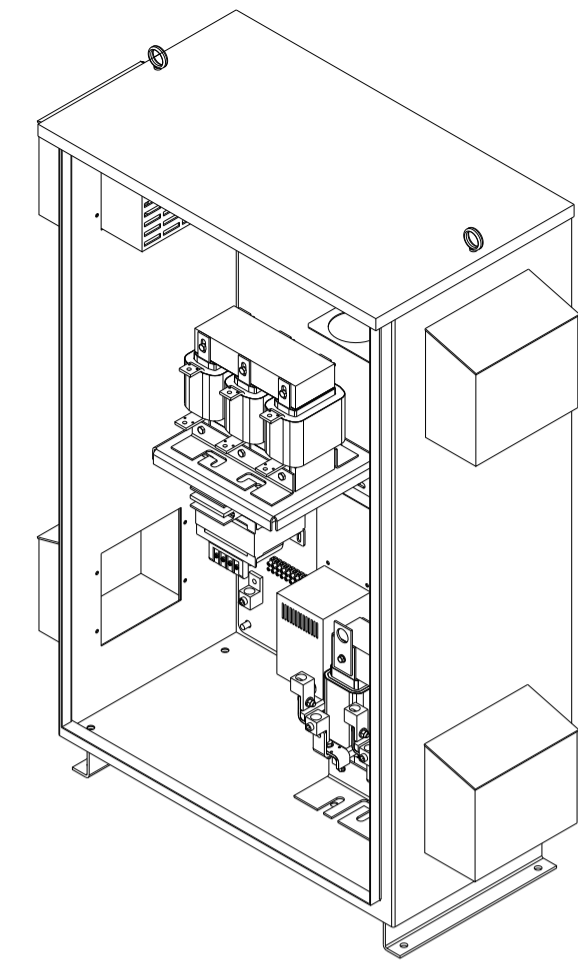


INSIDE DOOR

SYMBOL	TCI PART NUMBER
LR	KDRL2T
TR	KTR45A65HGX1
CAP.1, CAP.2	KCAP20A6B
CAP.3	KCAP5A6A
XFMR.	23899
Fu1;2;3	11077
Fu4,6	14106
Fu5	23977
CNT	19246
HEATER (400W)	20109

UNIT SPECIFICATIONS:

KVAR	HARMONIC	VOLT	HZ	PHASE	HP
45	5TH	480	60	3	150
ENCLOSURE		TYPE 3R- COLOR, WHITE			
FEATURES		CONTACTOR, HEATER			
APPROX.WT. LBS		410			

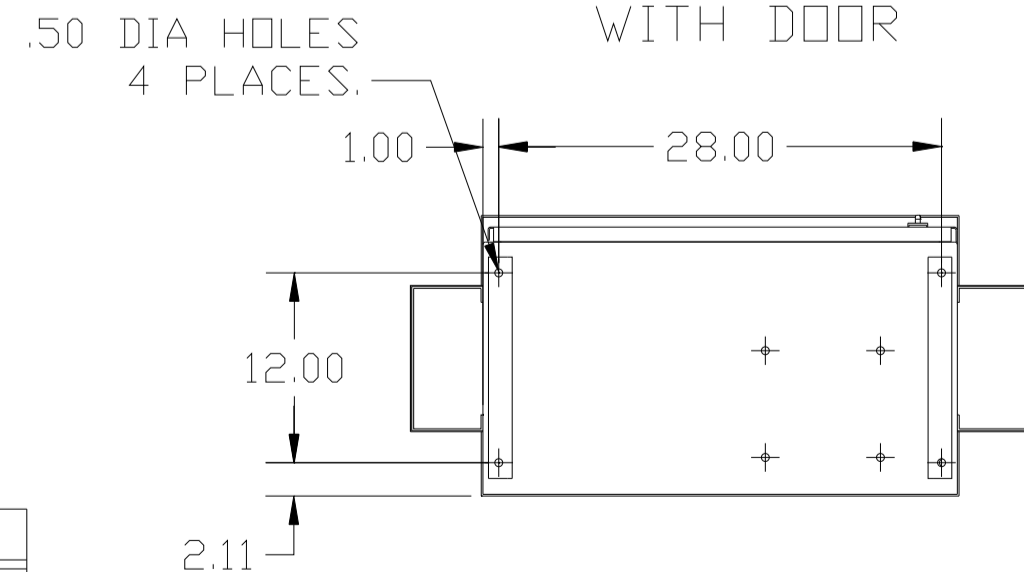

SUGGESTED CUSTOMER WIRE ENTRY AND EXIT LOCATION

GROUND LUG:
WIRE RANGE- 250MCM-6
TIGHTENING TORQUE 275 IN-LB.

CUSTOMER CONNECTIONS
WIRE RANGE- 250MCM-6
TIGHTENING TORQUE 275 IN-LB.

TOLERANCES (EXCEPT AS NOTED)				TCI		7878 N. 86th STREET MILWAUKEE, WI 53224	
DECIMAL	FRACTIONAL	ANGULAR	SCALE	DRN BY	DATE	DWG. NO.	REV.
.XX ± .12	± 1/32	± 1/2°	TO FIT	DSW	09/12/08	103732DG	
.XXX ± .06							
A 2641 ADD EYEBOLTS				10/21/09	DSW		
NO REVISION				DATE	BY	SCALE	APRVD.