


CUSTOMER IS RESPONSIBLE FOR INSTALLATION
TO MEET ALL NATIONAL AND LOCAL ELECTRICAL CODES.

NOTE: USE ONLY HUBS OR FITTINGS THAT COMPLY
WITH UL514B FOR TYPE 3R ENCLOSURES.

SEE DWG# 26750 FOR SCHEMATIC

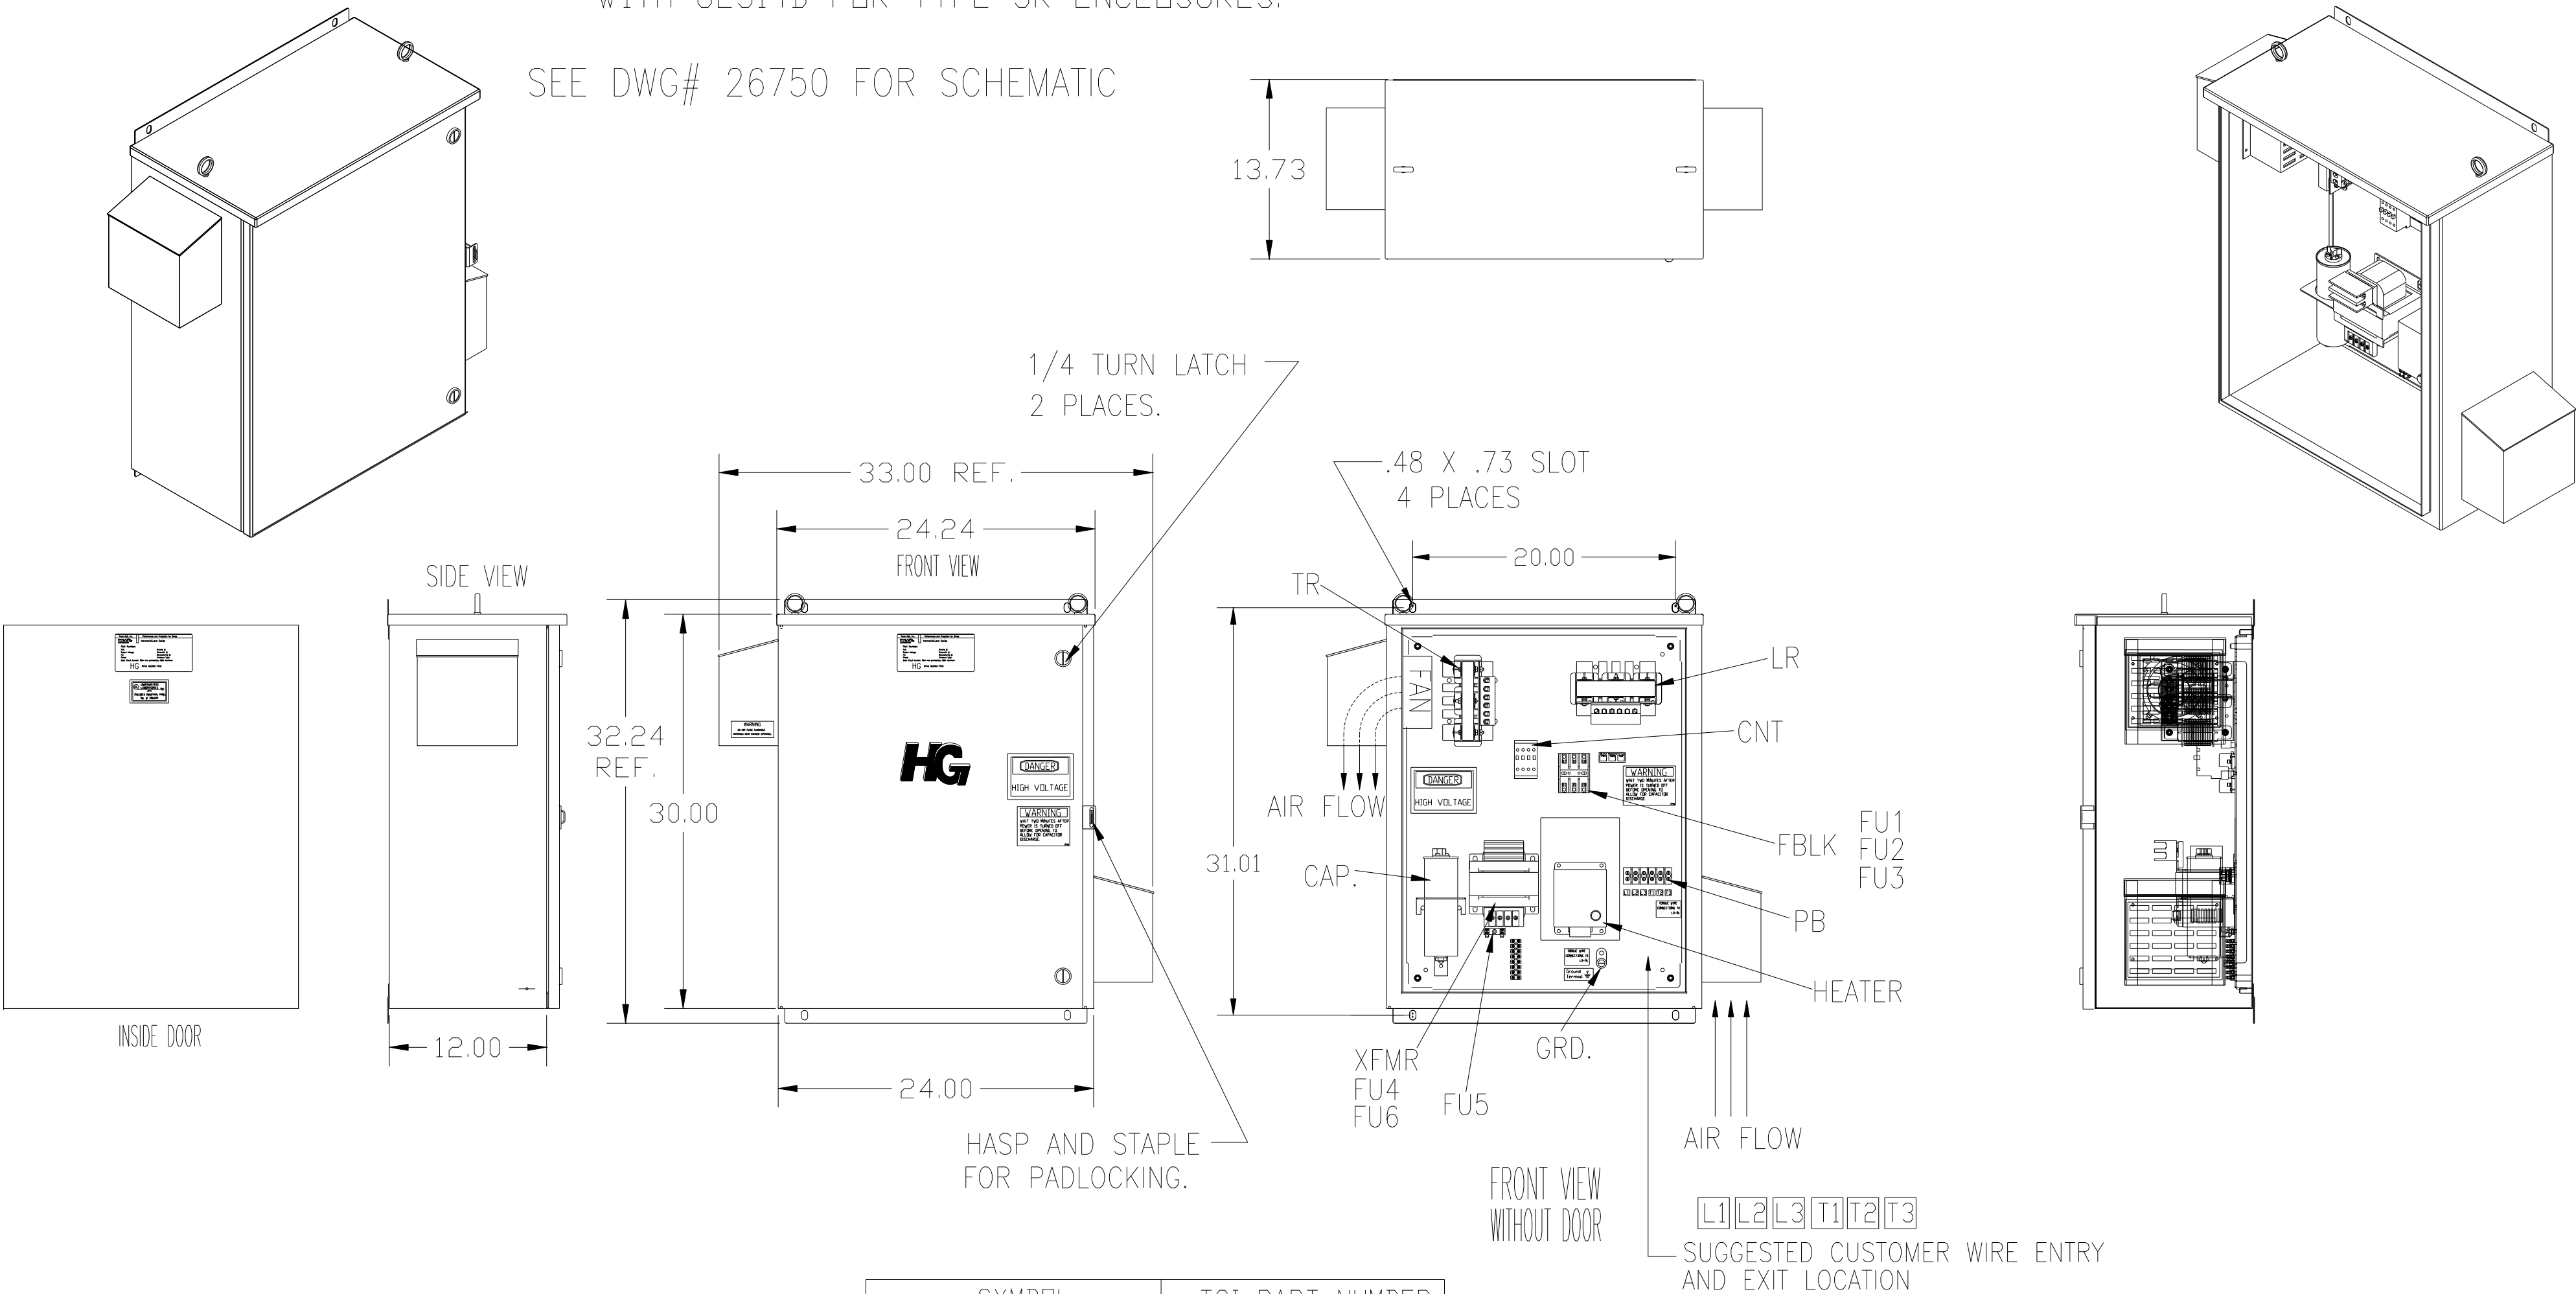

UNIT SPECIFICATIONS:					
KVAR	HARMONIC	VOLT	HZ	PHASE	HP
5	5TH	480	60	3	15
ENCLOSURE		UL TYPE 3R			
COLOR		WHITE			
APPROX.WT. LBS.		125			

SYMBOL	TCI PART NUMBER
LR	KDRF1T
TR	KTR5A65HG
CAP. (5 KVAR)	KCAP5A6A
XFMR.	23896
Fu1, 2, 3	15752
Fu4,6	24009
Fu5	17567
CNT	26739
HEATER (200 WATT)	11638

PB-POWER INPUT BLOCK:
WIRE RANGE-#18 TO #4 AWG.
TIGHTENING TORQUE 20 IN-LB.

GROUND LUG:
WIRE RANGE-1/0 TO #14 AWG.
TIGHTENING TORQUE 200 IN-LB.

						TOLERANCES (EXCEPT AS NOTED)		 7878 N. 86th STREET MILWAUKEE, WI 53224	
						DECIMAL			
						.XX ± .12	HG15AW03STCH, 15HP 480/3/60 UL TYPE 3R		
						.XXX±.06			
						FRACTIONAL ± 1/32			
A	2641 ADD EYEBOLT	10/21/09	DSW			ANGULAR ± 1/2°	DRN. BY DSW	DATE 8/20/08	DWG. NO. 103722DG
NO	REVISION	DATE	BY				SCALE TO FIT	APRVD. C	SHT. 1 of 1