


SEE 26822 FOR SCHEMATIC

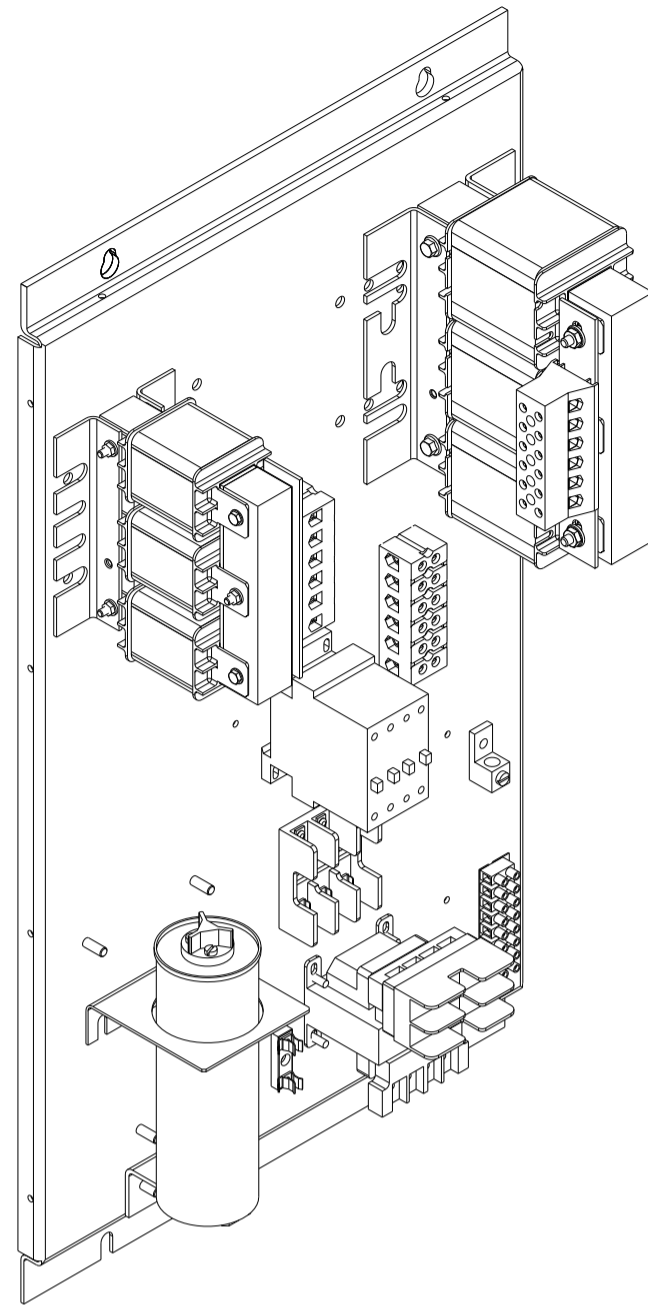


PB-POWER INPUT BLOCK:
WIRE RANGE-#18 TO #4 AWG.
TIGHTENING TORQUE 20 IN-LB.

GROUND LUG:
WIRE RANGE-1/0 TO #14 AWG.
1/0 AWG thru 2 AWG 50 IN-LBS. MAX.
4 AWG thru 6 AWG 45 IN-LBS. MAX.
8 AWG 40 IN-LBS. MAX.
10 AWG thru 14 AWG 35 IN-LBS. MAX.

| UNIT SPECIFICATIONS: | | | | | |
|----------------------|----------|------------------|----|-------|----|
| KVAR | HARMONIC | VOLT | HZ | PHASE | HP |
| 5 | 5TH | 240 | 60 | 3 | 15 |
| ENCLOSURE | | WHITE OPEN PANEL | | | |
| | | WITH CONTACTOR | | | |
| APPROX.WT. LBS. | | 75 | | | |

| SYMBOL | TCI PART NUMBER |
|-----------|-----------------|
| LR | KDRF21T |
| TR | KTR5B65HG |
| CAP1 | KCAP5B6B |
| XFMR. | 23891 |
| Fu1, 2, 3 | 22665 |
| Fu4,6 | 24073 |
| Fu5 | 13364 |
| CNT | 23073 |

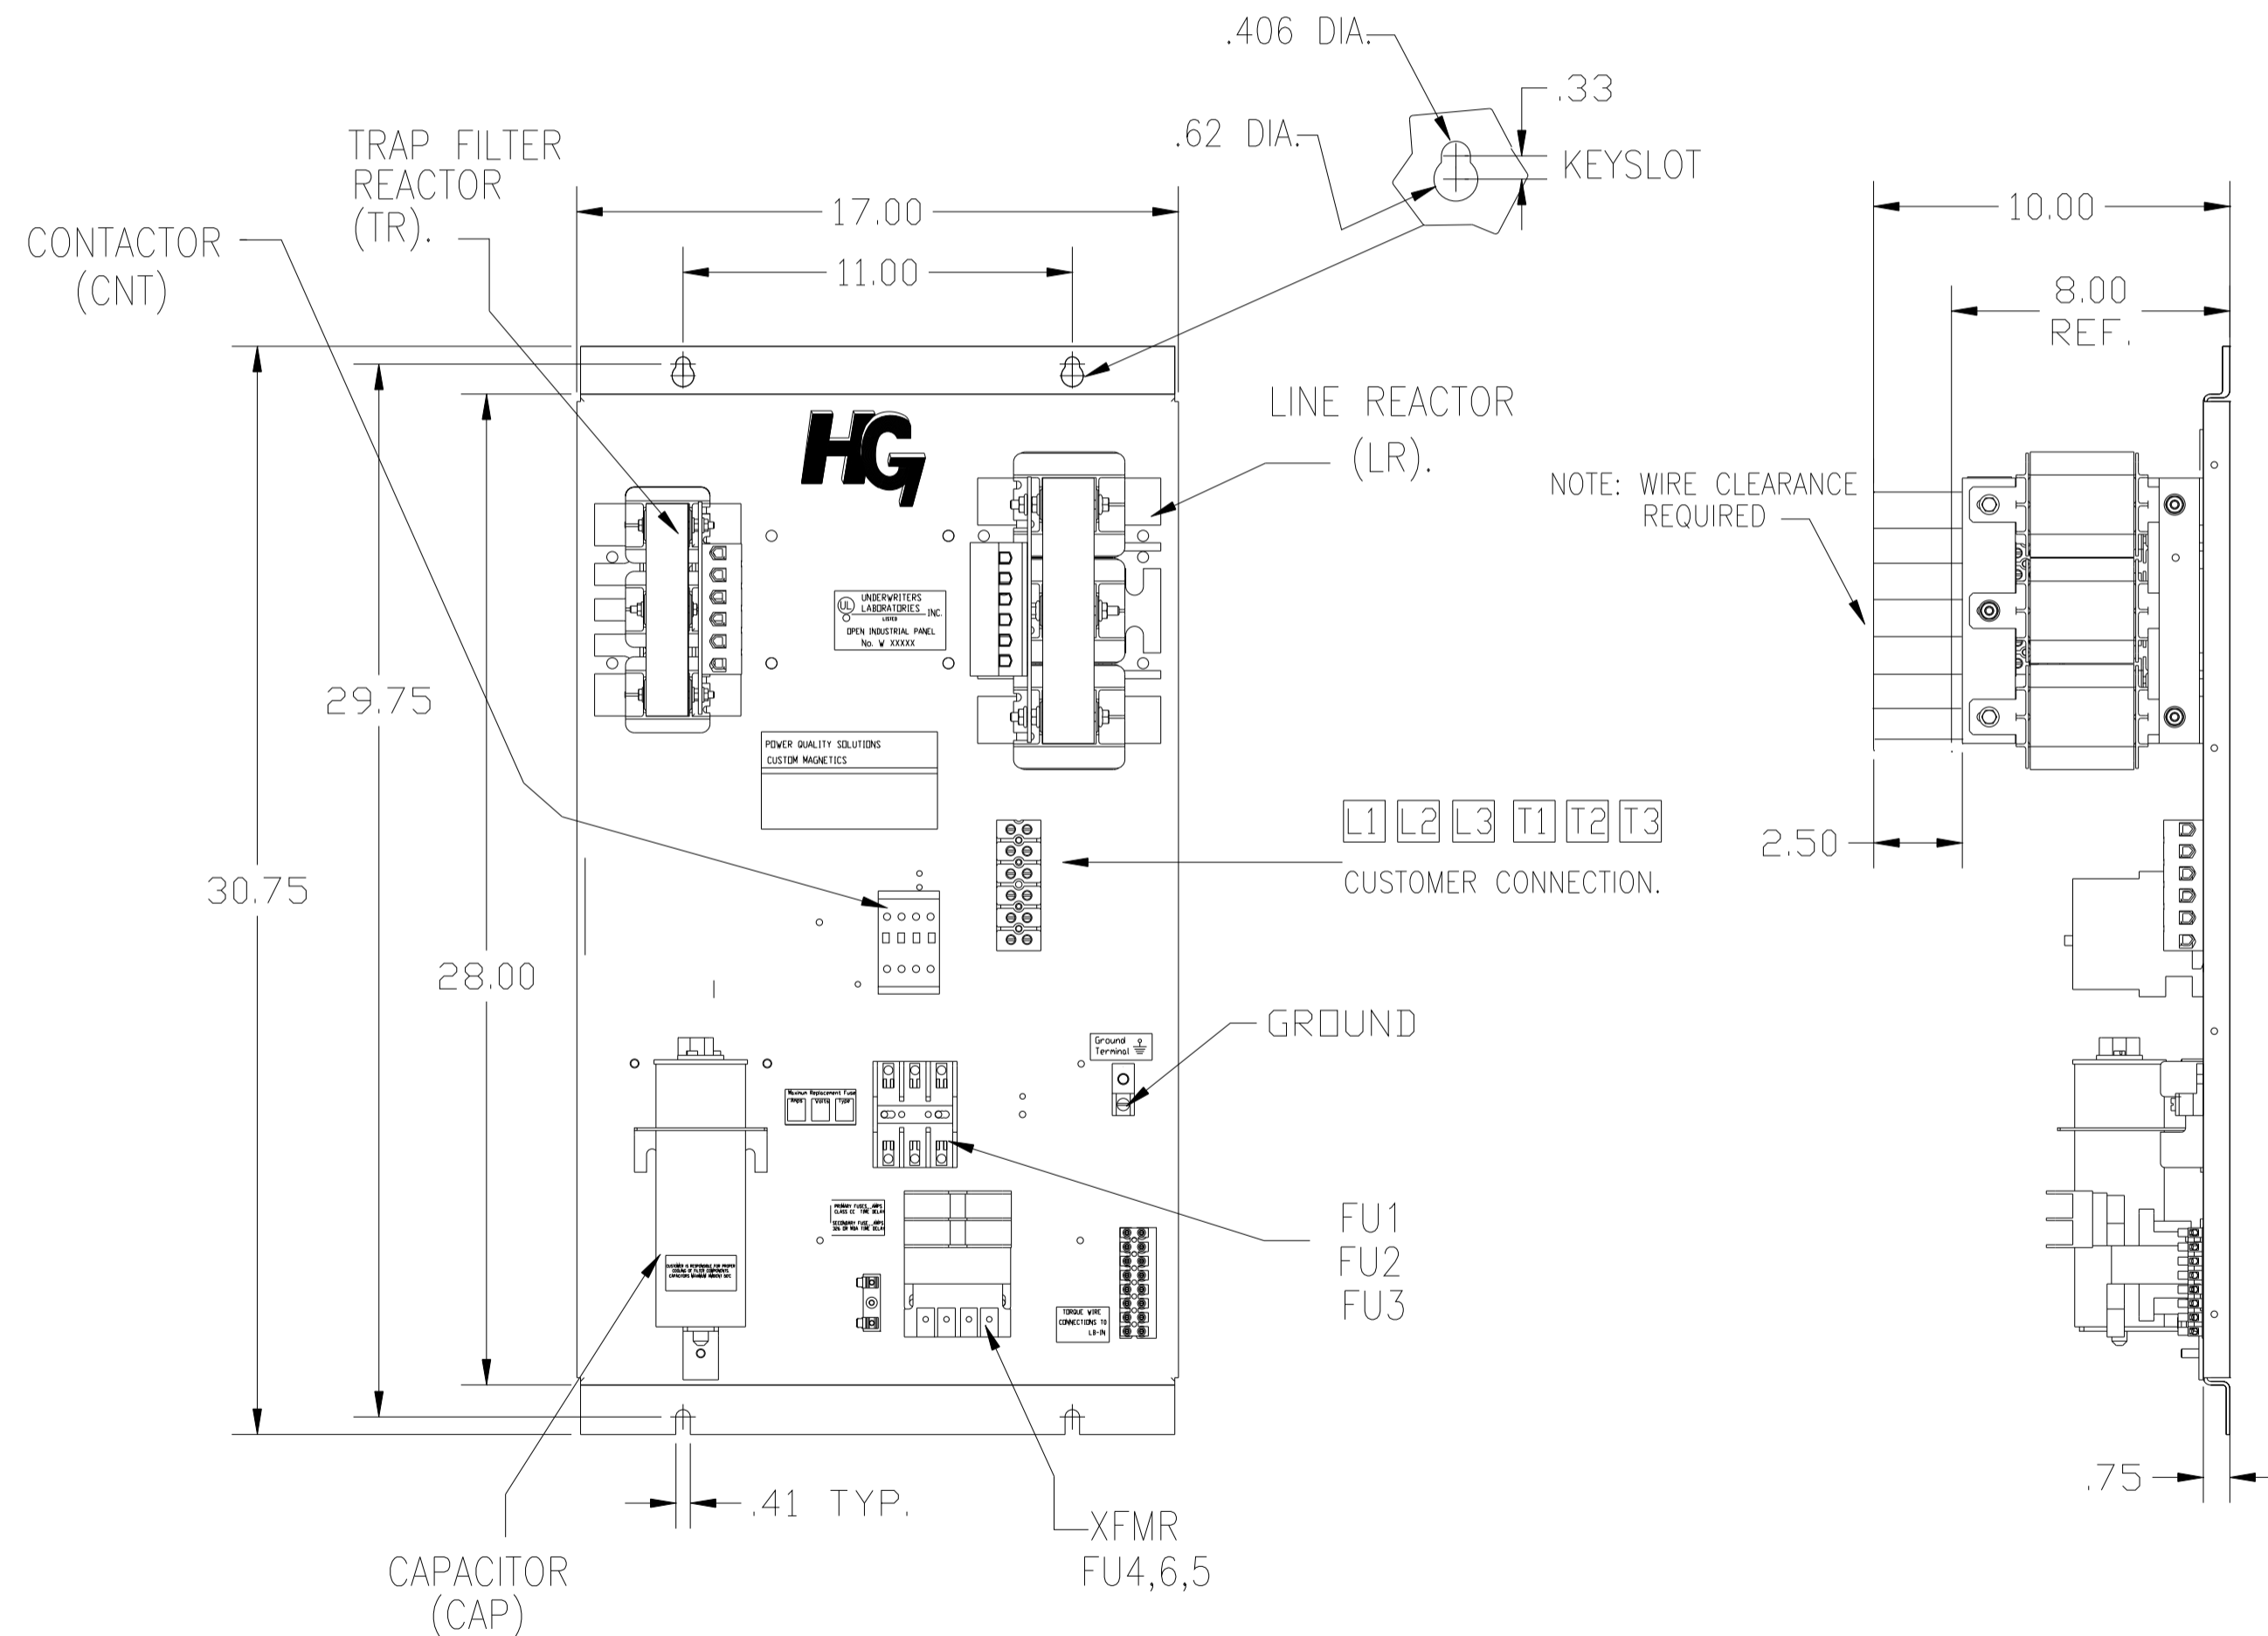

CUSTOMER IS RESPONSIBLE FOR PROPER COOLING OF FILTER COMPONENTS. CAPACITORS MAXIMUM AMBIENT 50°C.

CUSTOMER IS RESPONSIBLE FOR INSTALLATION TO MEET ALL NATIONAL AND LOCAL ELECTRICAL CODES.

| | | | | | | | |
|----|----------|------|----|------------------------------|--|---|--|
| | | | | TOLERANCES (EXCEPT AS NOTED) | | 7878 N. 86th STREET MILWAUKEE, WI 53224 | |
| | | | | DECIMAL | | | |
| | | | | .XX ± .03 | | HG15BW00STC, 15HP 240/3/60, OPEN, WITH CNT | |
| | | | | .XXX ± .01 | | | |
| | | | | FRACTIONAL ± 1/32 | | | |
| | | | | ANGULAR ± 1/2° | | DRN BY DSW DATE 10/09/08 DWG. NO. 103601DG SCALE TO SCALE ABRVD. C SHT. 1 OF 1 | |
| NO | REVISION | DATE | BY | | | | |