
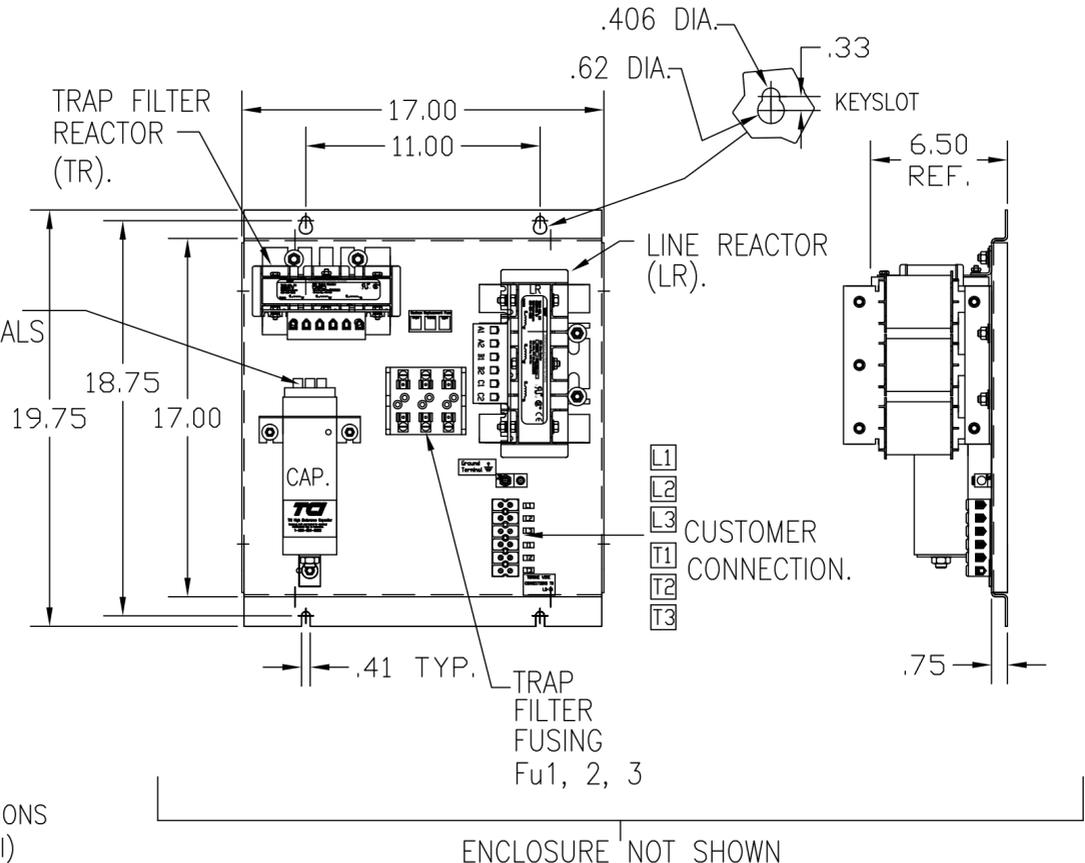
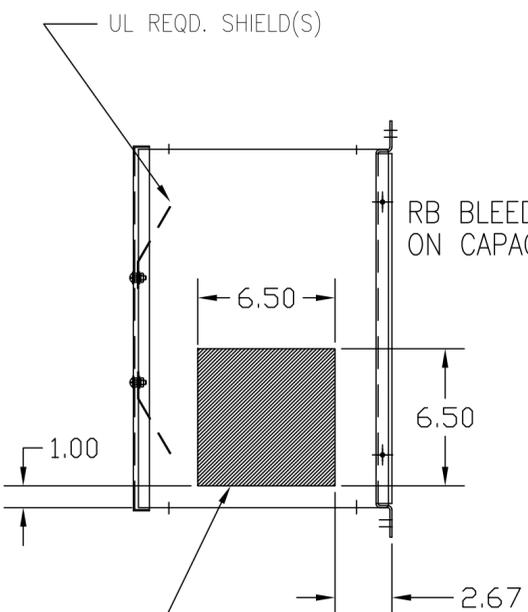
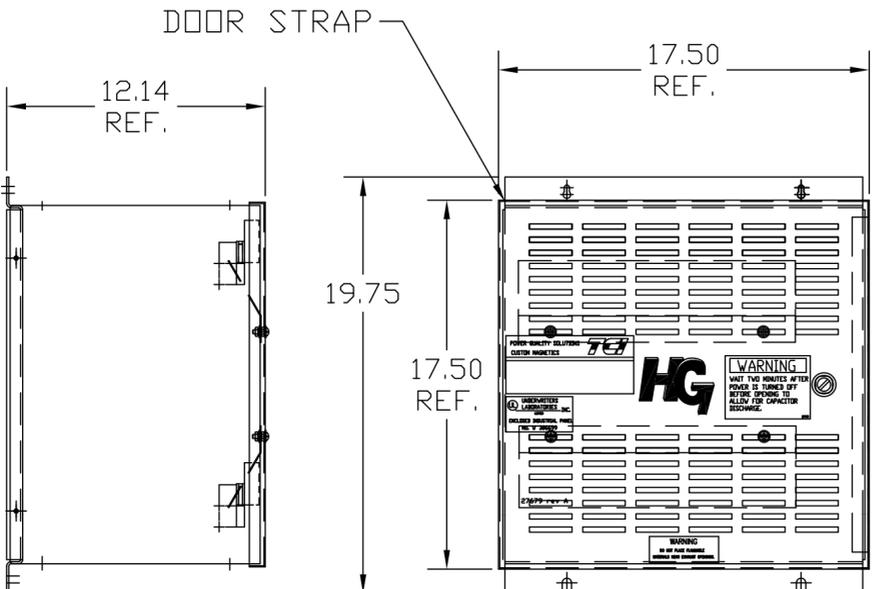


UNIT SPECIFICATIONS:					
KVAR HARMONIC	VOLT	HZ	PHASE	HP	
3	5TH	240	60	3	15
ENCLOSURE	NEMA 1				
APPROX.WT. LBS.	85				

HG15BW01ST	
COMPONENTS	
LINE REACTOR LR	X
TRAP REACTOR TR	X
CAPACITOR CAP	X
TRAP FUSING FU1,2,3	X
XFMR	X

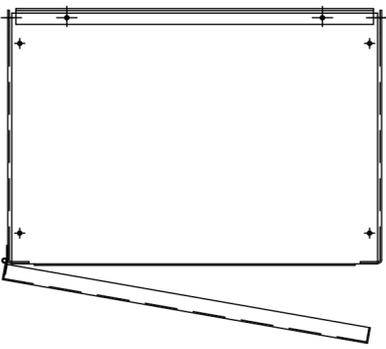

HATCHED AREAS ARE SUGGESTED CUSTOMER WIRE ENTRANCE AND EXIT LOCATIONS (BOTTOM ENTRANCE ALTERNATE-CONSULT TCI)

ENCLOSURE NOT SHOWN

SEE 25178 FOR SCHEMATIC

CUSTOMER IS RESPONSIBLE FOR INSTALLATION TO MEET ALL NATIONAL AND LOCAL ELECTRICAL CODES.

PB-POWER INPUT BLOCK:
WIRE RANGE-#18 TO #4 AWG.
TIGHTENING TORQUE 20 IN-LB.

GROUND LUG:
WIRE RANGE-1/0 TO #14 AWG.
1/0 AWG thru 2 AWG 50 IN-LBS. MAX.
4 AWG thru 6 AWG 45 IN-LBS. MAX.
8 AWG 40 IN-LBS. MAX.
10 AWG thru 14 AWG 35 IN-LBS. MAX.

TCI, LLC CLAIMS PROPRIETARY RIGHTS IN THE MATERIAL HEREIN DISCLOSED. IT IS SUPPLIED WITHOUT PREJUDICE TO ANY PATENT RIGHTS OF TCI AND MAY NOT BE REPRODUCED OR USED TO MANUFACTURE ANYTHING SHOWN THEREIN WITHOUT WRITTEN PERMISSION FROM TCI.				TOLERANCES (EXCEPT AS NOTED)	W132 N10611 Grant Drive Germantown, WI 53022 HG15BW01ST, HG7 STANDARD 15HP, 240/3/60 DRN. BY DSW DATE 04/19/05 DWG. NO. 102507DG SCALE TO FIT SIZE C SHT.1 OF 1	
	D	3023 FBLK, FUSE CHG	1/27/14	BMZ		.XX ± .03
	C	2702 RVSD UL SHIELD	1/15/11	RJC		.XXX ± .01
	B	2516, CAP WAS 17812	9/30/07	RJC		FRACTIONAL ± 1/32
	A	MOVED POWER BLOCK	2/21/06	DSW		ANGULAR ± 1/2°
NO	REVISION	DATE	BY			