



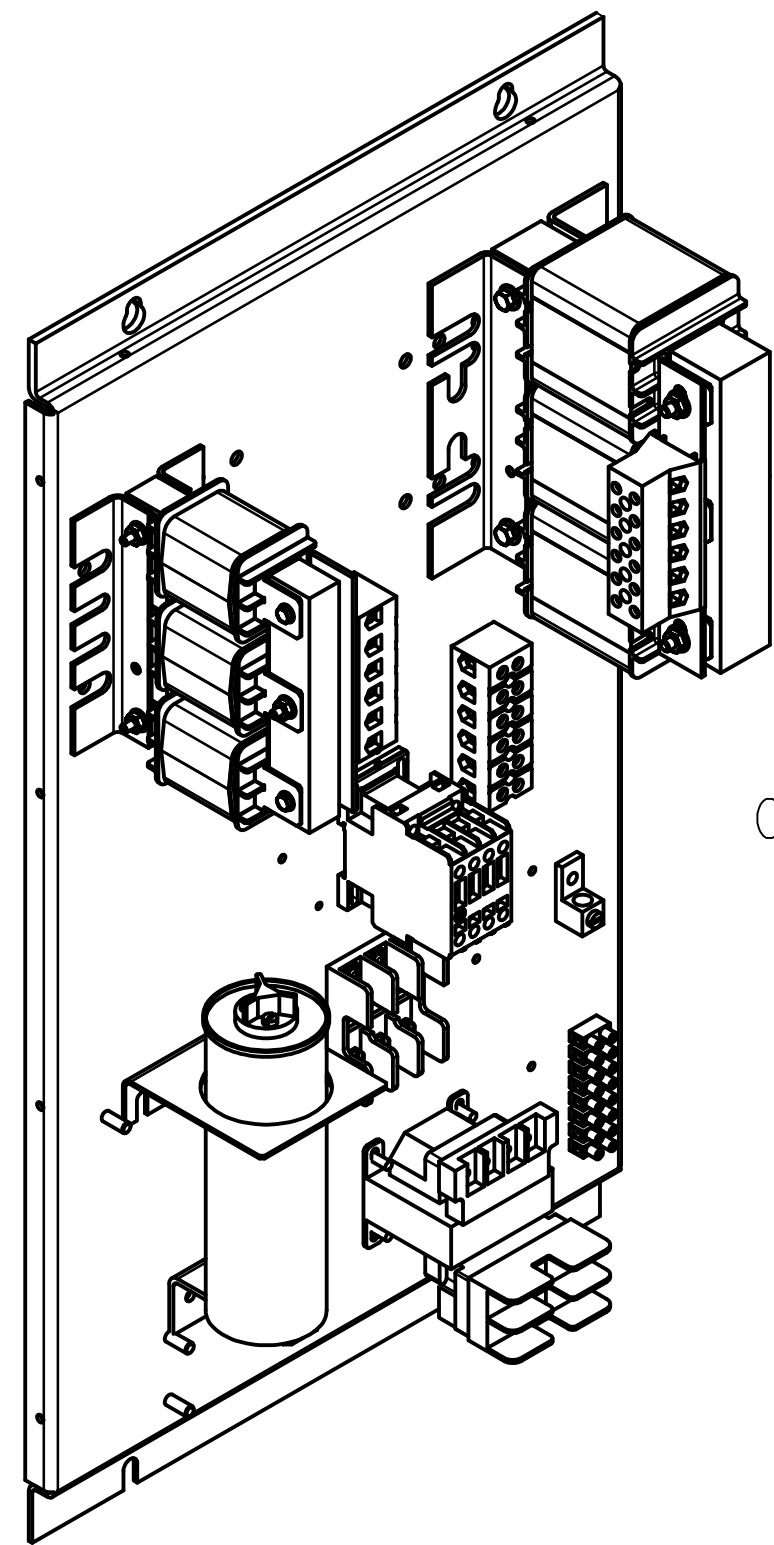


UNIT SPECIFICATIONS:					
KVAR	HARMONIC	VOLT	HZ	PHASE	HP
5	5TH	600	60	3	15
ENCLOSURE		WHITE OPEN PANEL			
OPTIONS		WITH CONTACTOR			
APPROX.WT. LBS.		60			

SYMBOL	HG15CW00STC
LR	X
TR	X
CAP	X
XFMR.	X
Fu1, 2, 3	X
Fu4,6	X
CNT	X

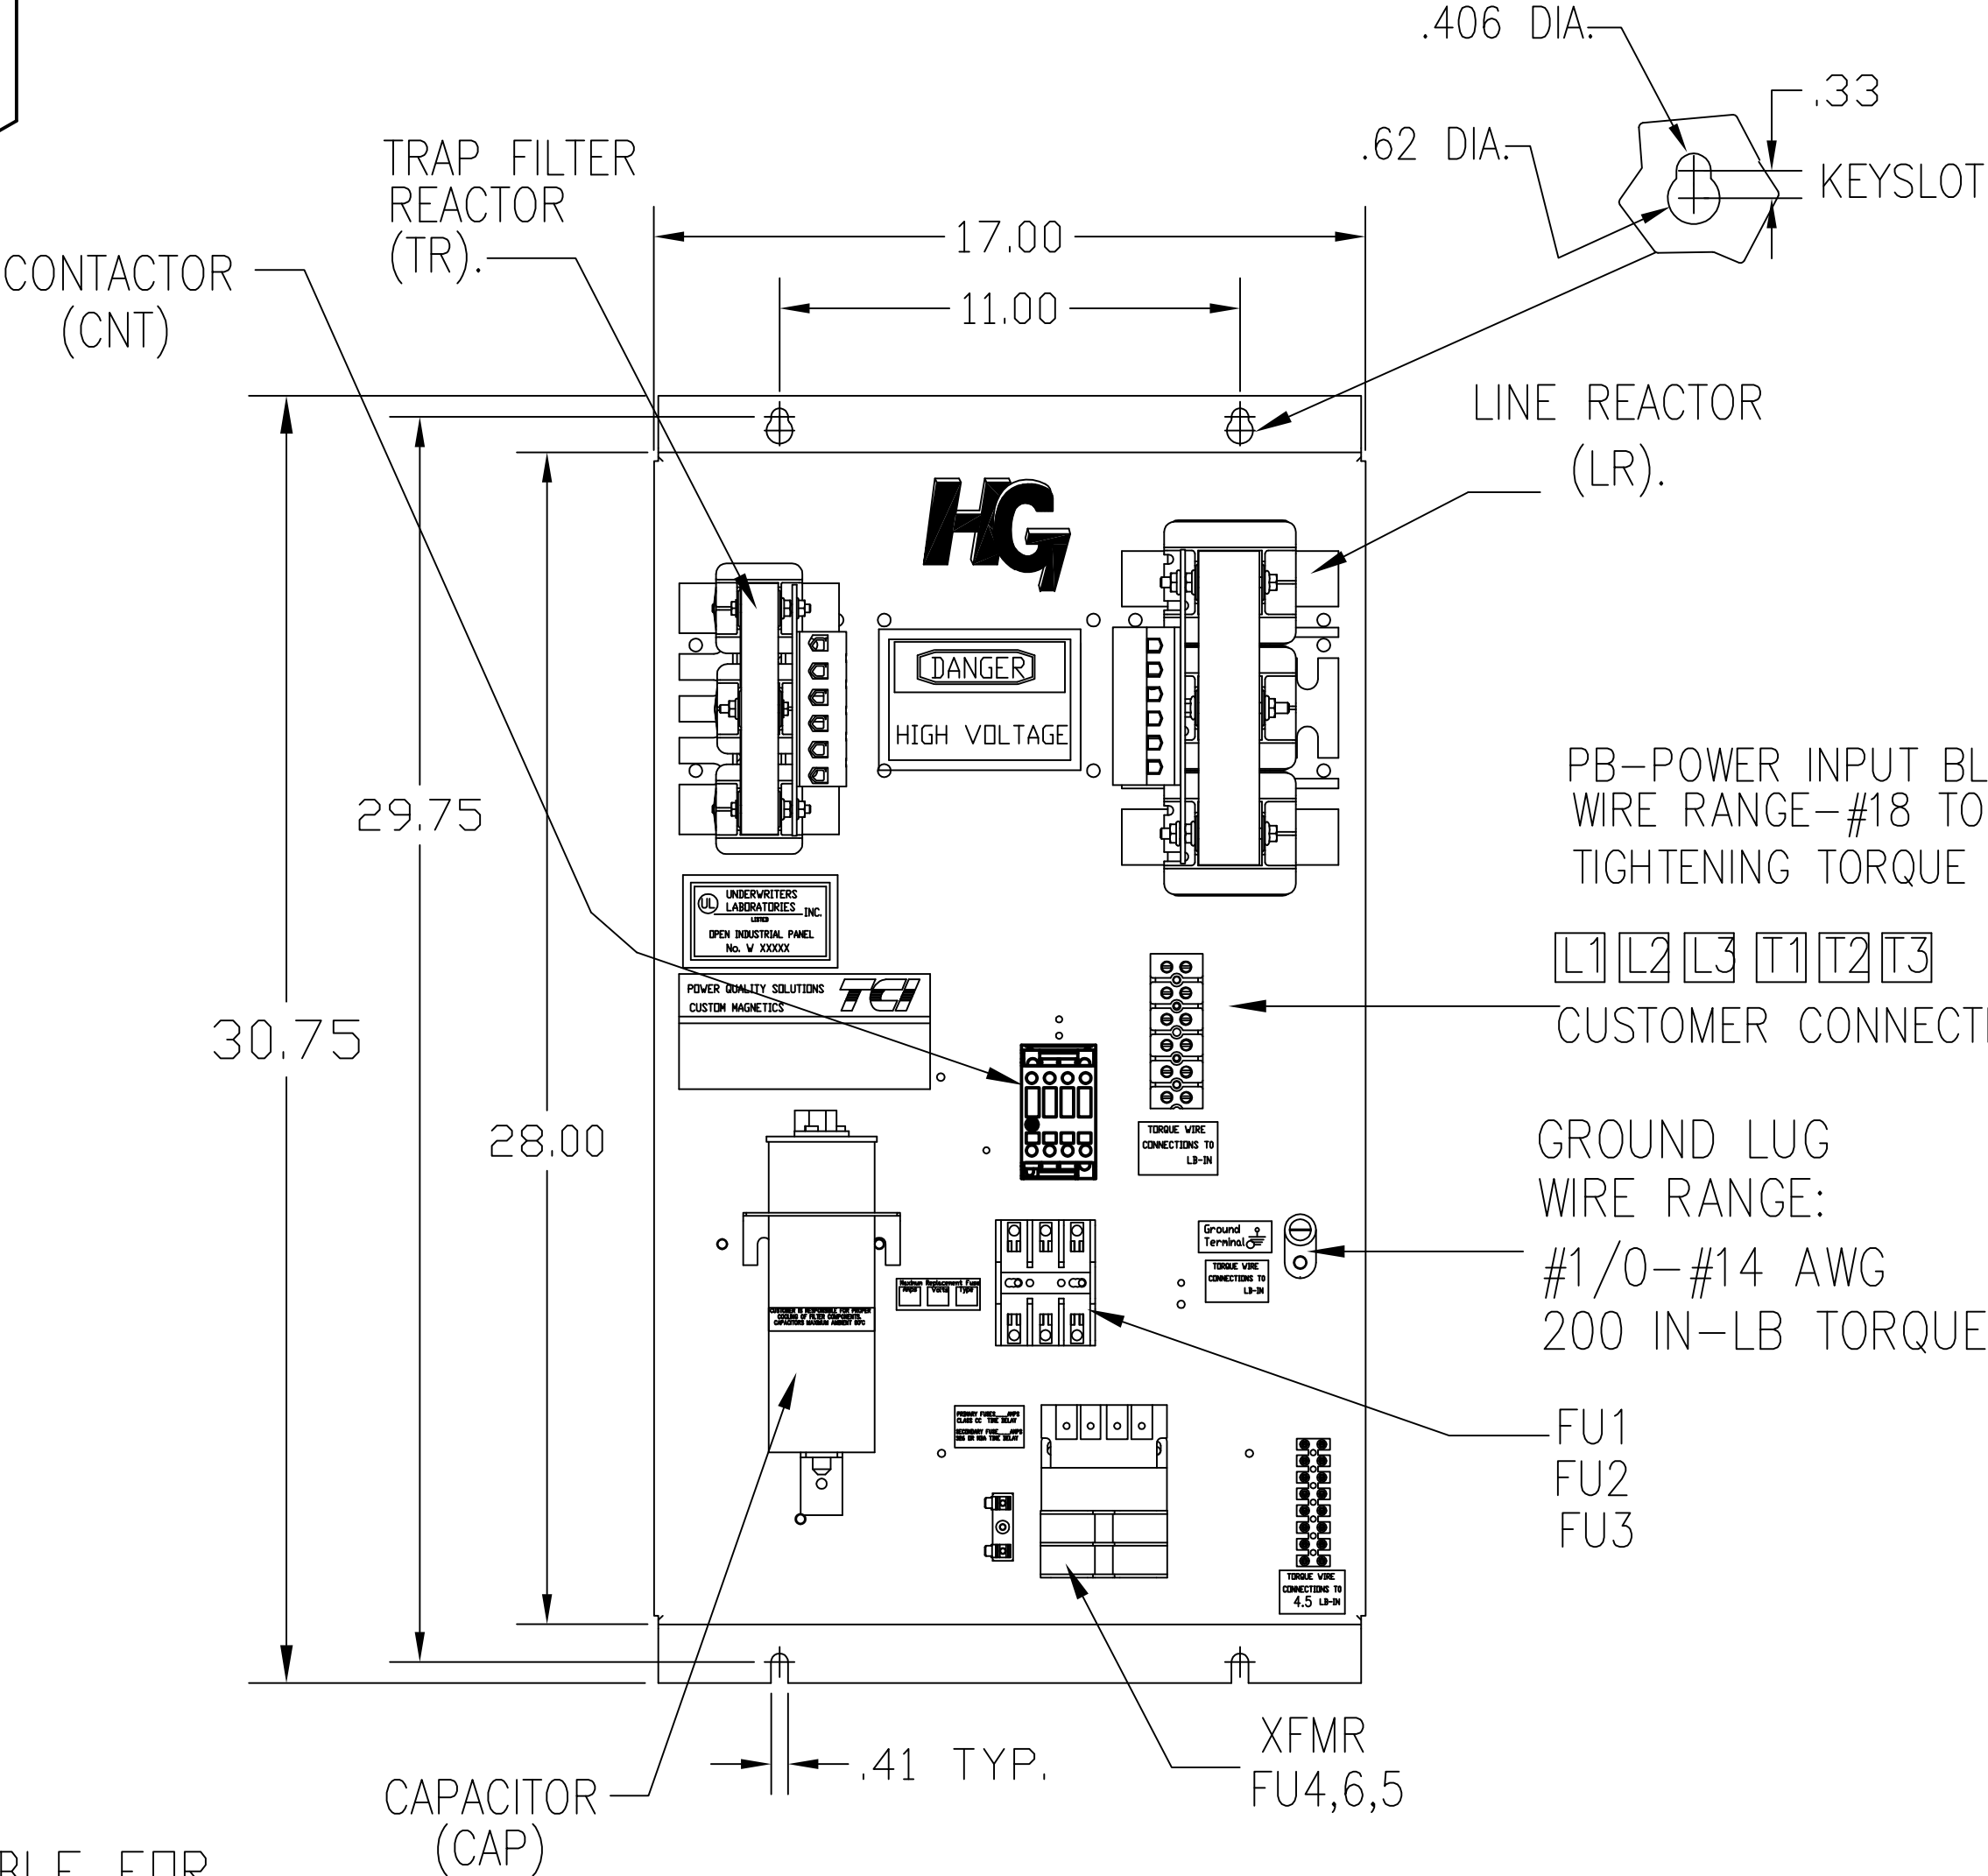

NOTE: WIRE CLEARANCE
REQUIRED

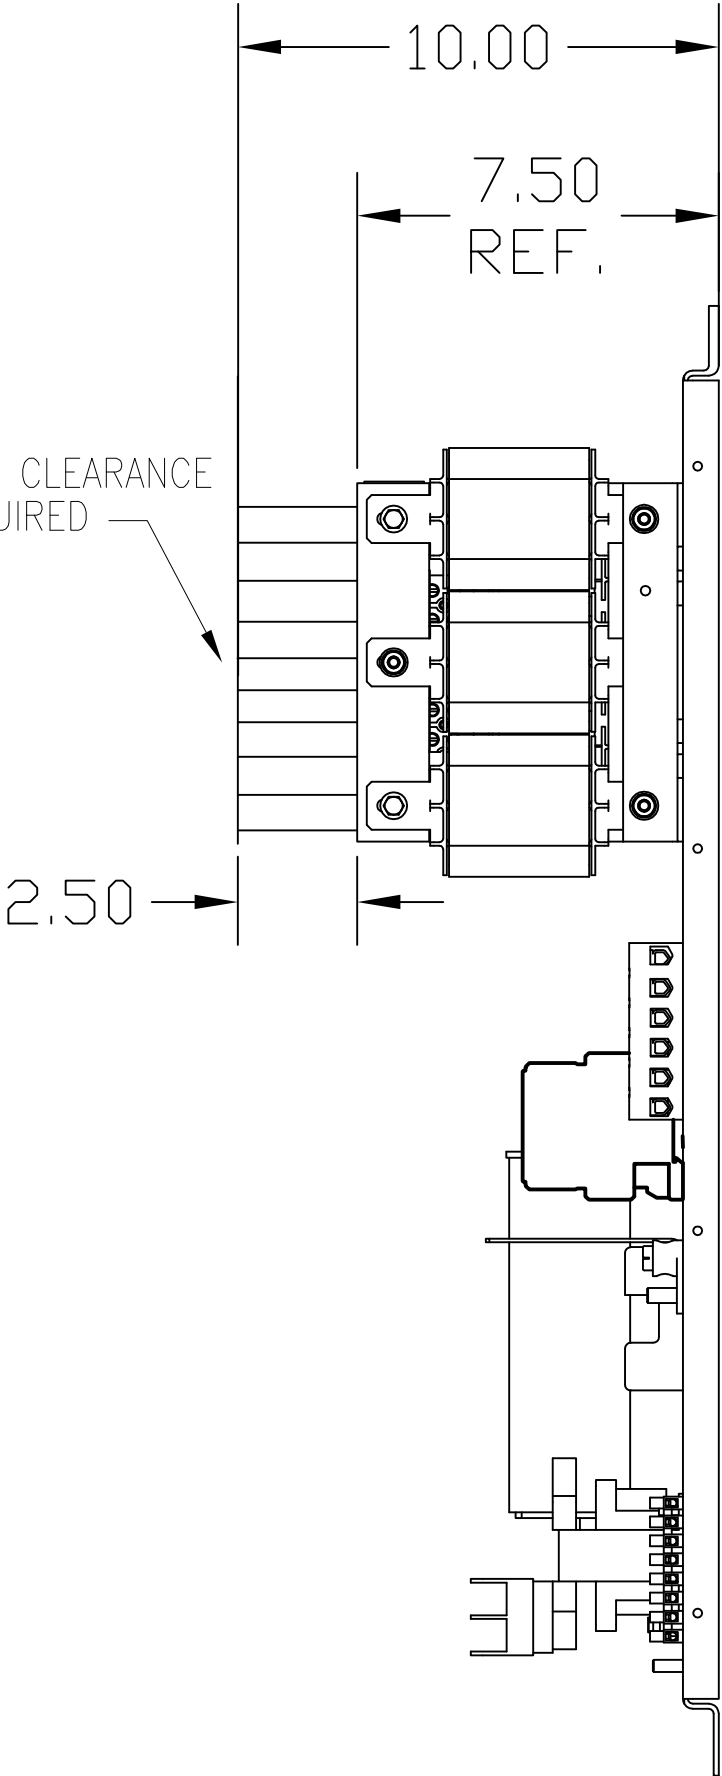

CUSTOMER IS RESPONSIBLE FOR
PROPER COOLING OF FILTER COMPONENTS.
CAPACITORS MAXIMUM AMBIENT 50°C.

CUSTOMER IS RESPONSIBLE FOR INSTALLATION
TO MEET ALL NATIONAL AND LOCAL ELECTRICAL CODES.

SEE DWG# 26878 FOR SCHEMATIC

				TOLERANCES (EXCEPT AS NOTED) DECIMAL	 W132 N10611 GRANT DRIVE GERMANTOWN, WI. 53022
				.XX ± .03	
				.XXX ± .01	
				FRACTIONAL ± 1/32	
				ANGULAR ± 1/2°	
3267 CNT CHANGE	11/16/15	BWM			HG15CW00STC, 15HP 600/3/60, OPEN, WITH CNT
CLASS J	9/29/10	DSW			
AS DESIGNED	11/11/08	DSW			DRN. BY DSW DATE 11/11/08 DWG. NO. 103568DG
REVISION	DATE	BY			SCALE TO SCALE APPRVD. SHT. 1 OF 1