
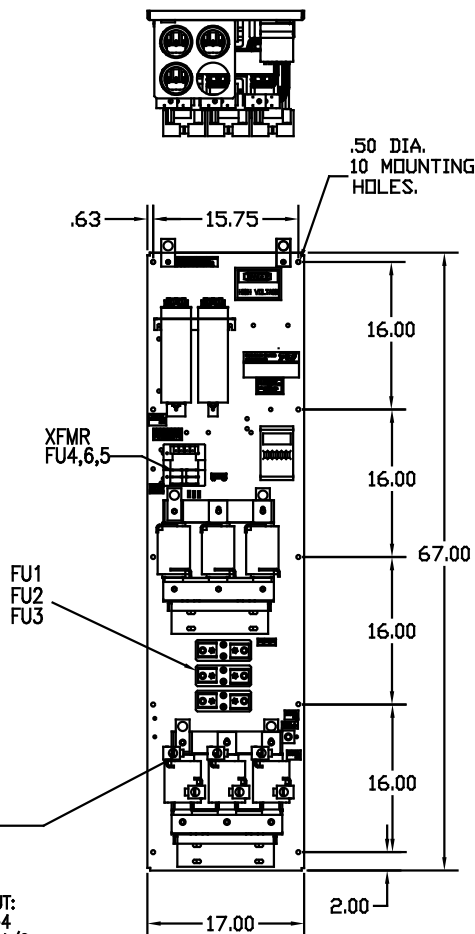
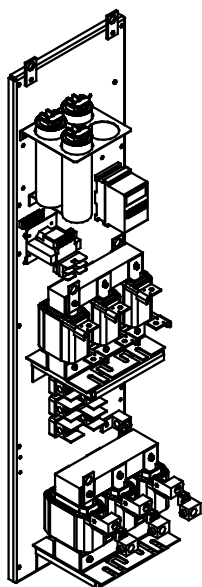


CUSTOMER CONNECTION OUTPUT:
WIRE RANGE—ONE 600MCM-4
TWO 250MCM-1/0
TIGHTENING TORQUE 500 IN-LB.

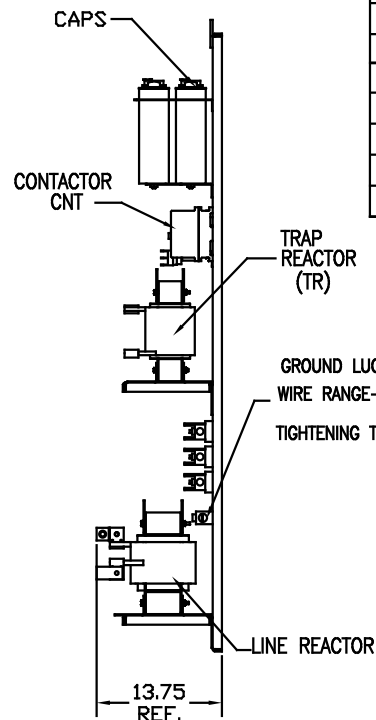

GROUND LUG:
WIRE RANGE—ONE 600MCM-4
TWO 250MCM-1/0
TIGHTENING TORQUE 500 IN-LB.

CUSTOMER IS RESPONSIBLE FOR PROPER COOLING OF FILTER COMPONENTS.
CAPACITORS MAXIMUM AMBIENT 50°C
PC BOARD MAX. AMBIENT 40°C.
CUSTOMER IS RESPONSIBLE FOR INSTALLATION TO MEET ALL NATIONAL AND LOCAL ELECTRICAL CODES.

UNIT SPECIFICATIONS:

KVAR	HARMONIC	VOLT	HZ	PHASE	HP
60	5TH	480	60	3	200
ENCLOSURE		WHITE OPEN PANEL			
APPROX.WT. LBS.		360			

SYMBOL	TCI PART NUMBER
LR	KDRS1T
TR	KTR60A65HG
CAP.1, CAP.2, CAP.3 (20 KVAR)	KCAP20A6B
XFMR.	23894
Fu1,2,3	11305
Fu4,6	13203
Fu5	13362
CNT	19246

FOR SCHEMATIC SEE DWG# 26690

SEE 26700-3 FOR DECAL LOCATIONS.
SEE PKLB52 FOR DECAL PARTS LIST

				TOLERANCES EXCEPT AS NOTED	7878 N. 86th STREET MILWAUKEE, WI 53224	
				DECIMAL		
				.XX ±.03	HG200AW00STC, HG7 W/CNT 200 HP, 480/3/60, OPEN	
				.XXX±.01		
				FRACTIONAL ± 1/32	DRN. BY DSW	DATE 7/23/08
				ANGULAR ± 1/2°	SCALE TO FIT	APPRV. B
NO	REVISION	DATE	BY			DWG. NO. 103537DG
						SHT.1 of 1