
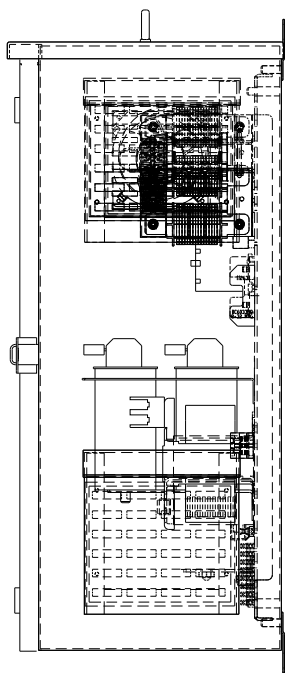
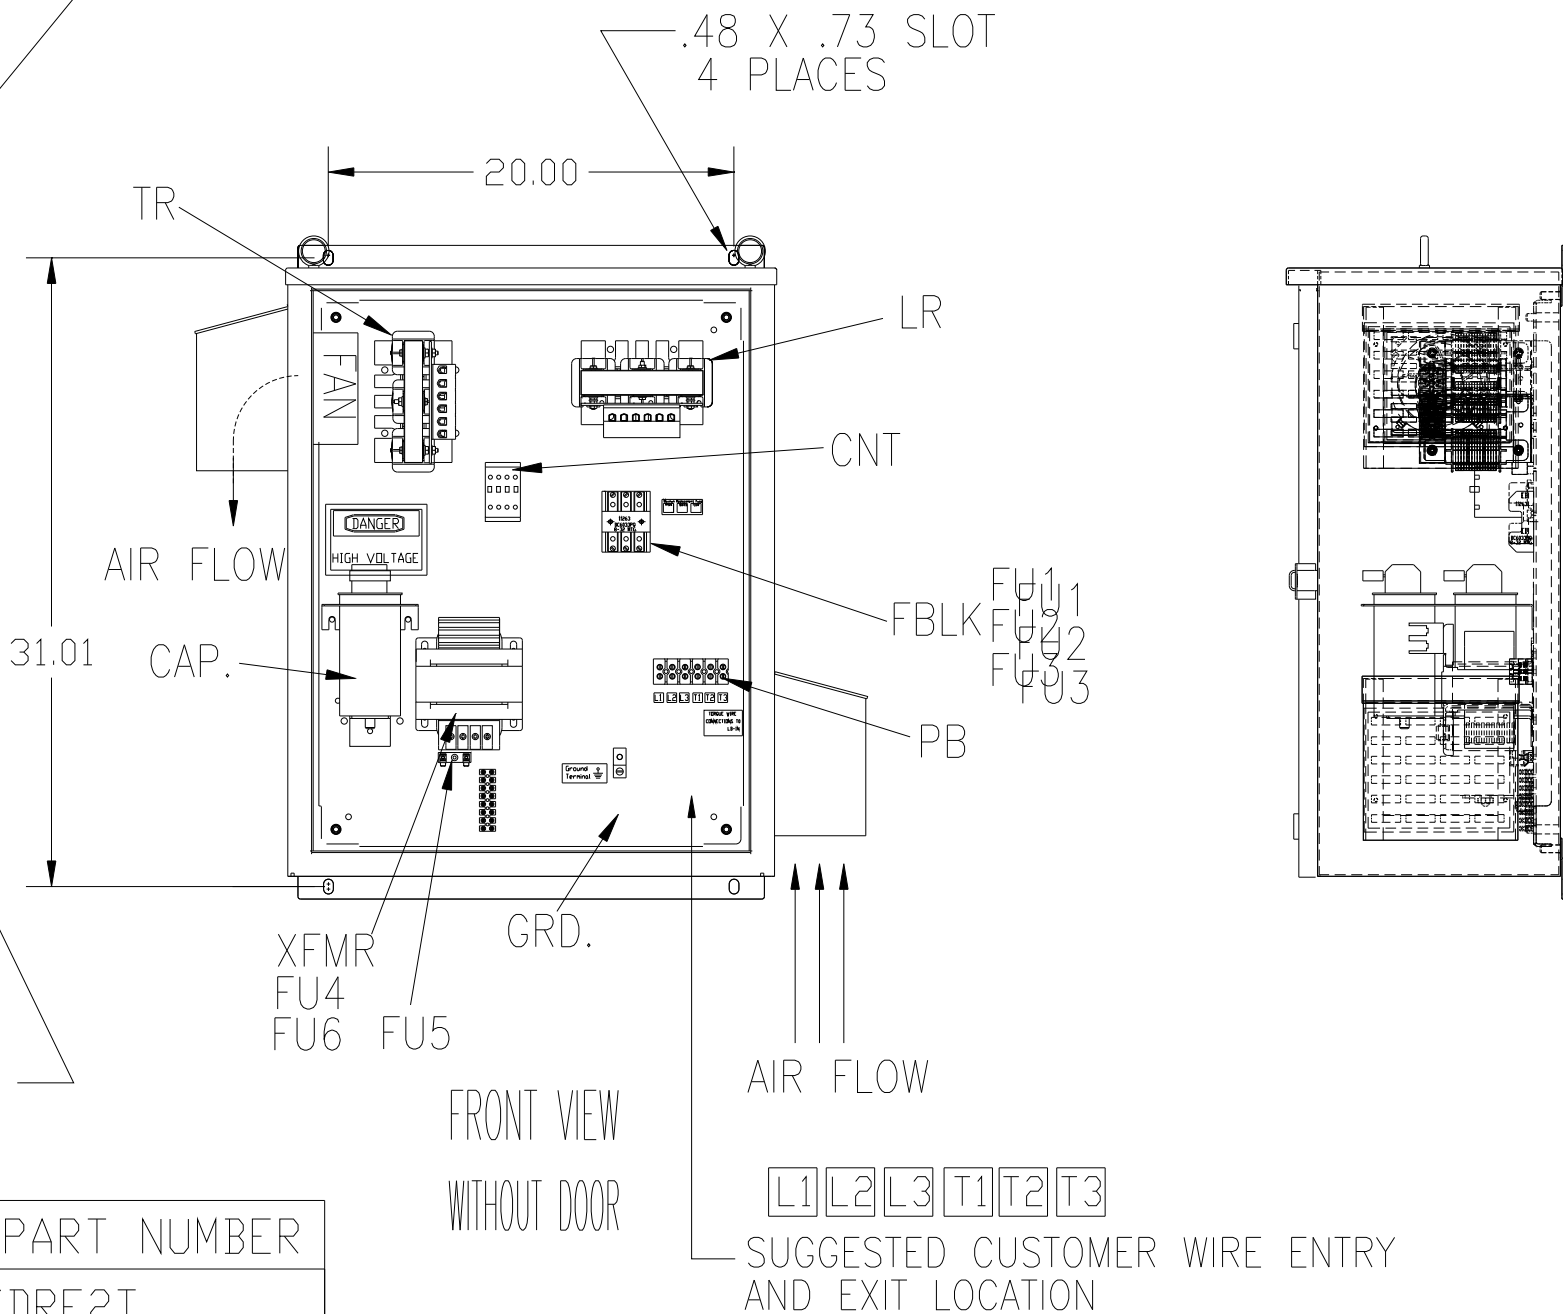
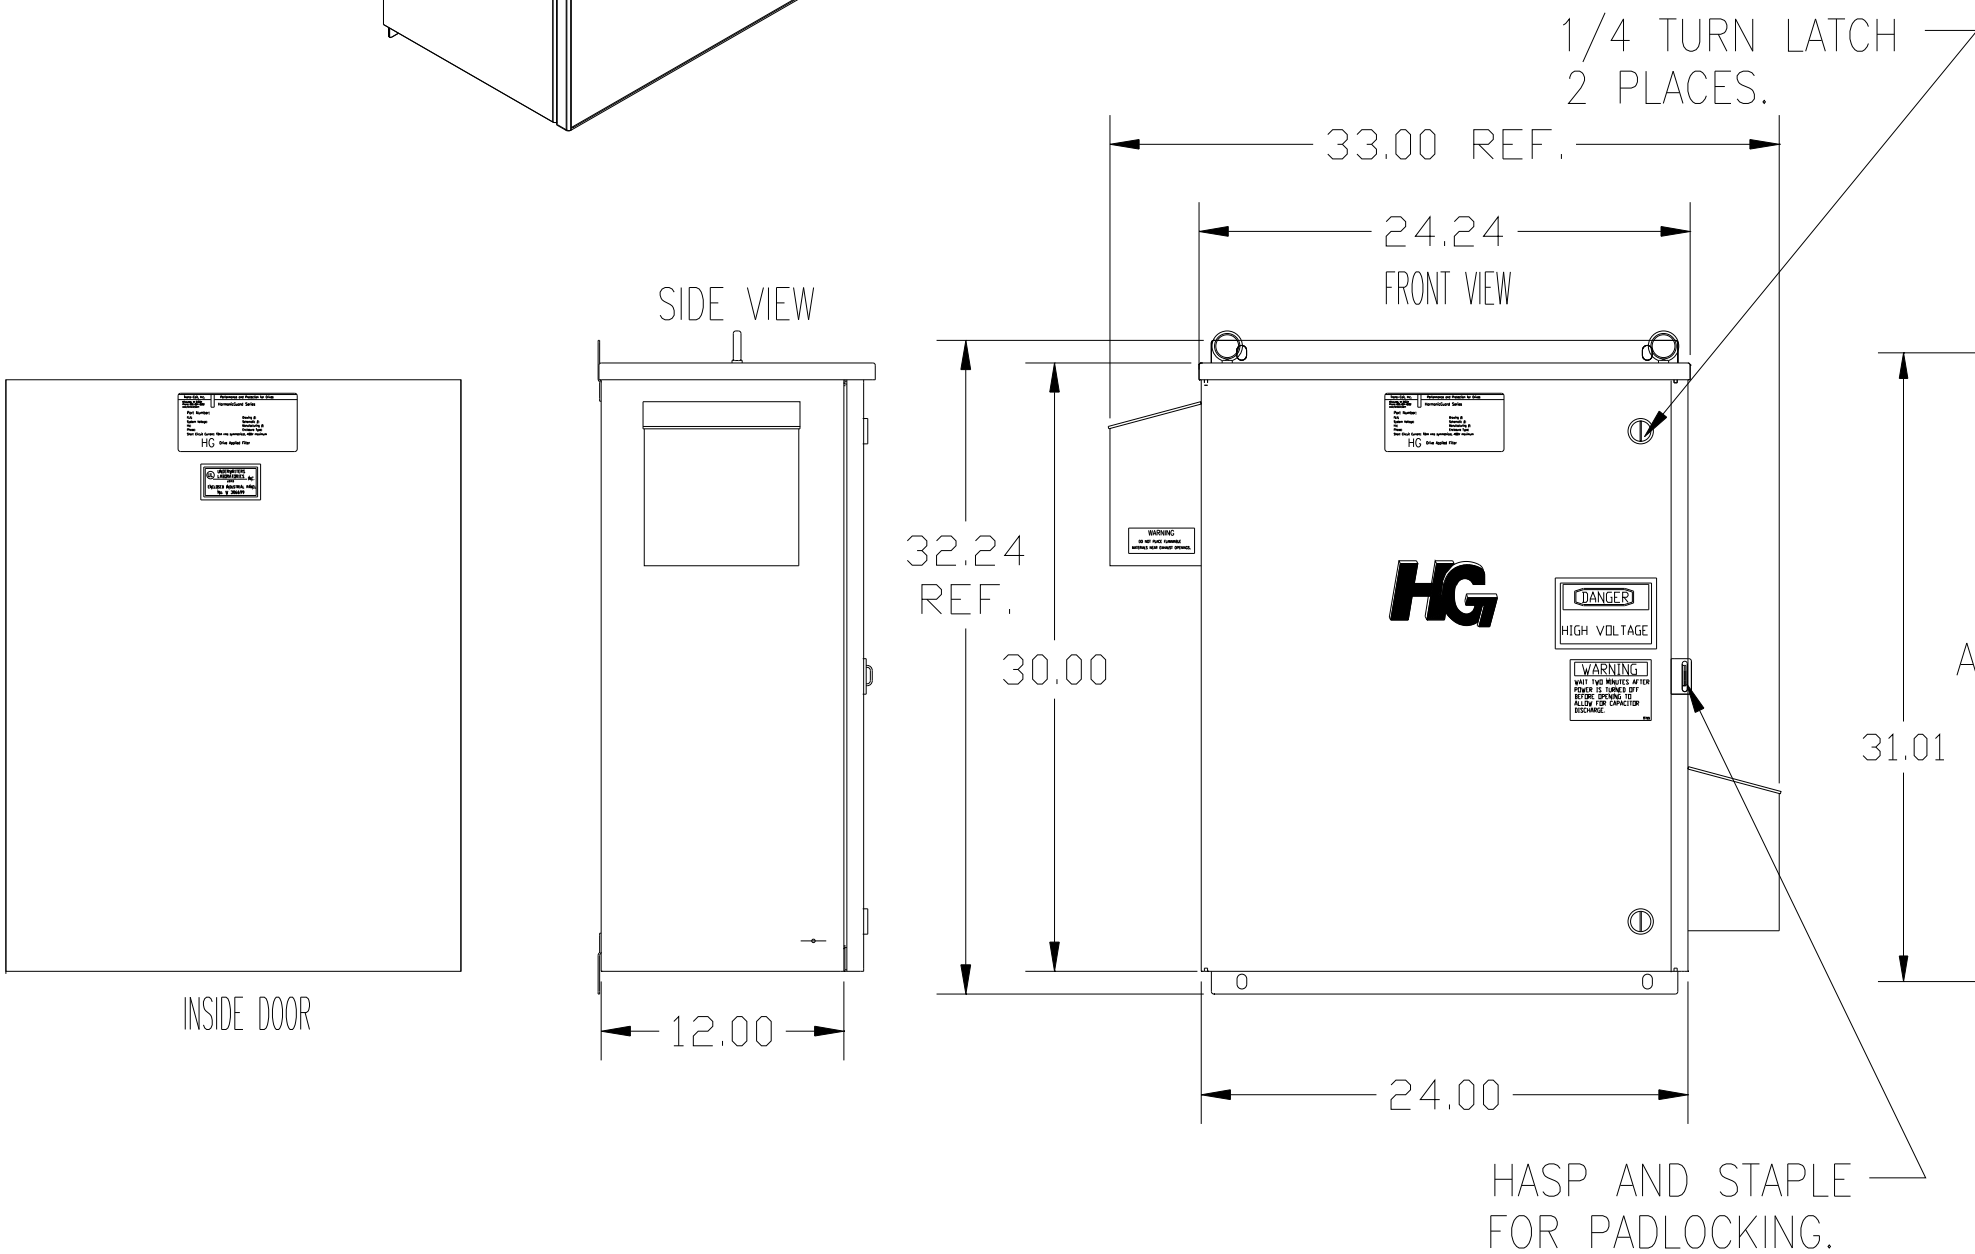
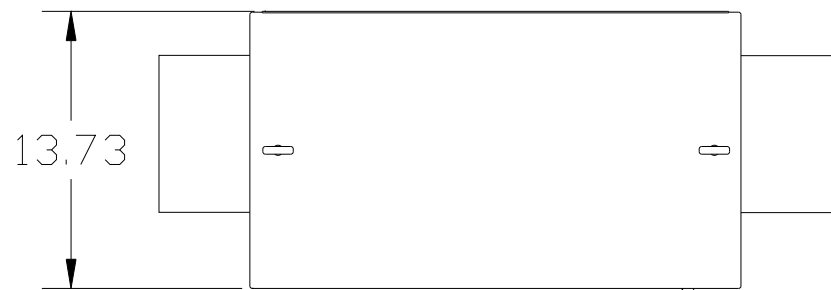


SEE DWG# 26752 FOR SCHEMATIC

CUSTOMER IS RESPONSIBLE FOR INSTALLATION
TO MEET ALL NATIONAL AND LOCAL ELECTRICAL CODES.

NOTE: USE ONLY HUBS OR FITTINGS THAT COMPLY
WITH UL514B FOR TYPE 3R ENCLOSURES.

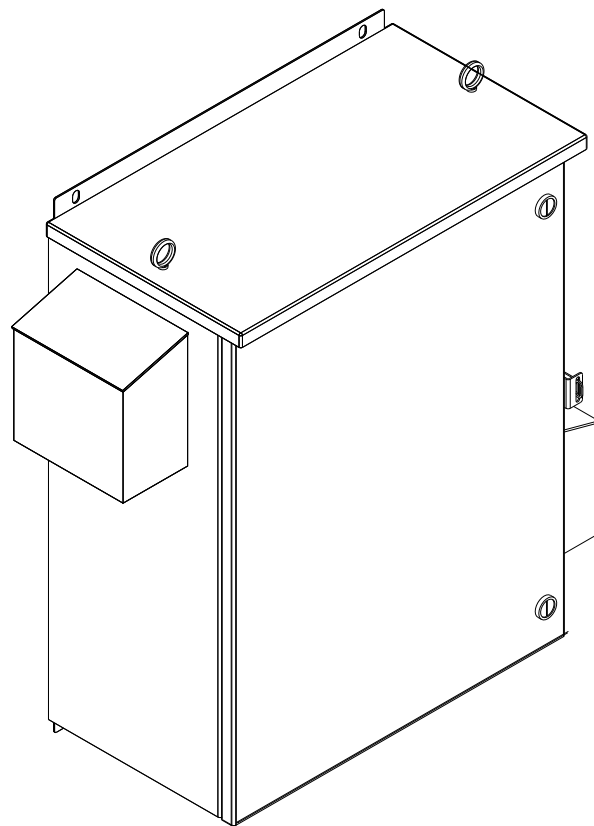

UNIT SPECIFICATIONS:					
KVAR	HARMONIC	VOLT	HZ	PHASE	HP
6	5TH	480	60	3	20
ENCLOSURE		UL TYPE 3R			
COLOR		WHITE			
APPROX.WT. LBS.		126			

SYMBOL	TCI PART NUMBER
LR	KDRF2T
TR	KTR6A65HG
CAP1, CAP2, (3 KVAR)	27605
XFMR.	23896
Fu1, 2, 3	15752
Fu4,6	24009
Fu5	17567
CNT	12434
SYMBOL	TCI PART NUMBER
CAP1, CAP2, (3 KVAR)	KCAP3A6A

PB-POWER INPUT BLOCK:
WIRE RANGE-#18 TO #4 AWG.
TIGHTENING TORQUE 20 IN-LB.

GROUND LUG:
WIRE RANGE-1/0 TO #14 AWG.
1/0 AWG thru 2 AWG 50 IN-LBS. MAX.
4 AWG thru 6 AWG 45 IN-LBS. MAX.
8 AWG 40 IN-LBS. MAX.
10 AWG thru 14 WG 35 IN-LBS. MAX.

E	2900 CHG TO ASC CAPS	3/15/13	DSW	TOLERANCES (EXCEPT AS NOTED)	 7878 N. 86th STREET MILWAUKEE, WI 53224
D	2707 CHG GRD. LUG	6/15/11	DSW	DECIMAL	
C	2702 RVSD FUSEBLK&FUSE	9/2/10	RJC	.XX ±.12	HG20AW03STC, 20HP 480/3/60 UL TYPE 3R
B	2684 12434 WAS ADD			.XXX±.03	
B	26739	5/27/10	DSW	FRACTIONAL ± 1/32	DRN. BY DSW DATE 08/25/08 DWG. NO. 103668DG SCALE TO FIT APRVD. C SHT.1 OF1
A	2641 ADD EYEBOLTS	10/13/09	DSW	ANGULAR ± 1/2°	
NO	REVISION	DATE	BY		