


SEE 26822 FOR SCHEMATIC

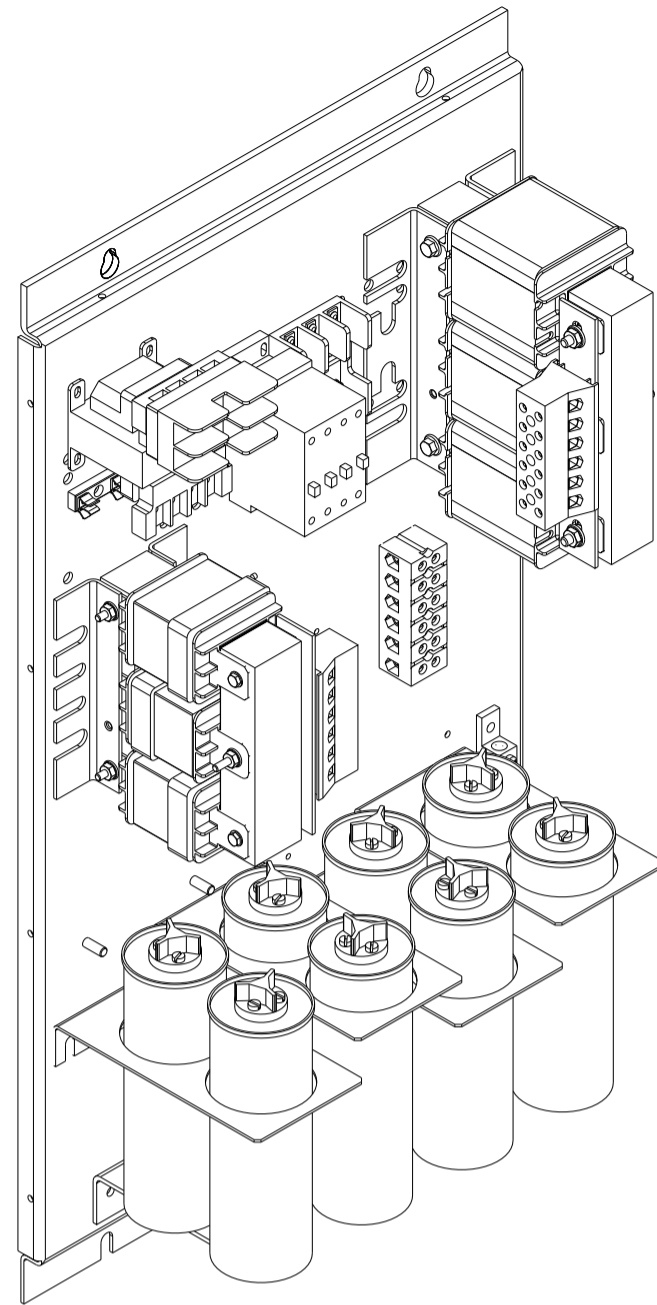


PB-POWER INPUT BLOCK:
WIRE RANGE-#18 TO #4 AWG.
TIGHTENING TORQUE 20 IN-LB.

GROUND LUG:
WIRE RANGE-1/0 TO #14 AWG.
1/0 AWG thru 2 AWG 50 IN-LBS. MAX.
4 AWG thru 6 AWG 45 IN-LBS. MAX.
8 AWG 40 IN-LBS. MAX.
10 AWG thru 14 AWG 35 IN-LBS. MAX.

UNIT SPECIFICATIONS:					
KVAR	HARMONIC	VOLT	HZ	PHASE	HP
6	5TH	240	60	3	20
ENCLOSURE		WHITE OPEN PANEL			
		WITH CONTACTOR			
APPROX.WT. LBS.		95			

SYMBOL	TCI PART NUMBER
LR	KDRF22T
TR	KTR6B65HG
CAP1-8 (3 KVAR)	KCAP3A6A
XFMR.	23891
Fu1, 2, 3	22665
Fu4,6	24073
Fu5	13364
CNT	23021

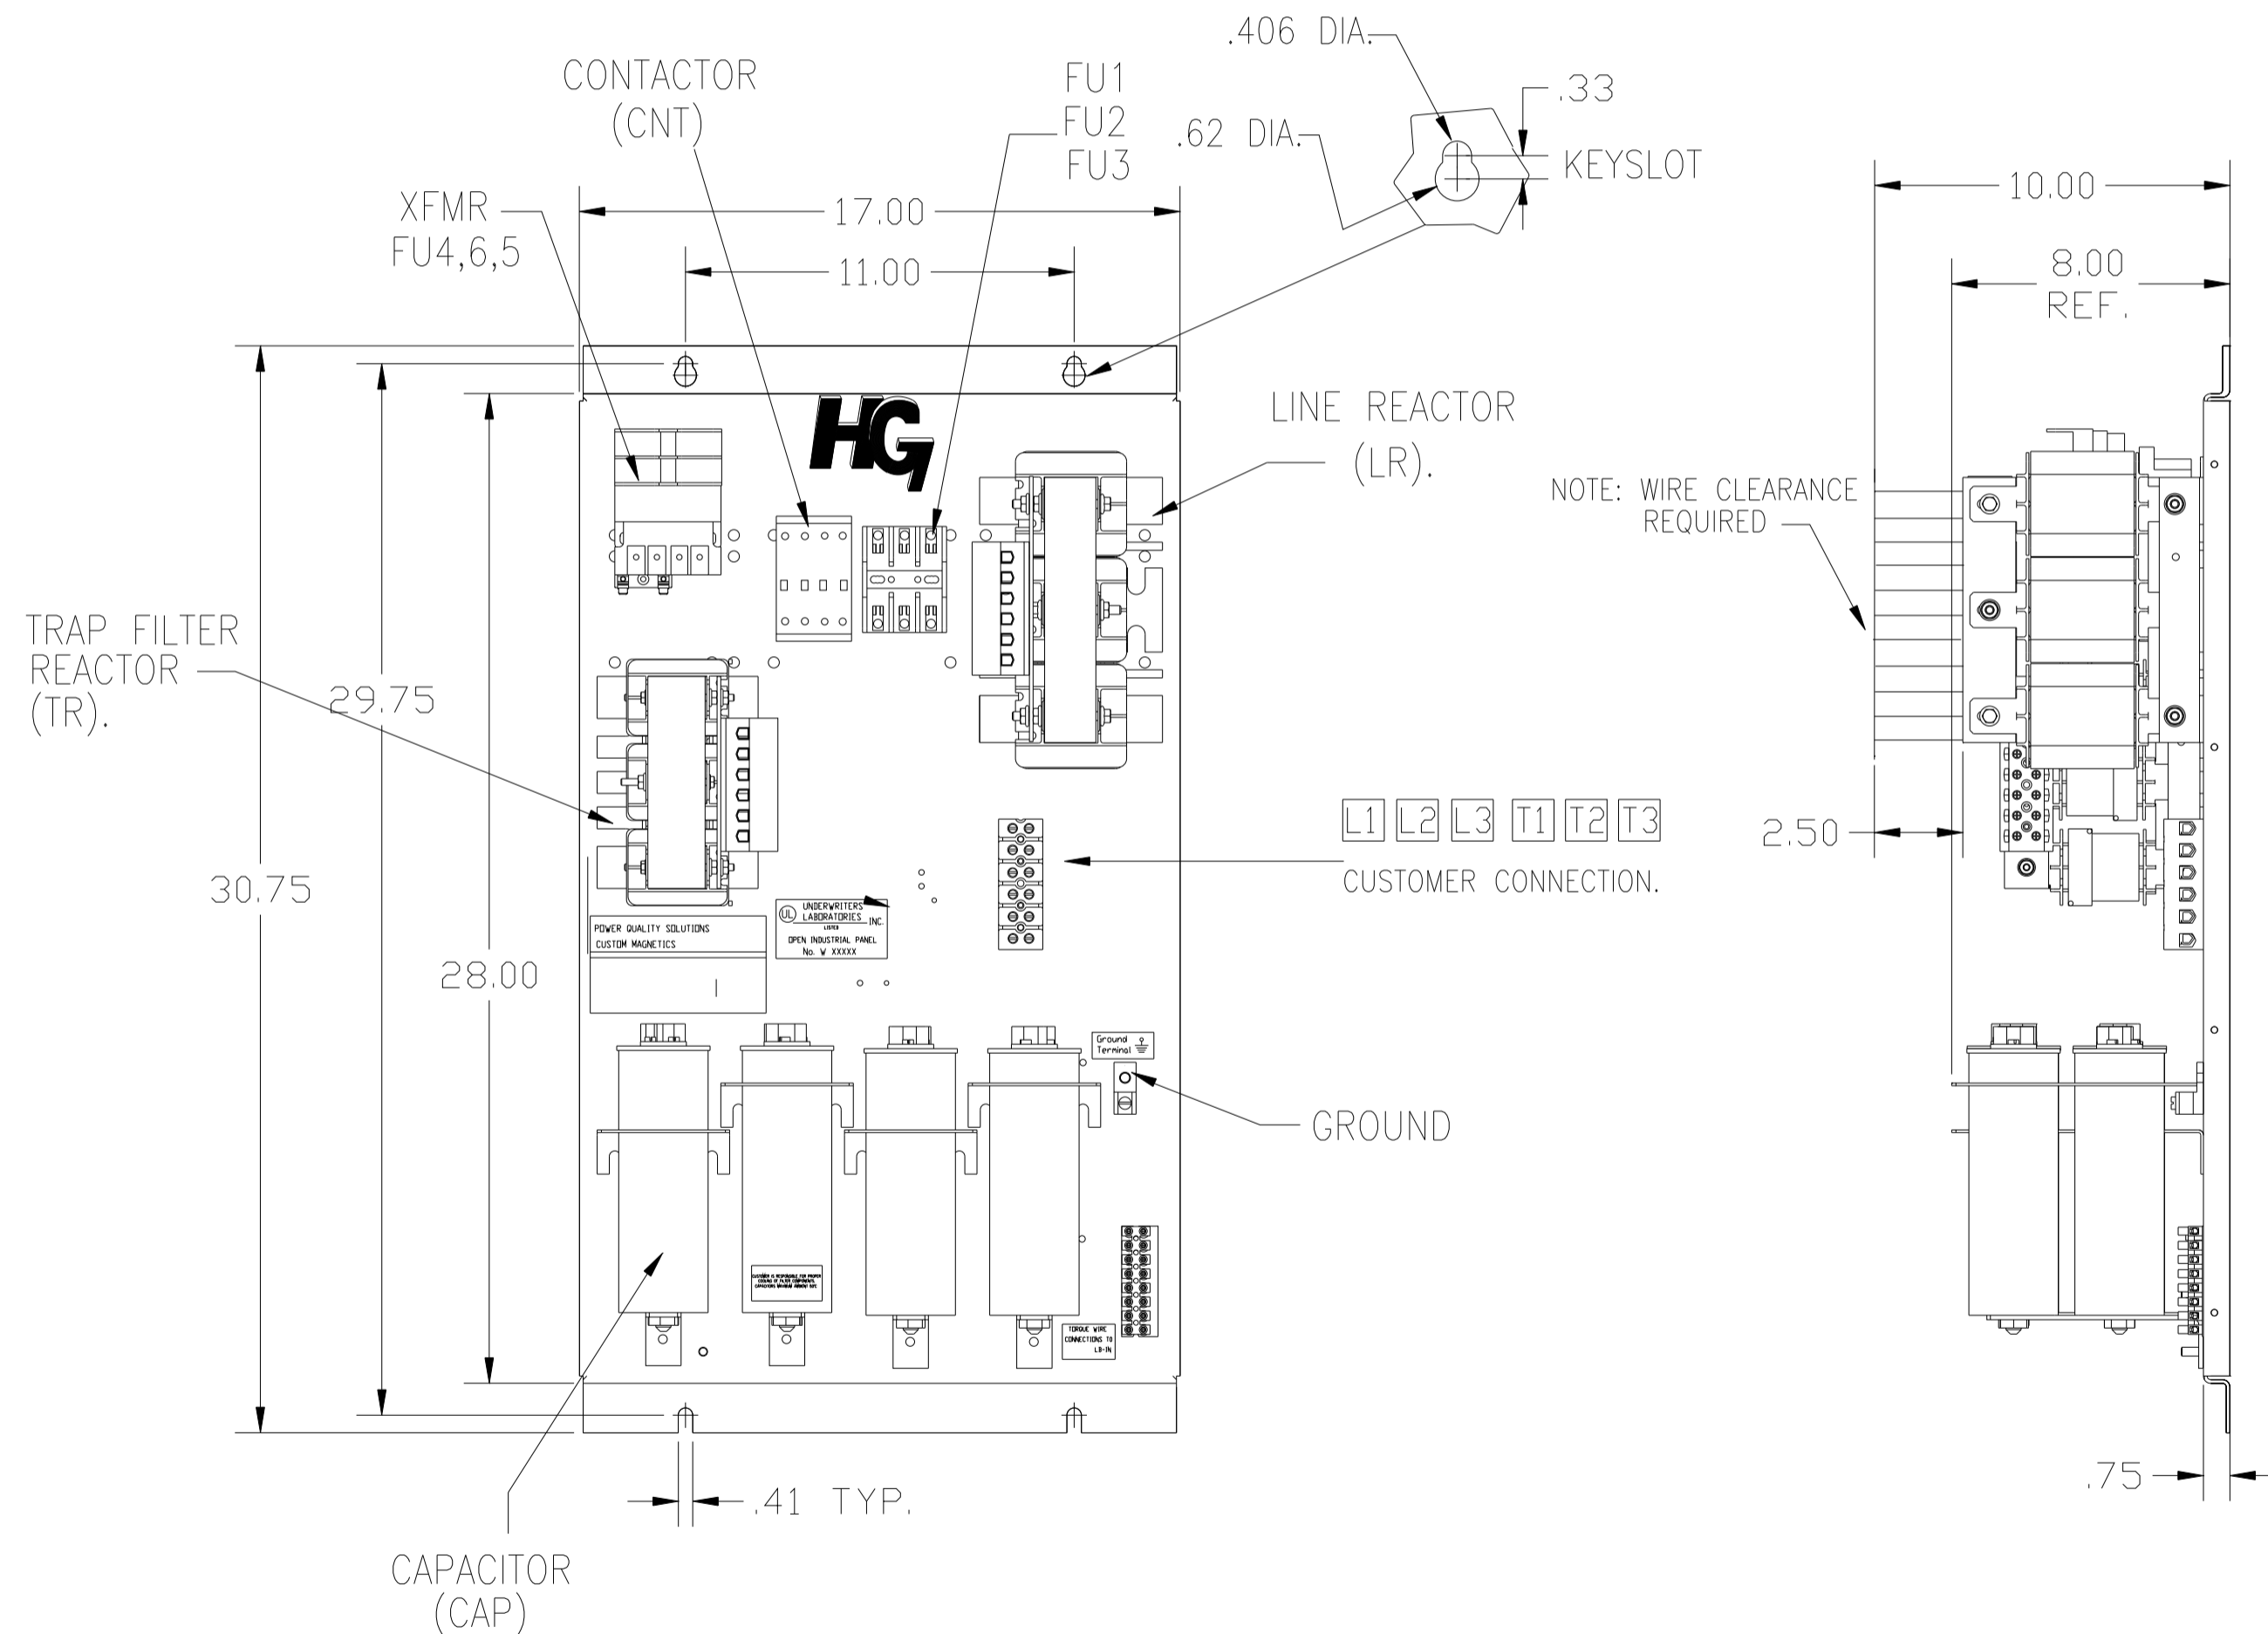

CUSTOMER IS RESPONSIBLE FOR PROPER COOLING OF FILTER COMPONENTS. CAPACITORS MAXIMUM AMBIENT 50°C.

CUSTOMER IS RESPONSIBLE FOR INSTALLATION TO MEET ALL NATIONAL AND LOCAL ELECTRICAL CODES.

				TOLERANCES (EXCEPT AS NOTED)	7878 N. 86th STREET MILWAUKEE, WI 53224
				DECIMAL	
				.XX ± .03	HG20BW00STC, 20HP 240/3/60, OPEN, WITH CNT
				.XXX ± .01	
				FRACTIONAL ± 1/32	
				ANGULAR ± 1/2°	DRN BY DSW DATE 10/09/08 DWG. NO. 103602DG SCALE TO SCALE APPRVD. C
NO	REVISION	DATE	BY		SHT. 1 OF 1