


INSIDE DOOR



SIDE VIEW

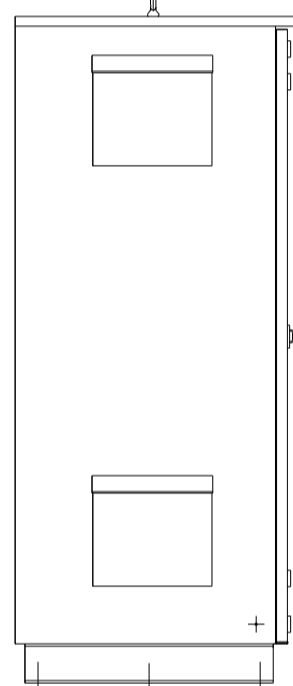


CUSTOMER IS RESPONSIBLE FOR INSTALLATION TO MEET ALL NATIONAL AND LOCAL ELECTRICAL CODES.

NOTE: USE ONLY HUBS OR FITTINGS THAT COMPLY WITH UL514B FOR TYPE 3R ENCLOSURES.


SEE DWG# 26751 FOR SCHEMATIC

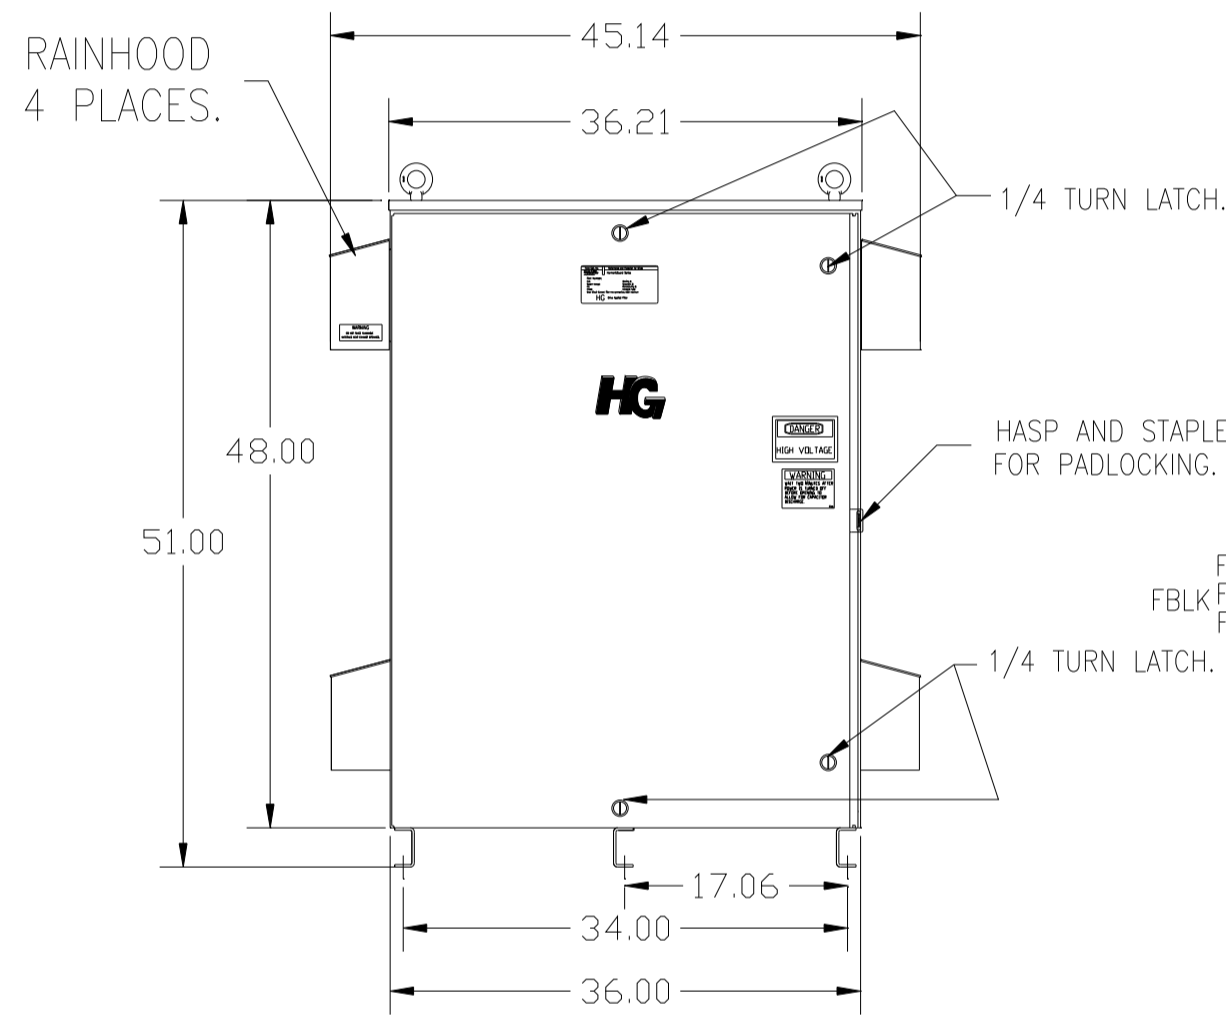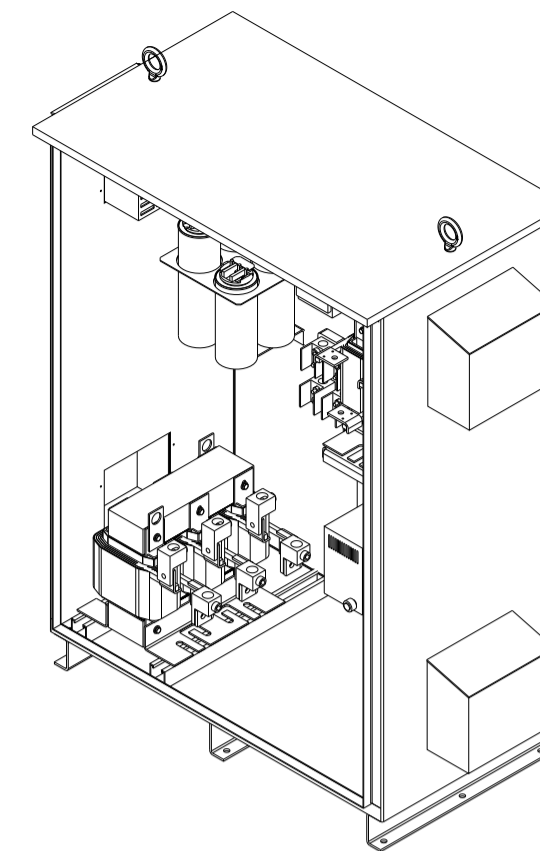


FRONT VIEW WITH DOOR

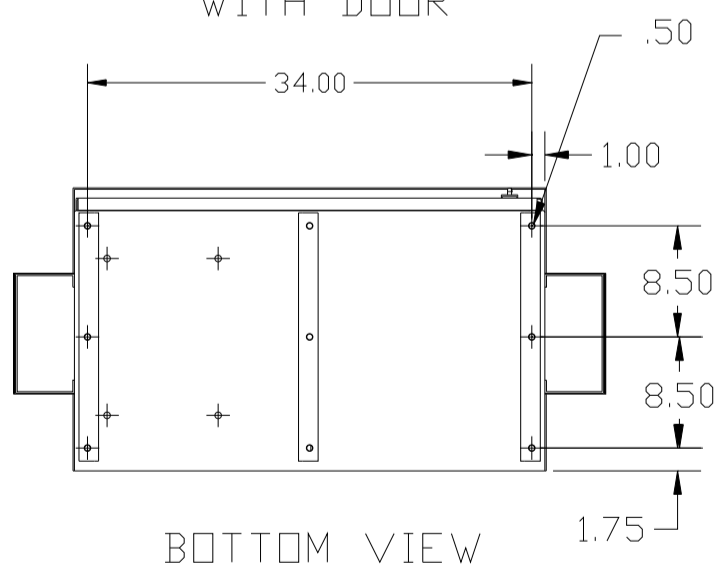

BOTTOM VIEW

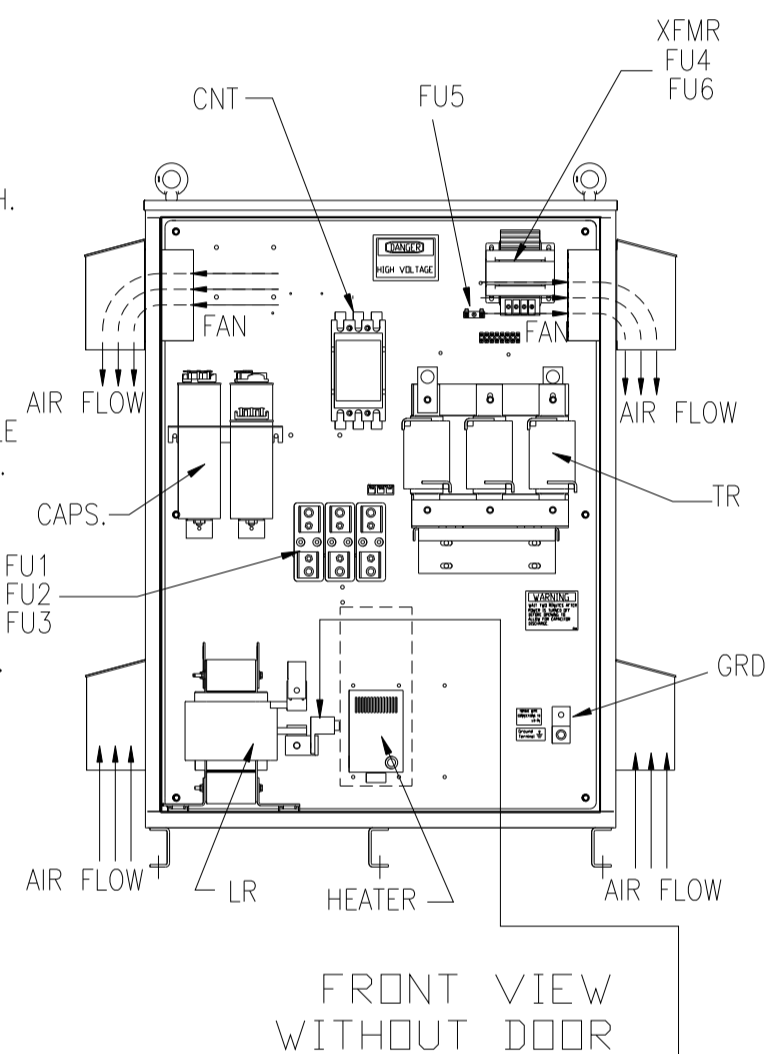

FRONT VIEW WITHOUT DOOR

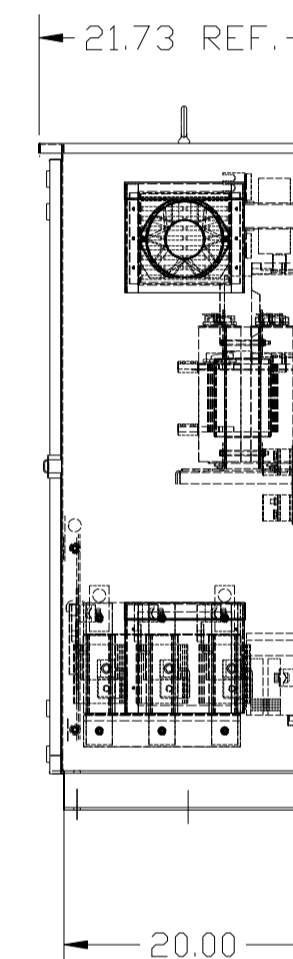

SIDE VIEW



SUGGESTED CUSTOMER WIRE ENTRY AND EXIT LOCATION

SYMBOL	TCI PART NUMBER
LR	KDRS2T
TR	KTR75A65HG
CAP.1, CAP2, CAP3 (20 KVAR)	27609
CAP.4 (15 KVAR)	27608
XFMR.	23899
Fu1;2;3	13333
Fu4,6	14106
Fu5	23977
CNT	23368
HEATER	20109
ALTERNATE	TCI PART NUMBER
CAP.1, CAP2, CAP3 (20 KVAR)	KCAP20A6B
CAP.4 (15 KVAR)	KCAP15A6A

UNIT SPECIFICATIONS:					
KVAR	HARMONIC	VOLT	HZ	PHASE	HP
75	5TH	480	60	3	250
ENCLOSURE	TYPE 3R- COLOR WHITE				
FEATURES	CONTACTOR, HEATER				
APPROX.WT. LBS.	555				

GROUND LUG:
WIRE RANGE—ONE 600MCM—4
TWO 250MCM—1/0
TIGHTENING TORQUE 500 IN—LB.

CUSTOMER CONNECTION OUTPUT:
WIRE RANGE—ONE 600MCM—4
TWO 250MCM—1/0
TIGHTENING TORQUE 500 IN—LB.

TOLERANCES (EXCEPT AS NOTED)		TCI 7878 N. 86th STREET MILWAUKEE, WI 53224	
DECIMAL	FRACTIONAL	DRN BY	DATE
.XX ±.12	± 1/32	DSW	09/15/08
.XXX ±.06	ANGULAR ± 1/2°	SCALE TO FIT	APRVD.
		DWG. NO. 103734DG	
A 2641 ADD EYEBOLTS		DATE 10/21/09	
NO REVISION		BY DSW	
		SHT. 1 OF 1	