
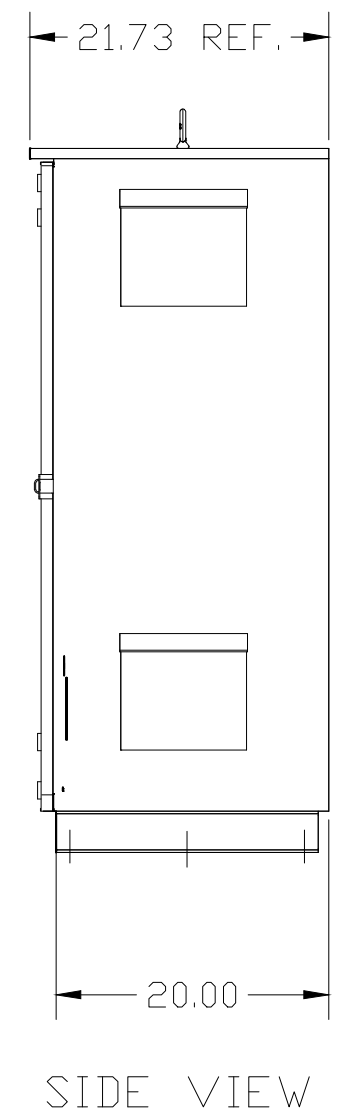
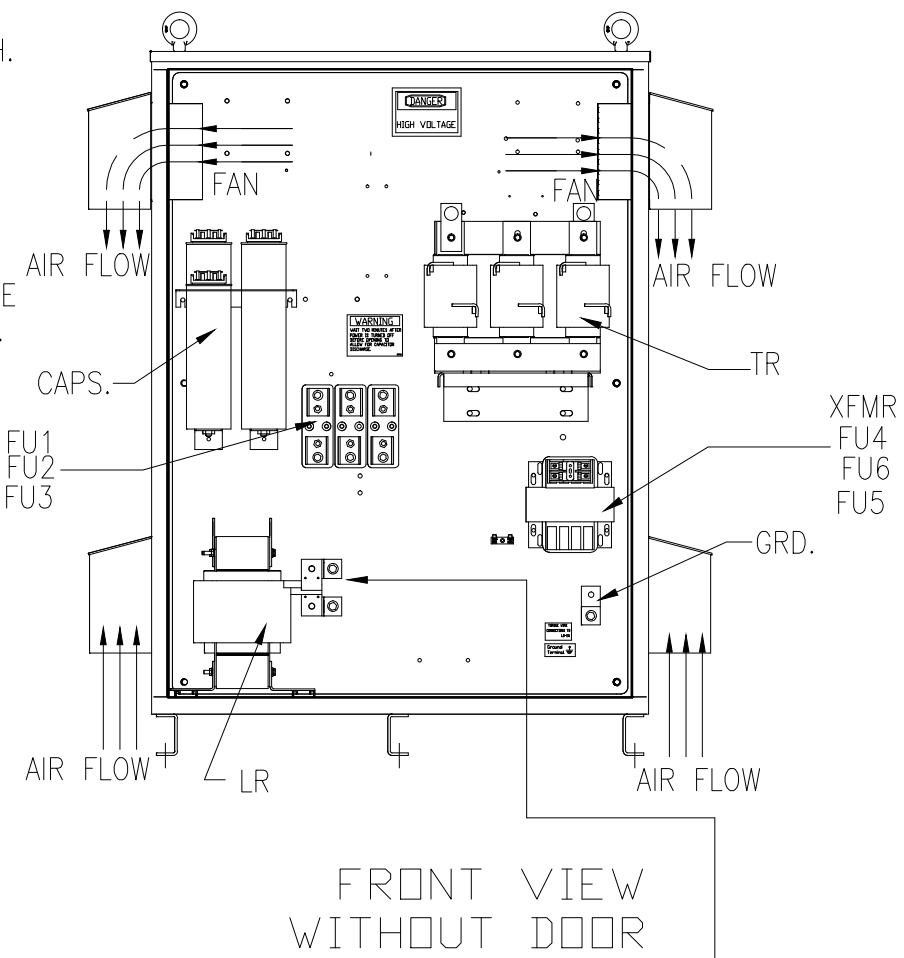
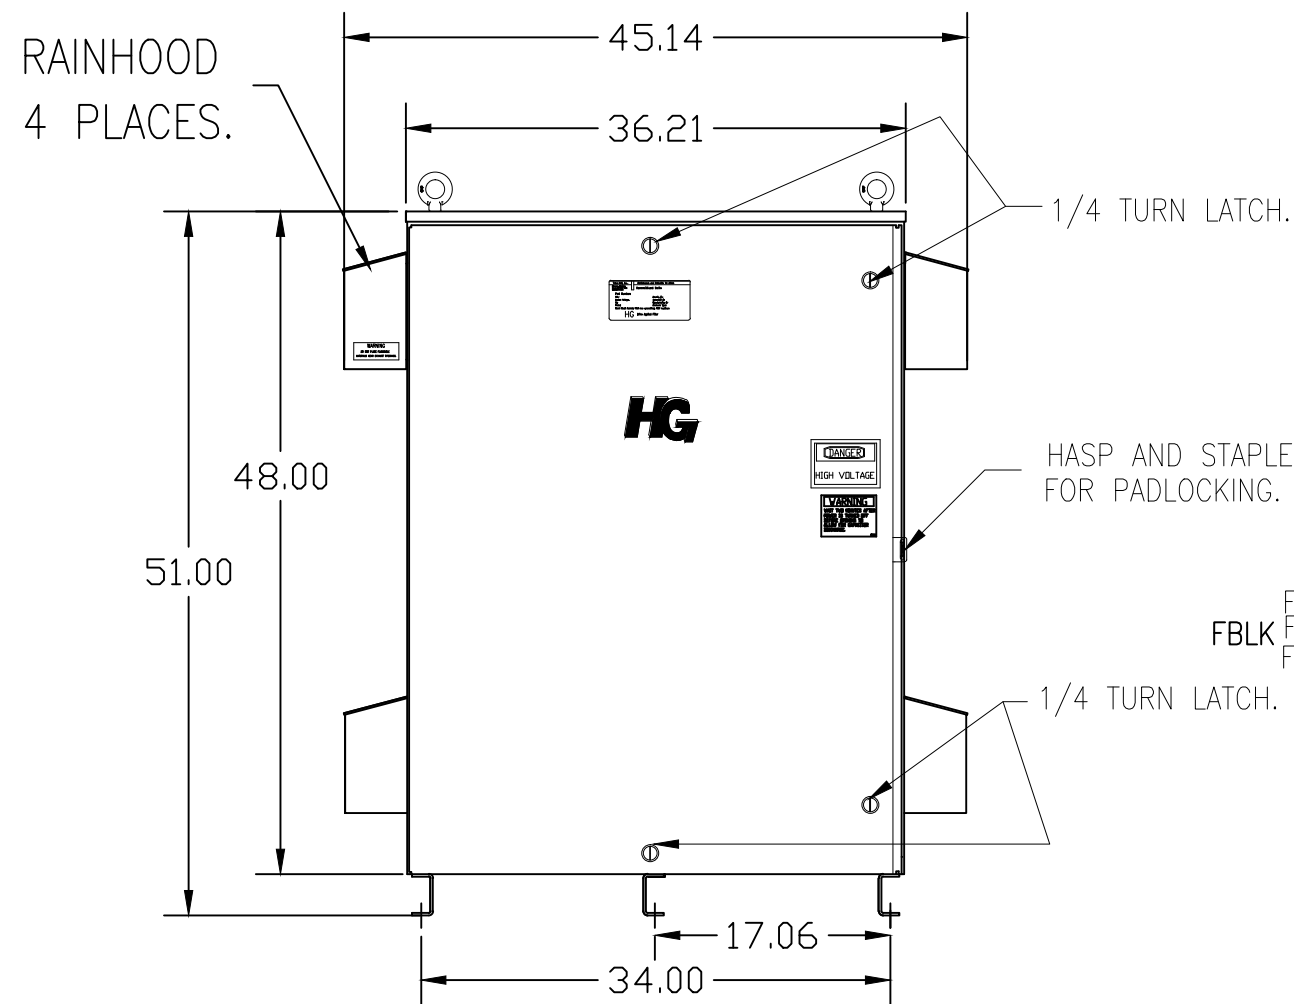
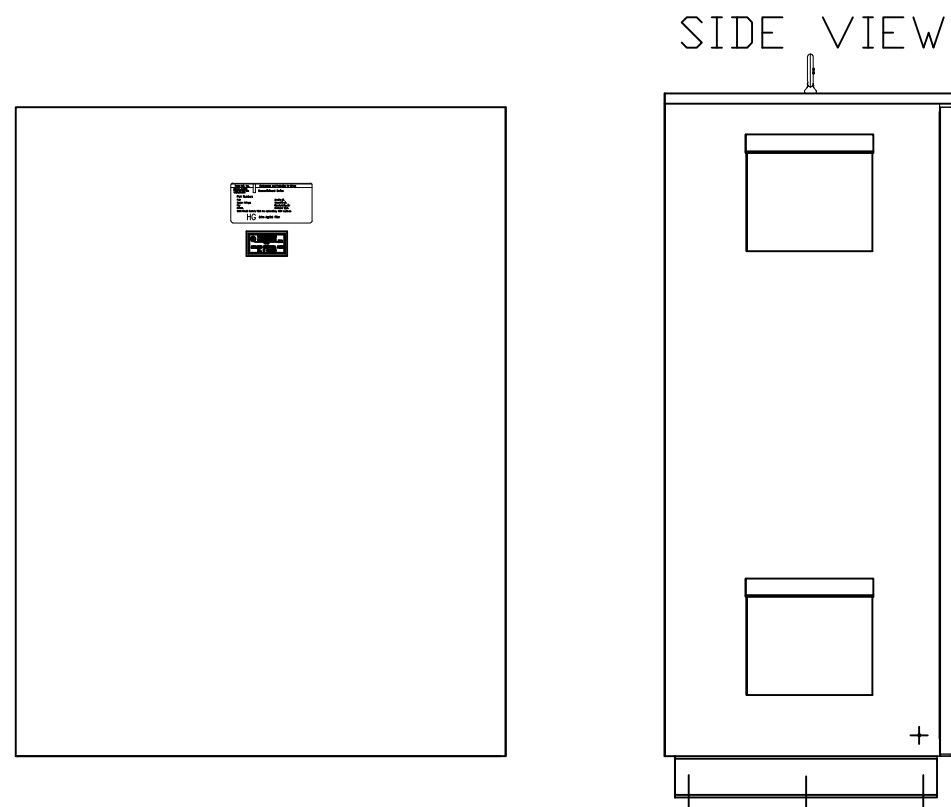


CUSTOMER IS RESPONSIBLE FOR INSTALLATION
TO MEET ALL NATIONAL AND LOCAL ELECTRICAL CODES.


NOTE: USE ONLY HUBS OR FITTINGS THAT COMPLY
WITH UL514B FOR TYPE 3R ENCLOSURES.

SEE DWG# 26972-2 FOR SCHEMATIC

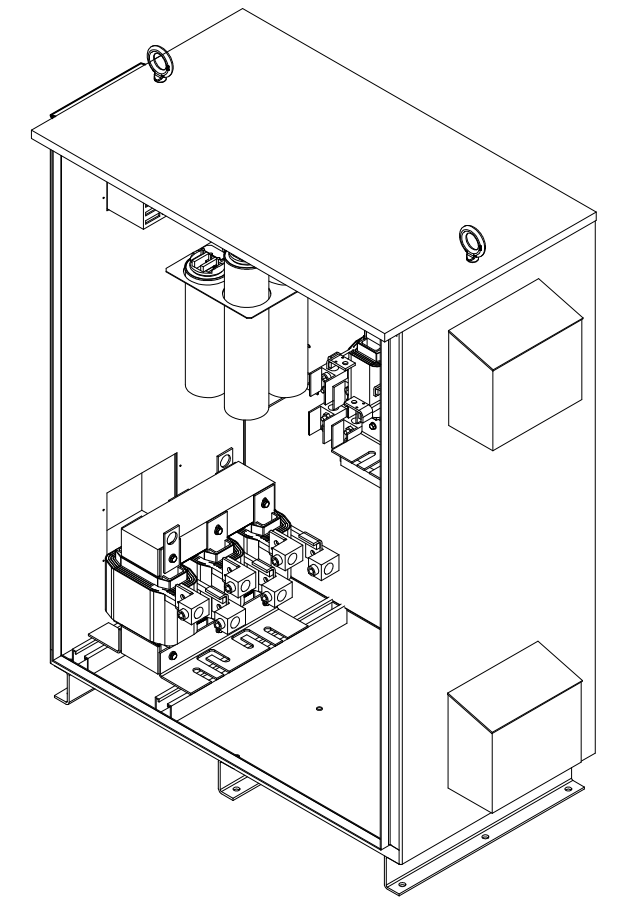


INSIDE DOOR SYMBOL	TCI PART NUMBER
LR	KDRS42T
TR	KTR75C65HG
CAP.1, CAP2, CAP3 (20 KVAR)	KCAP20C6B
CAP.4 (15 KVAR)	KCAP15CA6B
XFMR.	24389
Fu1,2,3	11305
Fu4,6	24073
Fu5	13362

FRONT VIEW WITH DOOR

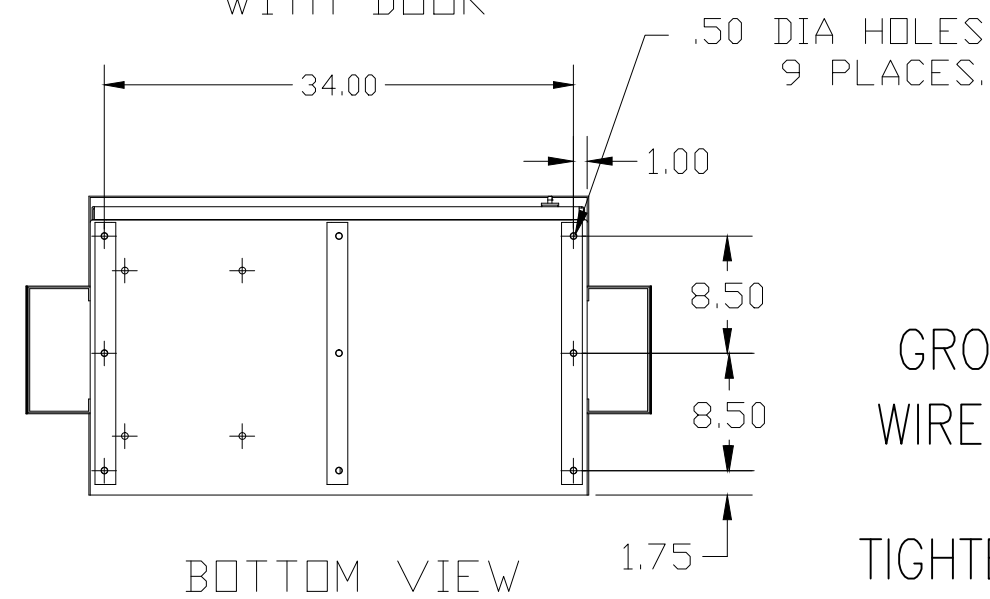

BOTTOM VIEW

FRONT VIEW WITHOUT DOOR



SUGGESTED CUSTOMER WIRE ENTRY AND EXIT LOCATION

SIDE VIEW

GROUND LUG:
WIRE RANGE—ONE 600MCM-4
TWO 250MCM-1/0
TIGHTENING TORQUE 500 IN-LB.

CUSTOMER CONNECTION OUTPUT:
WIRE RANGE—ONE 600MCM-4
TWO 250MCM-1/0
TIGHTENING TORQUE 500 IN-LB.

UNIT SPECIFICATIONS:					
KVAR	HARMONIC	VOLT	HZ	PHASE	HP
75	5TH	600	60	3	250
ENCLOSURE	TYPE 3R- COLOR WHITE				
APPROX.WT. LBS.	580				

TCI, LLC CLAIMS PROPRIETARY RIGHTS IN THE MATERIAL HEREIN DISCLOSED. IT IS SUPPLIED WITHOUT PREJUDICE TO ANY PATENT RIGHTS OF TCI AND MAY NOT BE REPRODUCED OR USED TO MANUFACTURE ANYTHING SHOWN THEREIN WITHOUT WRITTEN PERMISSION FROM TCI.

TOLERANCES (EXCEPT AS NOTED)				TCI® W132 N10611 Grant Drive Germantown, WI 53022	
DECIMAL	FRACTIONAL	ANGULAR	DRN. BY	DATE	DWG. NO.
.XX ±.12	± 1/32	± 1/2°	DSW	2/25/09	103644DG
.XXX±.06			SCALE	SIZE	SHT. 1 OF 1
			TO FIT	C	
Δ 2641 ADD EYEBOLTS	10/13/09	DSW			
NO REVISION	DATE	BY			