



CUSTOMER IS RESPONSIBLE FOR INSTALLATION
TO MEET ALL NATIONAL AND LOCAL ELECTRICAL CODES.

NOTE: USE ONLY HUBS OR FITTINGS THAT COMPLY
WITH UL514B FOR TYPE 3R ENCLOSURES.







SEE DWG# 26900 FOR SCHEMATIC

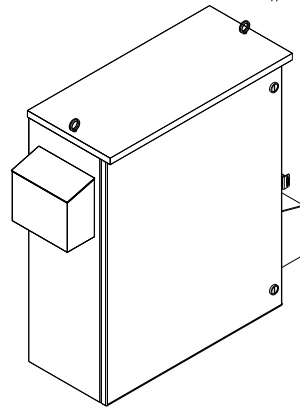

SIDE VIEW

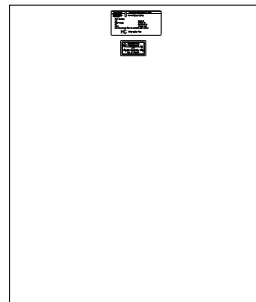


INSIDE DOOR

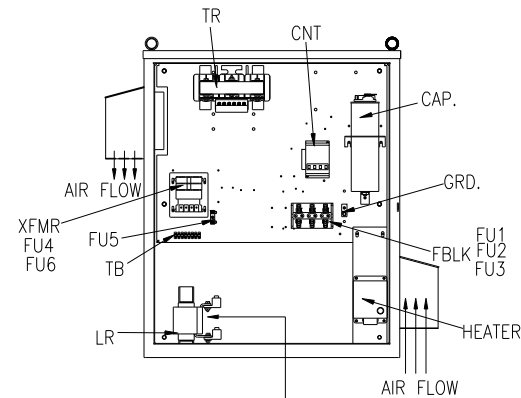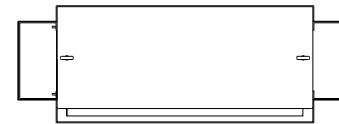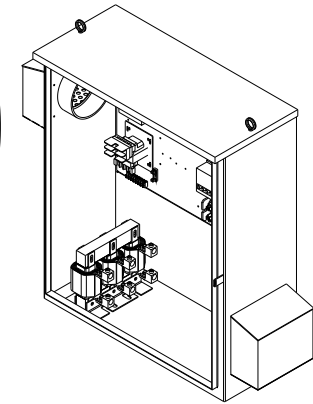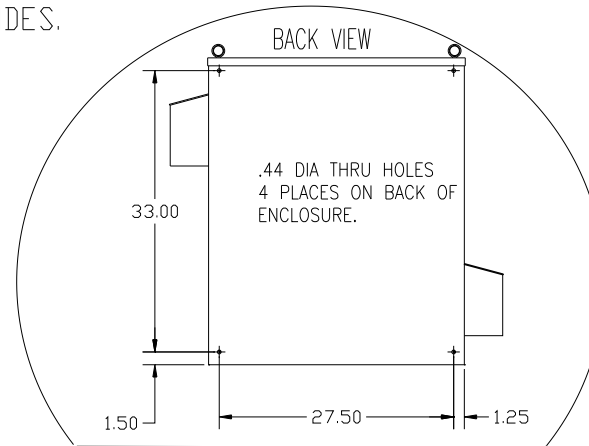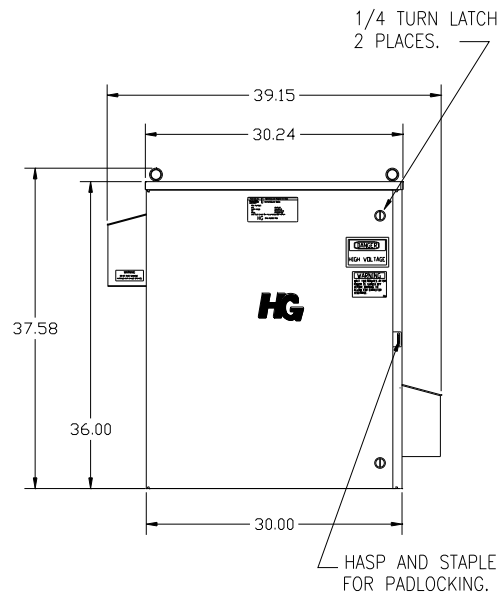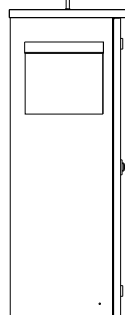

L1 L2 L3 T1 T2 T3

SUGGESTED CUSTOMER WIRE ENTRY
AND EXIT LOCATION

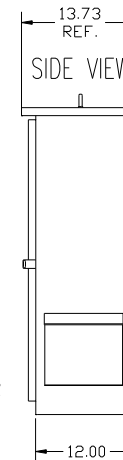

CUSTOMER CONNECTIONS


L1 L2 L3 T1 T2 T3

AND GROUND LUG.

WIRE SIZE (AWG)	RATED TORQUE (IN-LBS)
2/0-3	50
4-6	45
8	40
10-14	35

UNIT SPECIFICATIONS:					
KVAR HARMONIC	VOLT	HZ	PHASE	HP	
10 5TH	240	60	3	30	
ENCLOSURE	UL TYPE 3R				
COLOR	WHITE				
FEATURES	CONTACTOR				
APPROX.WT. LBS.	200				

HG30BW03STC		
COMPONENTS		
LINE REACTOR	LR	X
TRAP REACTOR	TR	X
CAPACITOR	CAP	X
TRAP FUSING	FU1,2,3	X
XFMR		X
XFMR	FU4,6	X
XFMR	FU5	X
CNT		X

						TOLERANCES (EXCEPT AS NOTED)		 7878 N. 86th STREET MILWAUKEE, WI 53224	
						DECIMAL			
						.XX ± .12 .XXX± .03			
						FRACTIONAL ± 1/32			
C 3033 UPDATE LAYOUT				2/24/14	DSW	HG30BW03STC, 30HP 240/3/60 UL TYPE 3R			
NO	REVISION	DATE	BY	ANGULAR ± 1/2°	SCALE TO FIT	DRN. BY DSW	DATE 12/22/08	DWG. NO. C 103714DG	
						APRVD	SHT. 1 OF 1		