


SEE DWG# 26972-2 FOR SCHEMATIC


CUSTOMER IS RESPONSIBLE FOR INSTALLATION TO MEET ALL NATIONAL AND LOCAL ELECTRICAL CODES.

NOTE: USE ONLY HUBS OR FITTINGS THAT COMPLY WITH UL514B FOR TYPE 3R ENCLOSURES.



UNIT SPECIFICATIONS:					
KVAR	HARMONIC	VOLT	HZ	PHASE	HP
105	5TH	600	60	3	350
ENCLOSURE		TYPE 3R- COLOR, WHITE			
APPROX.WT. LBS		956			

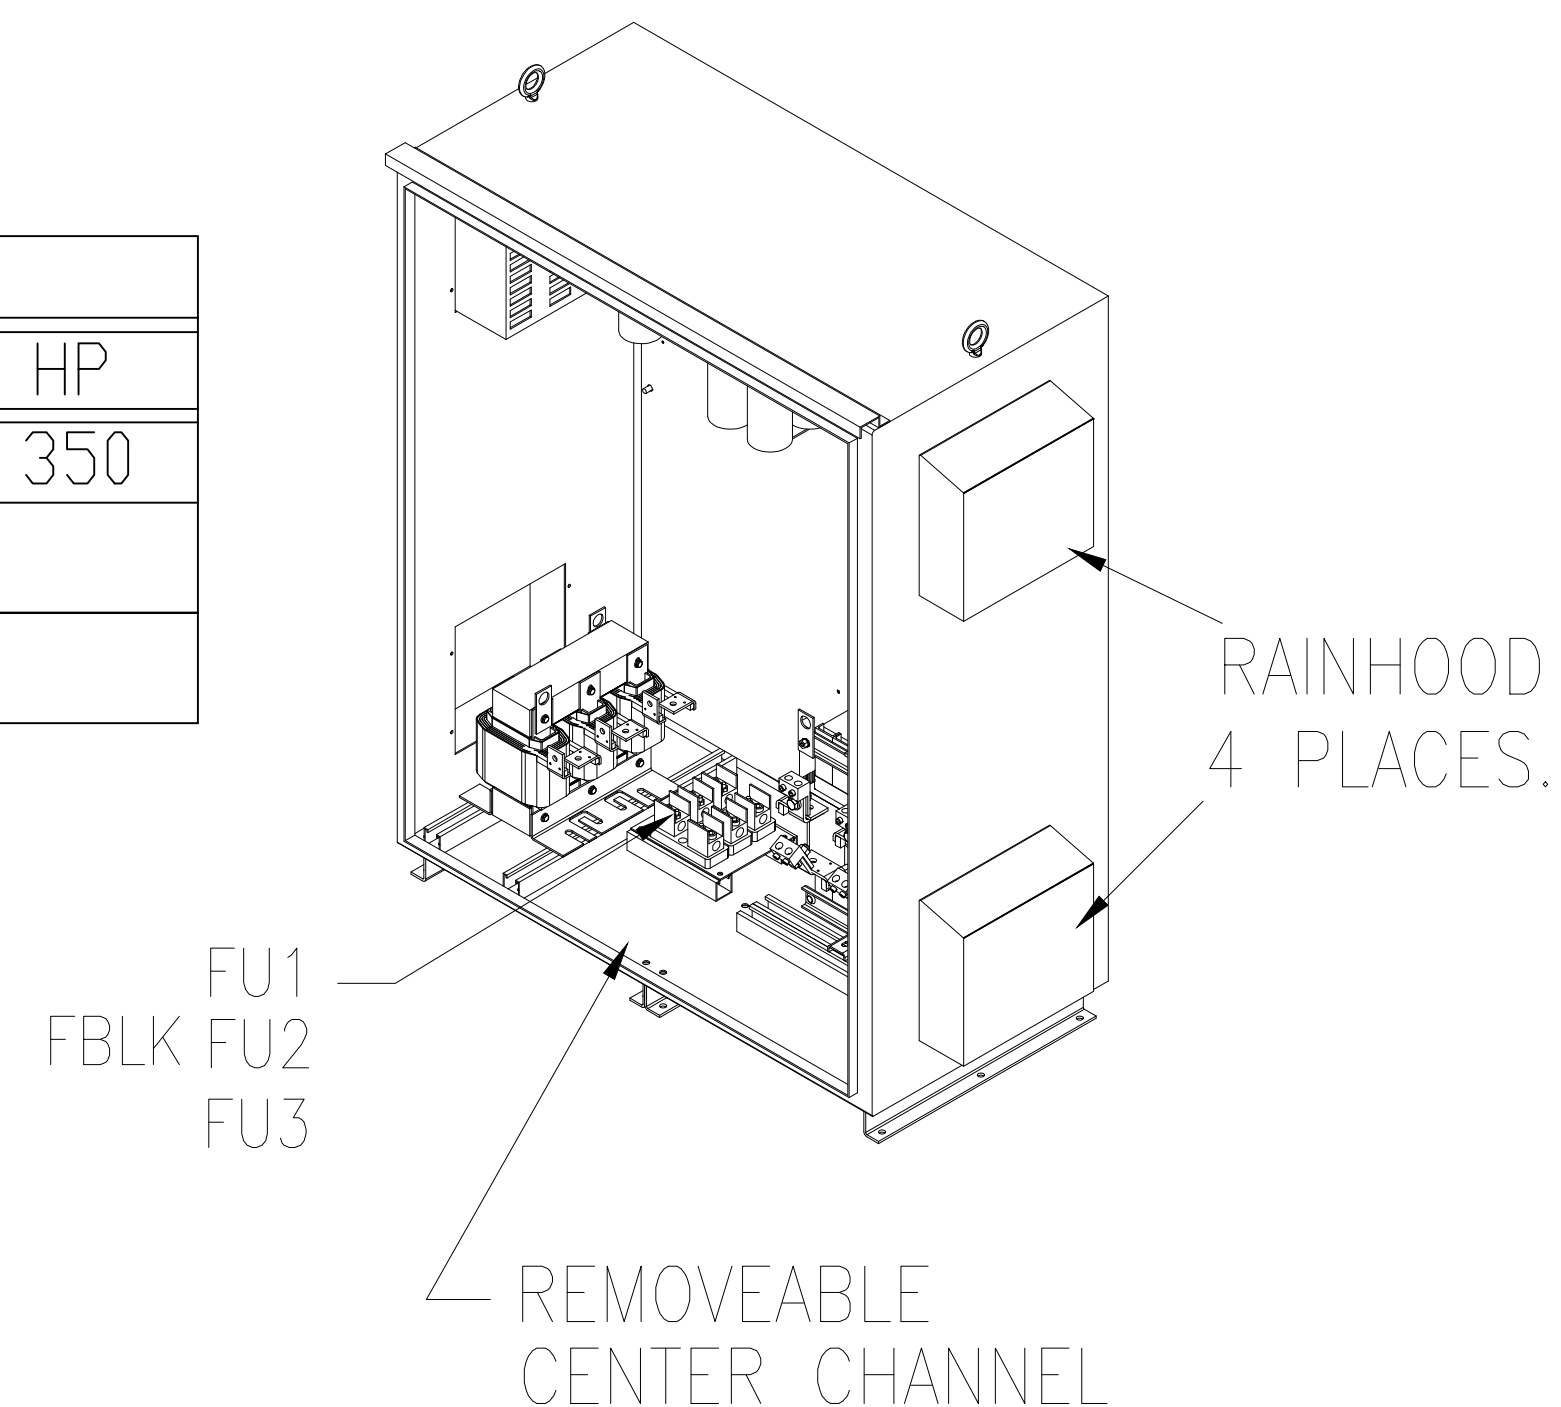

INSIDE DOOR


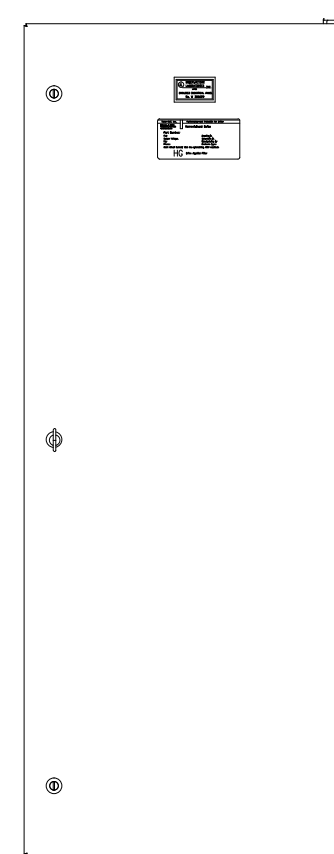


SIDE VIEW

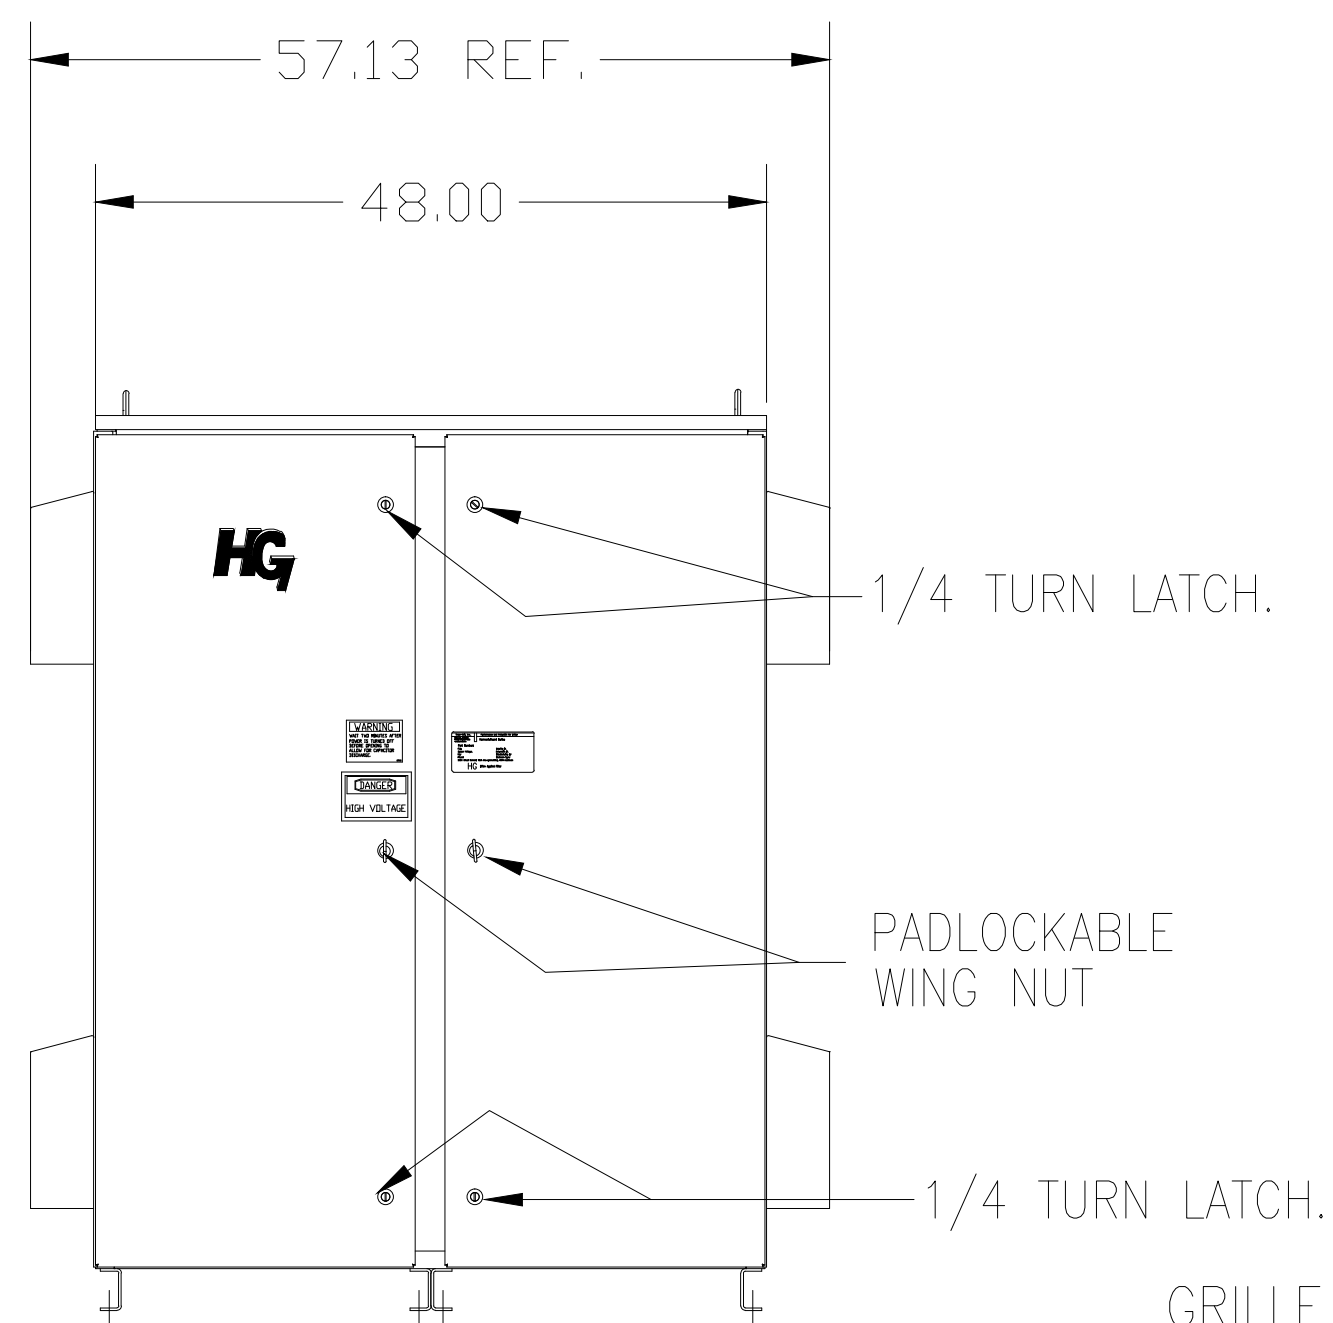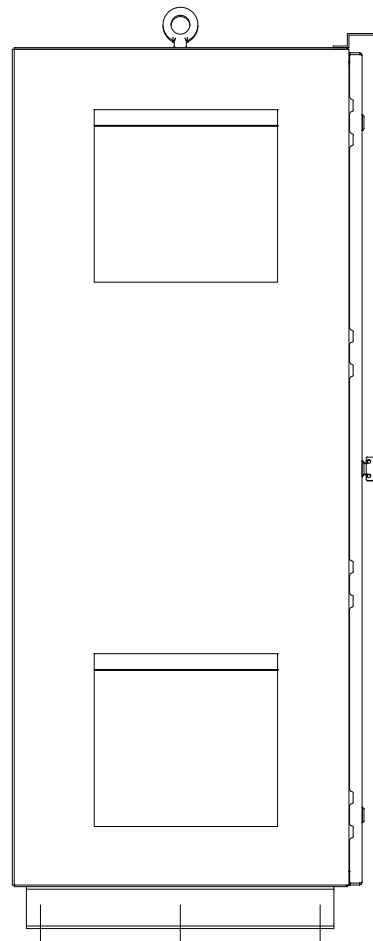

FRONT VIEW WITH DOORS.

FRONT VIEW WITHOUT DOORS

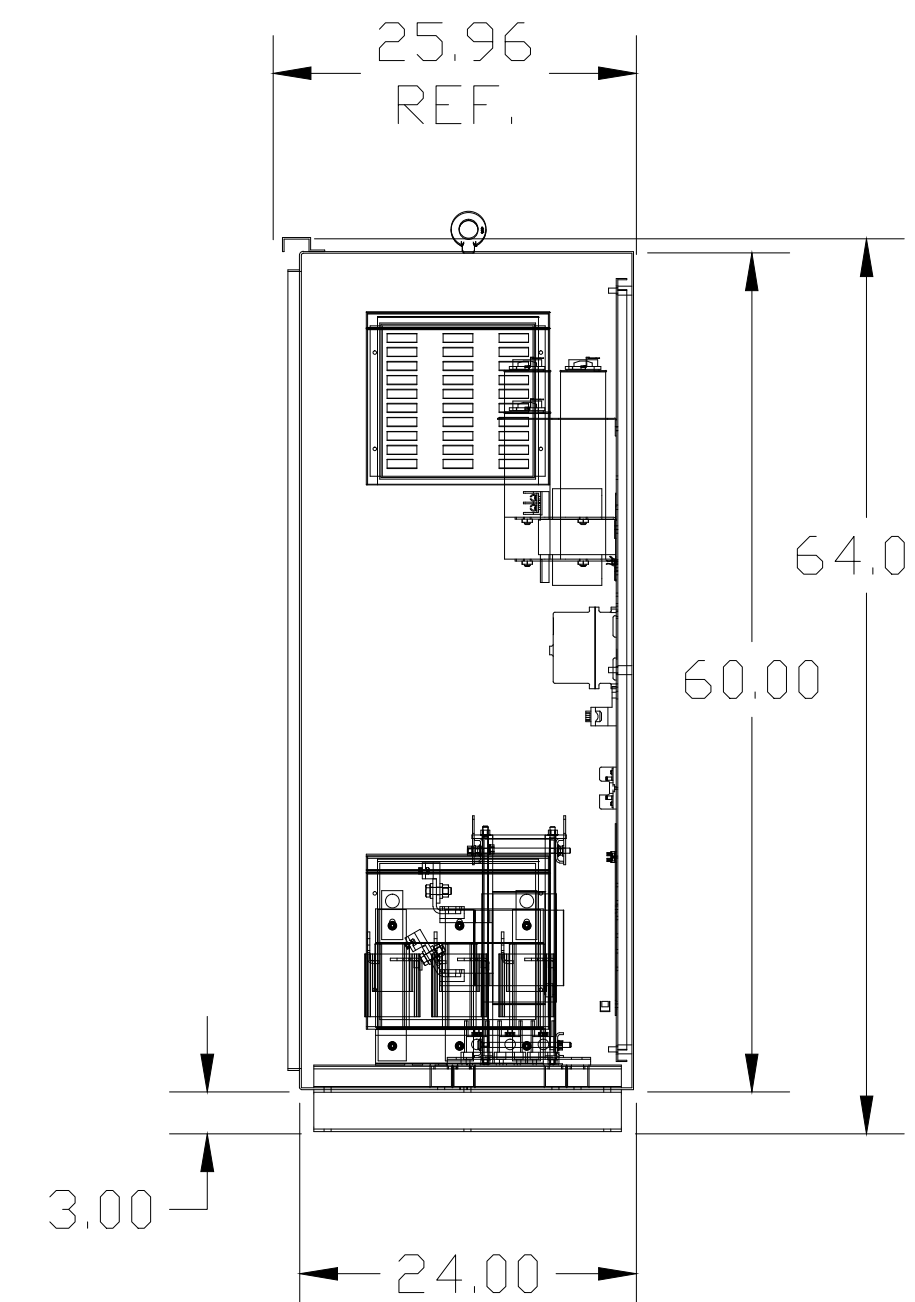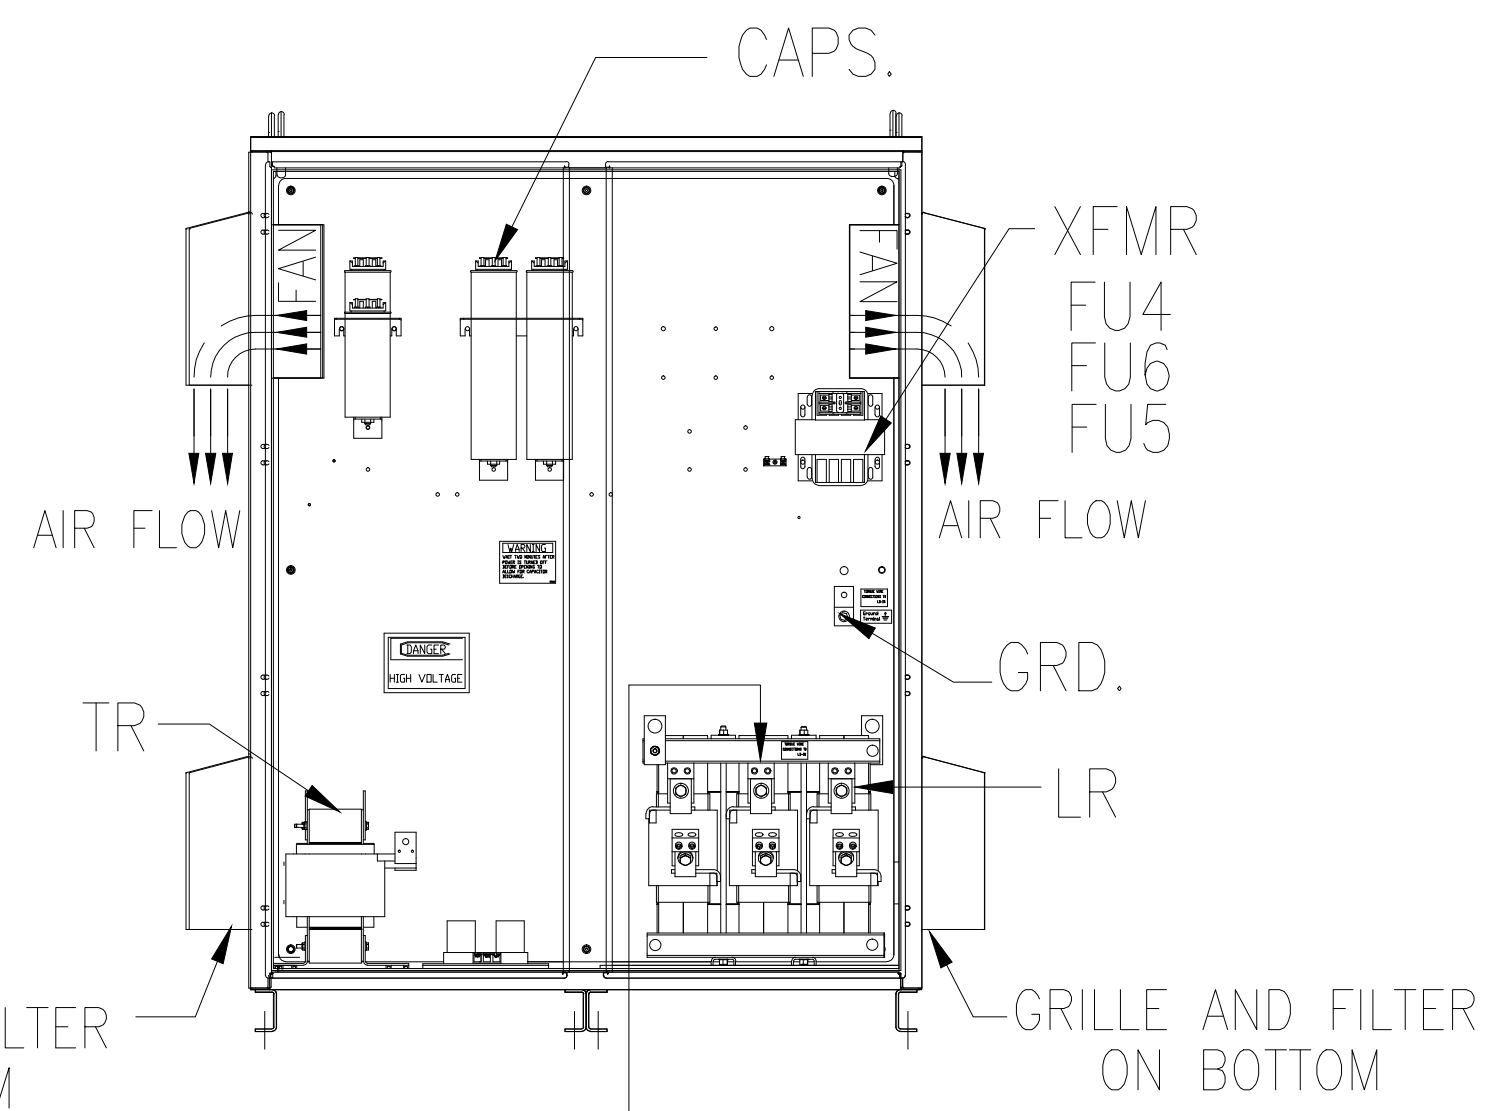


SIDE VIEW

SYMBOL	TCI PART NUMBER
LR	KDRX42T
TR	KTR105C65HG
(15 KVAR) 1 PLACE.	KCAP15C6B
(20 KVAR) 4 PLACES.	KCAP20C6B
(10 KVAR) 1 PLACE.	KCAP10C6B
XFMR.	24389
Fu1;2;3	13333
Fu4,6	13697
Fu5	16987

L1 L2 L3 T1 T2 T3

SUGGESTED CUSTOMER WIRE ENTRY AND EXIT LOCATION

.50 DIA HOLES 12 PLACES.

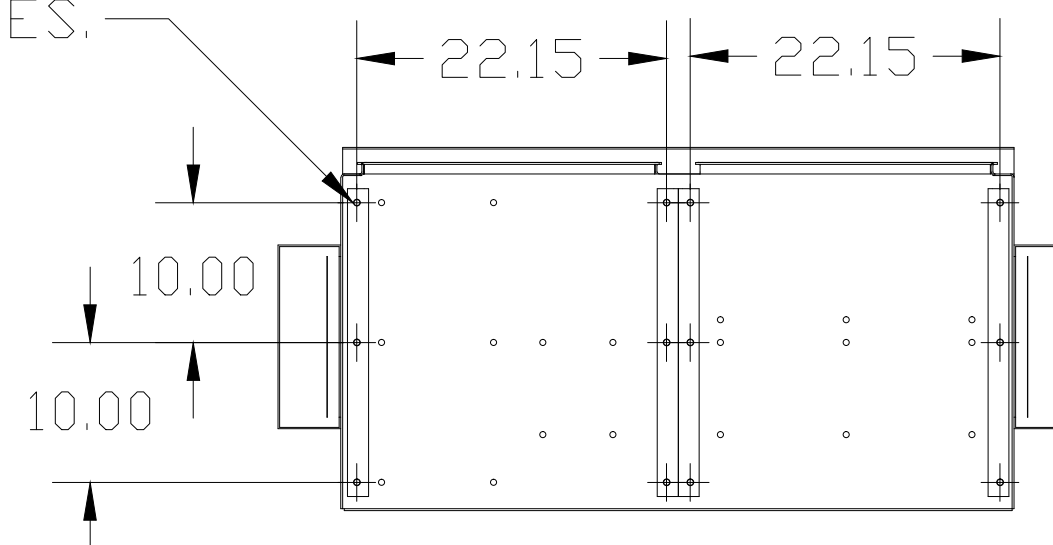

BOTTOM VIEW

GROUND LUG:
WIRE RANGE—ONE 600MCM—4
TWO 250MCM—1/0
TIGHTENING TORQUE 500 IN—LB.

CUSTOMER INPUT/OUTPUT CONNECTIONS:
WIRE RANGE—TWO 350MCM—4
TIGHTENING TORQUE 275 IN—LB.

<small>TCI, LLC CLAIMS PROPRIETARY RIGHTS IN THE MATERIAL HEREIN DISCLOSED. IT IS SUPPLIED WITHOUT PREJUDICE TO ANY PATENT RIGHTS OF TCI AND MAY NOT BE REPRODUCED OR USED TO MANUFACTURE ANYTHING SHOWN THEREIN WITHOUT WRITTEN PERMISSION FROM TCI.</small>	TOLERANCES (EXCEPT AS NOTED)	DECIMAL	.XX ±.12
	FRACTIONAL	.XXX ±.06	± 1/32
	ANGULAR	± 1/2°	
NO	REVISION	DATE	BY
		SCALE TO FIT	SIZE D
<small>TCI W132 N10611 Grant Drive Germantown, WI 53022</small>			HG350CW03ST, 350HP 600/3/60 UL TYPE 3R
DRW BY	DATE	DWG NO.	103646DG
DSW	2/18/09		
SHT. 1			DF 1