



UL REQUIRED SHIELD

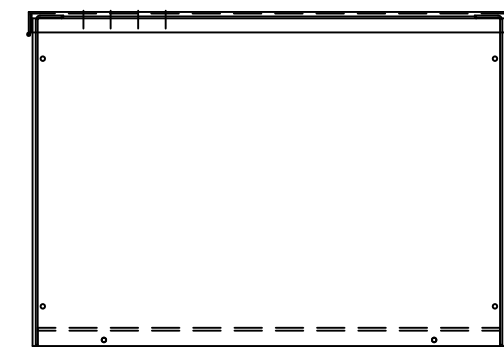

UNIT SPECIFICATIONS:						
KVAR	HARMONIC	VOLT	HZ	PHASE	HP	
15	5TH	600	60	3	40	
ENCLOSURE		NEMA 1				
OPTIONS		WITH CONTACTOR				
APPROX.WT. LBS.		185				

SYMBOL	TCI PART NUMBER
LR	KDRI41T
TR	KTR15C65HG
CAP	KCAP15C6B
XFMR.	24385
Fu1, 2, 3	11307
Fu4,6	24126
Fu5	13364
CNT	23021

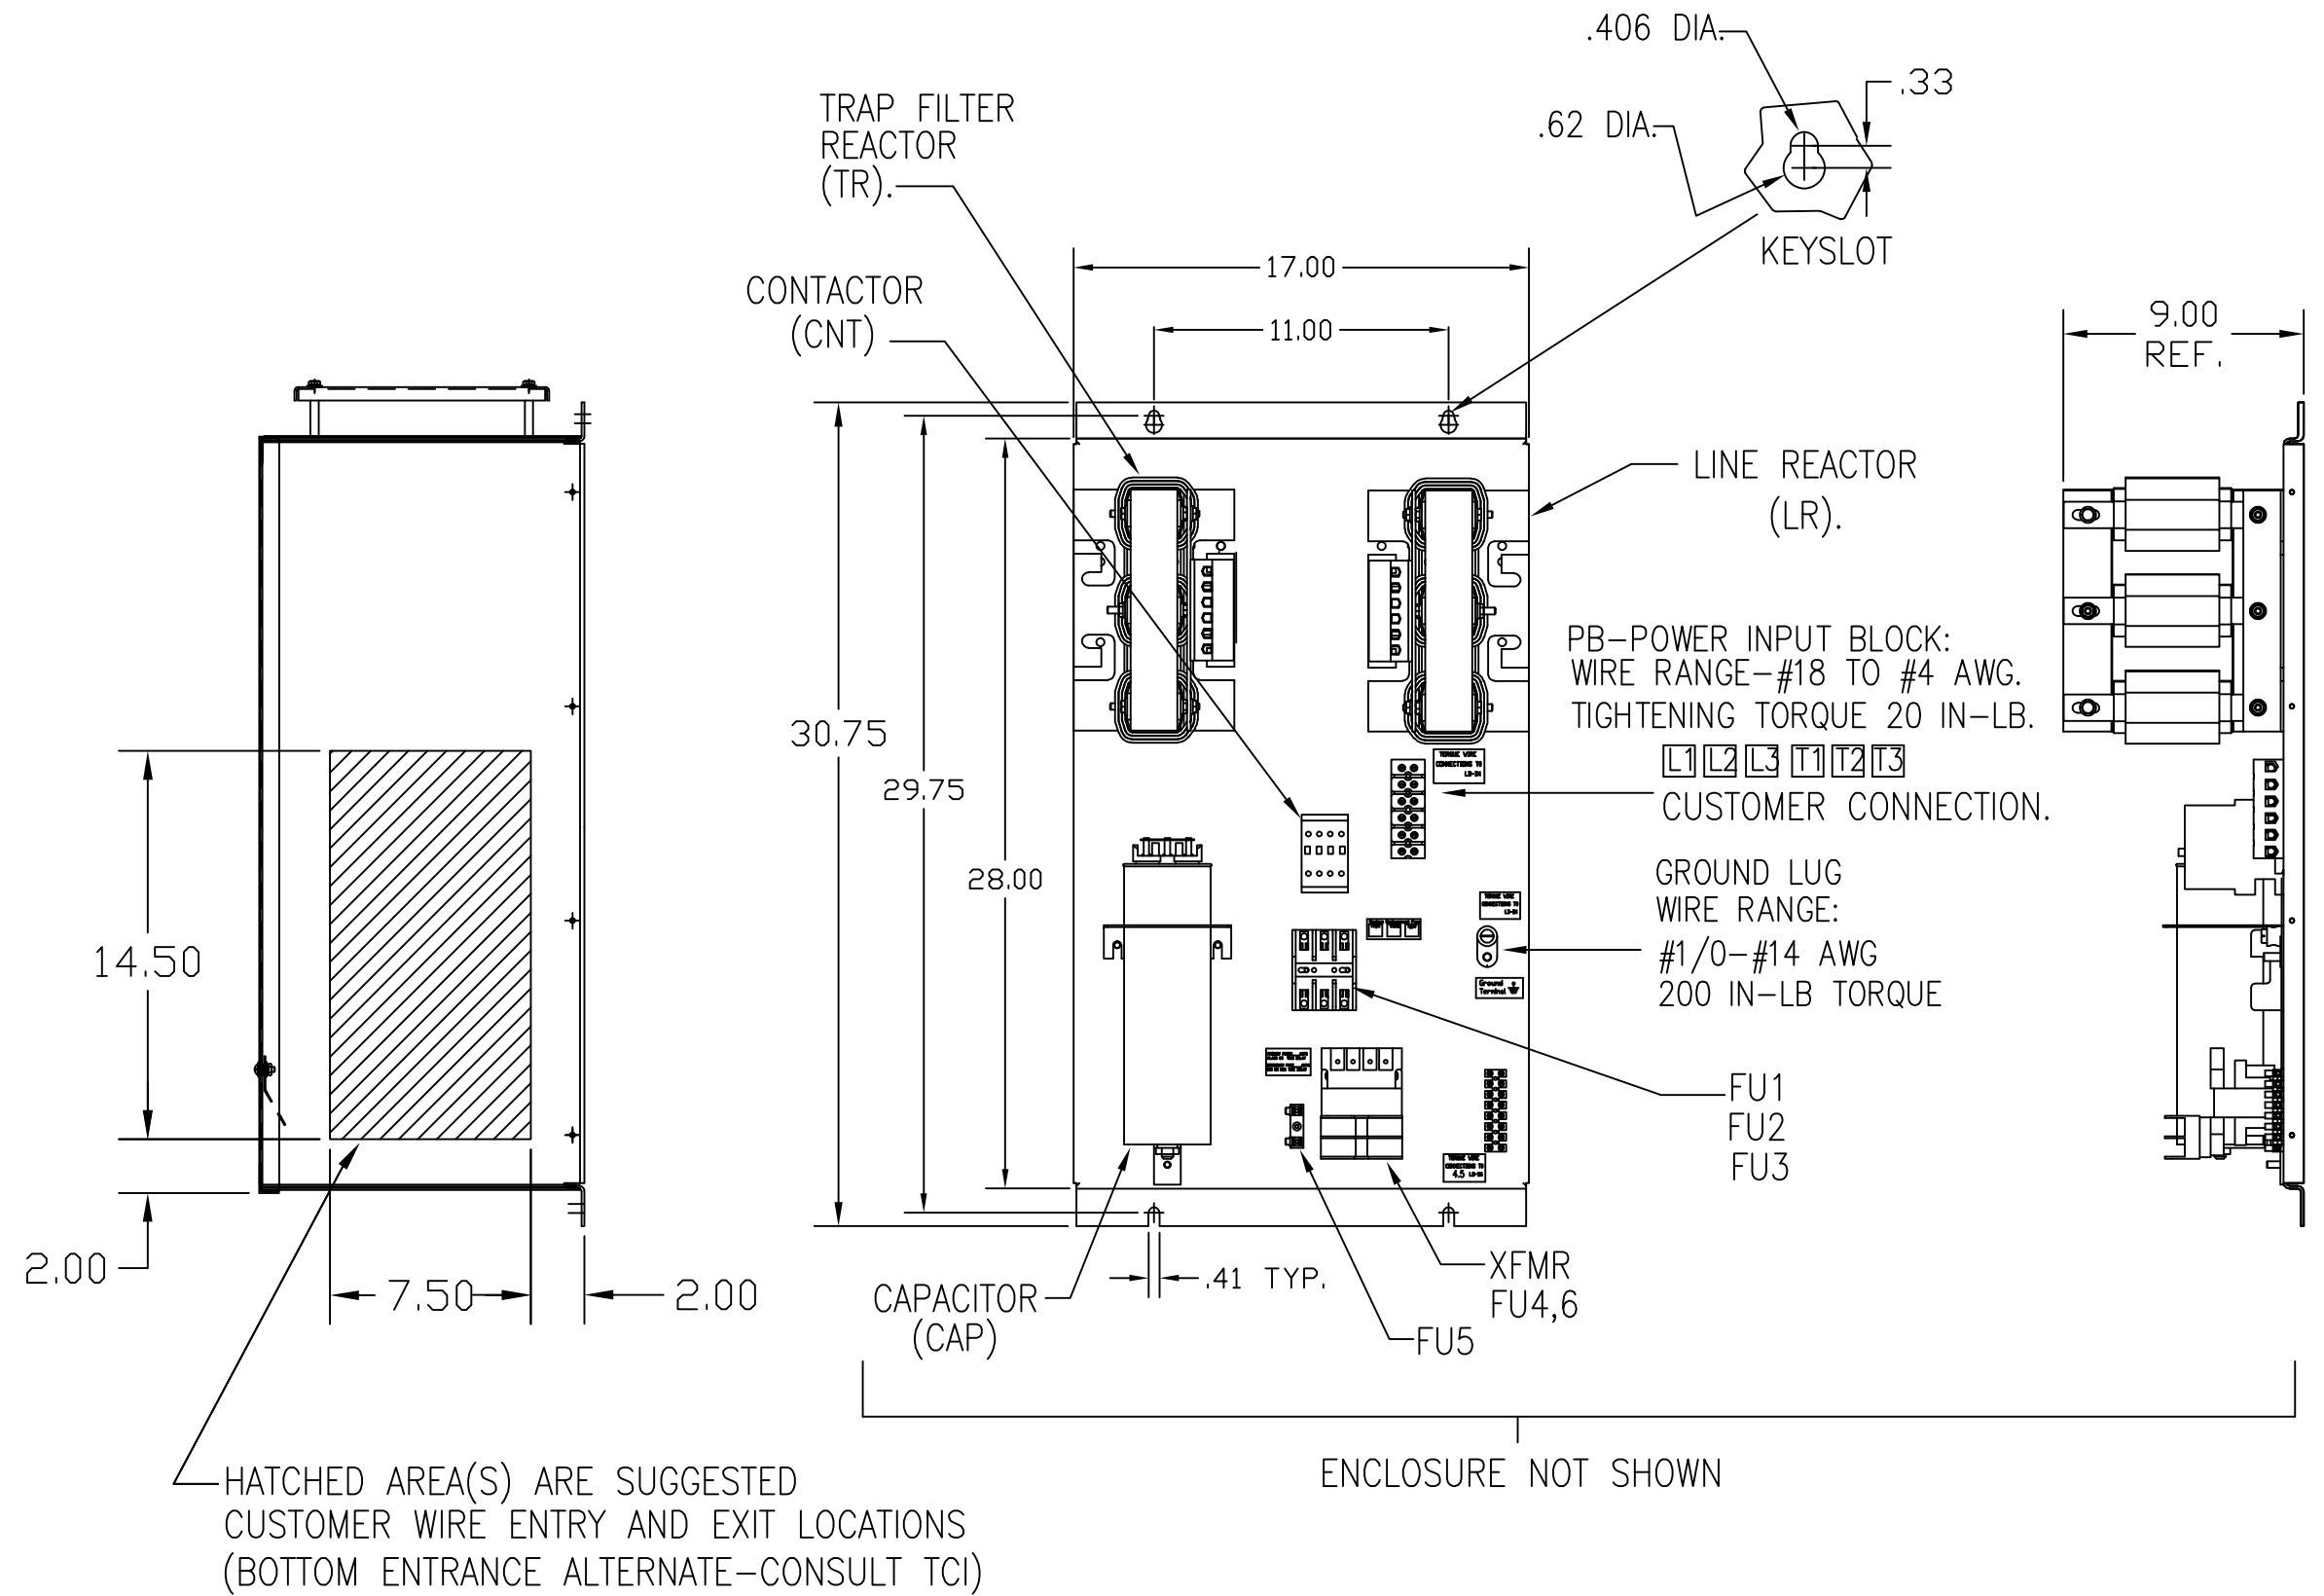

SEE DWG #26878 FOR SCHEMATIC
CUSTOMER IS RESPONSIBLE FOR INSTALLATION
TO MEET ALL NATIONAL AND LOCAL ELECTRICAL CODES.

				TOLERANCES (EXCEPT AS NOTED):		W132 N10611 Grant Drive Germantown, WI 53022	
				DECIMAL			
				.XX ± .03		HG40CW01STC 40HP 600/3/60, ENCLOSED, WITH CNT	
				.XXX ± .01			
				FRACTIONAL		DRN. BY DSW DATE 11/12/08 DWG. NO. 103550DG SCALE TO FIT APRVD. C	
				± 1/32			
A	2702	REVISED SHIELDS		1/26/12	RJC	SHT. 1 OF 1	
NO		REVISION		DATE	BY		