



UNIT SPECIFICATIONS:						
KVAR	HARMONIC	VOLT	HZ	PHASE	HP	
135	5TH	480	60	3	450	
OPEN		WHITE PANEL				
APPROX.WT. LBS.		685				
SYMBOL	TCI PART NUMBER					
LR	KDRX4T					
TR	KTR135A65HG					
CAP1-6 (20KVAR)	27609					
CAP7 (15KVAR)	27608					
Fu1, 2, 3	12462					
ALTERNATE	TCI PART NUMBER					
CAP1-6 (20KVAR)	KCAP20A6B					
CAP7 (15KVAR)	KCAP15A6B					

SEE 25078 FOR SCHEMATIC



CUSTOMER CONNECTIONS:
 WIRE RANGE-TWO 600MCM-2
 TIGHTENING TORQUE 500 IN.-LB.
 GROUND LUG:
 WIRE RANGE-TWO 600MCM-2
 TIGHTENING TORQUE 500 IN.-LB.

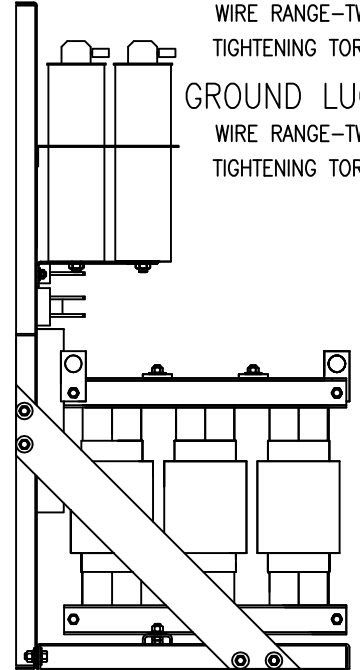

TRAP
 FILTER
 FUSING
 Fu1, 2, 3

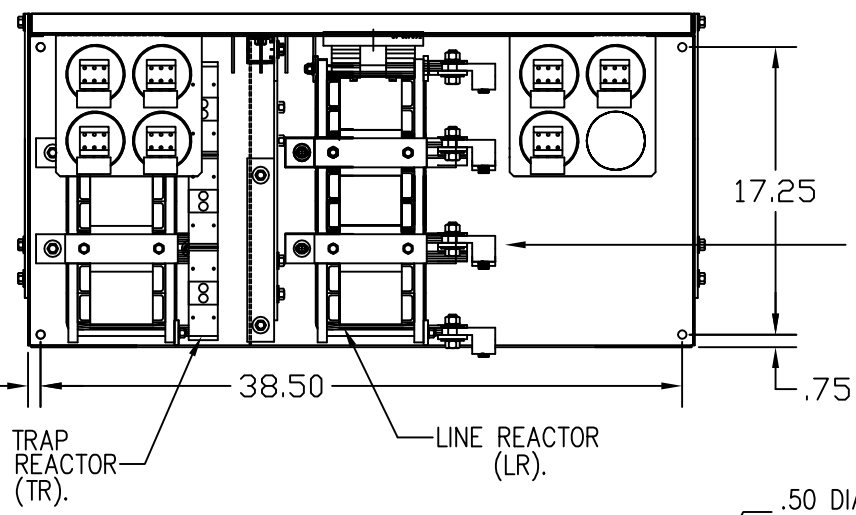

CUSTOMER CONNECTIONS:
 L1 L2 L3
 T1 T2 T3

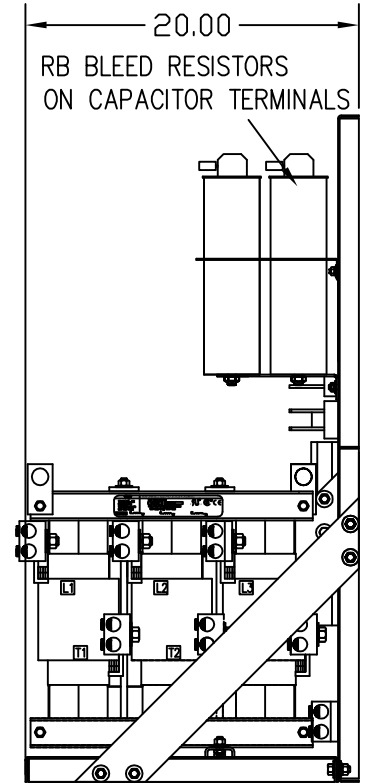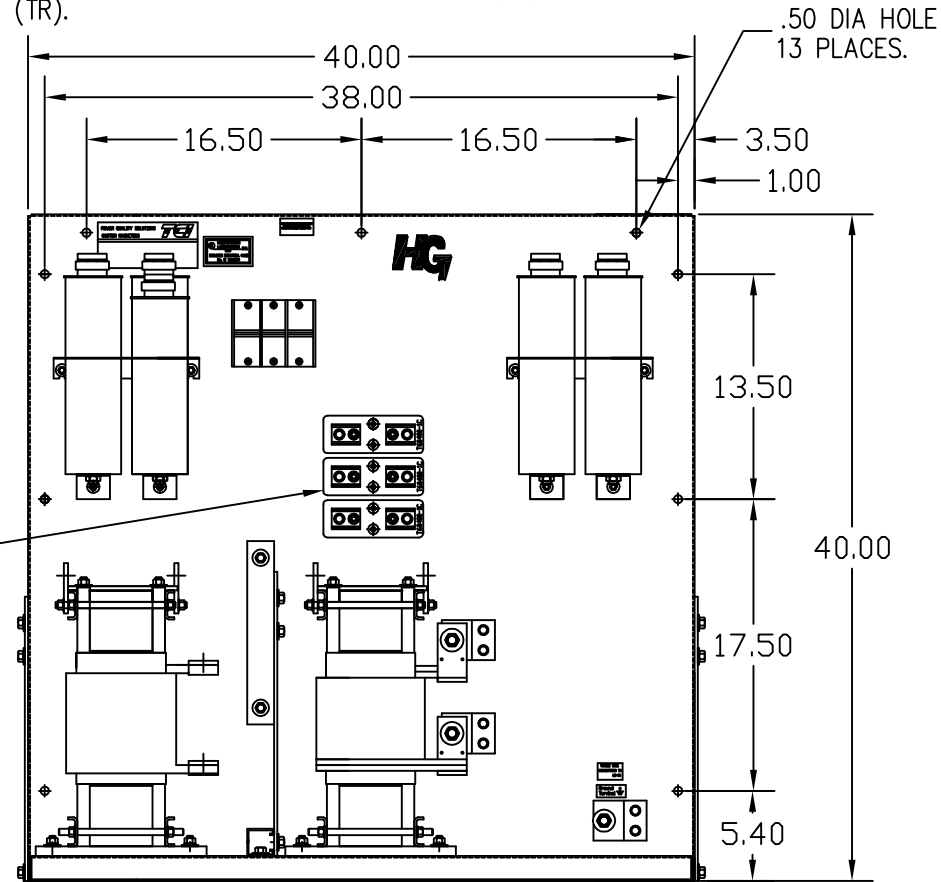

CUSTOMER IS RESPONSIBLE FOR PROPER COOLING OF FILTER COMPONENTS. CAPACITORS MAXIMUM AMBIENT 50°C

CUSTOMER IS RESPONSIBLE FOR INSTALLATION TO MEET ALL NATIONAL AND LOCAL ELECTRICAL CODES.

				TOLERANCES EXCEPT AS NOTED:		TCI 7878 N. 86th STREET MILWAUKEE, WI 53224	
				DECIMAL			HG450AW00ST HG7 STANDARD 450HP, 480/3/60 OPEN
C	2920 ASC CAP CHANGE	10/10/13	MJS	.XX ±.03			
B	Updated Reactor to 135	8/28/11	RJC	.XXX±.01			
	Rvsd view of caps			FRACTIONAL ± 1/32			
A	2516, CAP WAS 23123			ANGULAR ± 1/2°			
	CAP WAS 16448	9/30/07	RJC				
NO	REVISION	DATE	BY			SCALE TO FIT	