
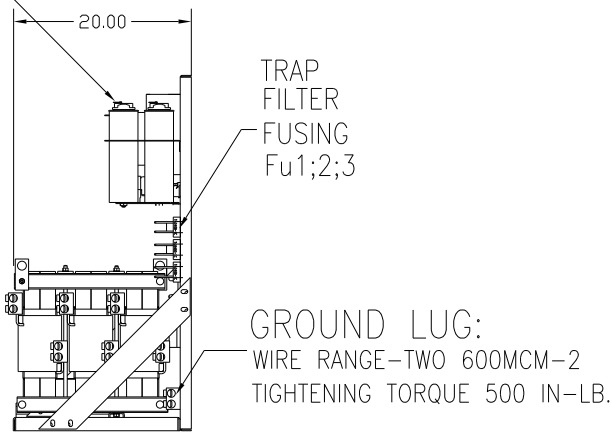
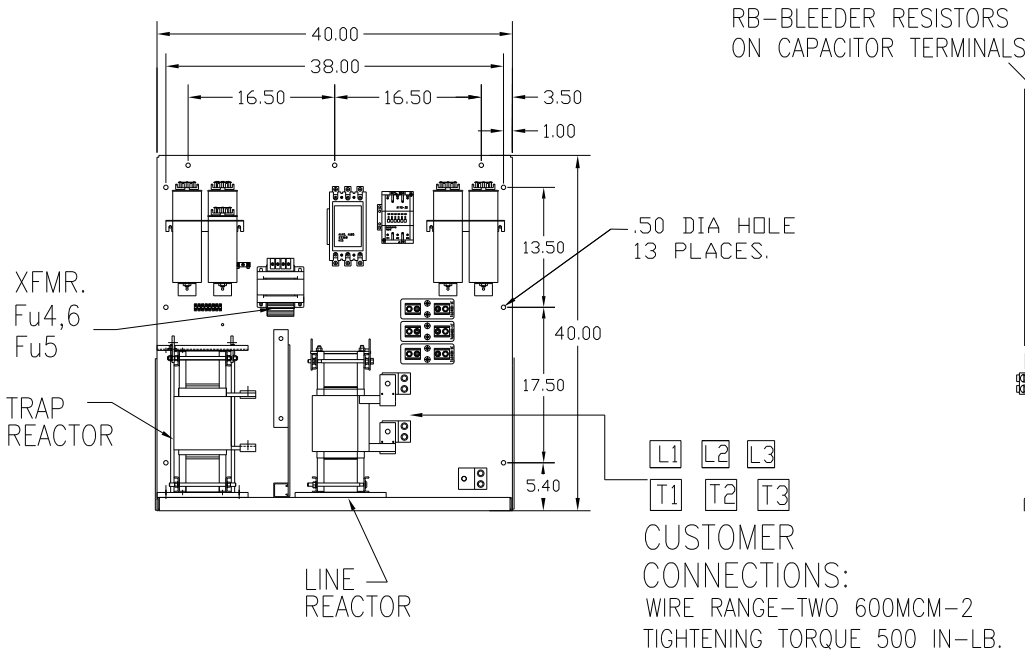


UNIT SPECIFICATIONS:					
KVAR	HARMONIC	VOLT	HZ	PHASE	HP
135	5TH	480	60	3	450
ENCLOSURE		WHITE OPEN PANEL			
APPROX.WT. LBS.		690			

FOR SCHEMATIC SEE DWG# 26690

SYMBOL	TCI PART NUMBER
LR	KDRX4T
TR	KTR135A65HG
CAP 1-6. (20 KVAR)	KCAP20A6B
CAP 7 (15KVAR)	KCAP15A6B
CONTACTOR	23368
CONTACTOR	19246
XFMR.	23899
Fu1a;2a;3a	13232
Fu4,6	14106
Fu5	23977

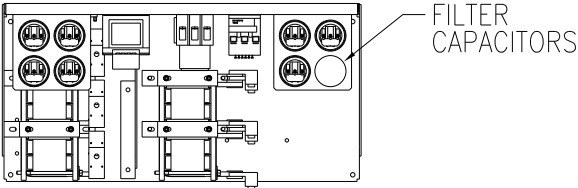

CUSTOMER IS RESPONSIBLE FOR PROPER COOLING OF FILTER COMPONENTS. CAPACITORS MAXIMUM AMBIENT 50°C PC BOARD MAX. AMBIENT 40°C.

CUSTOMER IS RESPONSIBLE FOR INSTALLATION TO MEET ALL NATIONAL AND LOCAL ELECTRICAL CODES.

				TOLERANCES (EXCEPT AS NOTED):		 7878 N. 86th STREET MILWAUKEE, WI 53224	
B	Updated reactor to 135 kvar			DECIMAL			
	was (2) 145 contactors			.XX ± .03		HG450AW00STC HG7, W/CNT 450HP, 480/3/60 OPEN	
	revised view of caps,fuseblock	8/29/11	RJC	.XXX±.01			
A	2702 REVISED LAYOUT & RVSD FUSEBLK & FUSE	9/2/10	RJC	FRACTIONAL ± 1/32			
				ANGULAR ± 1/2°		DRN BY DSW	DATE 08/04/08
NO	REVISION	DATE	BY	SCALE TO FIT	APPRV	DWG NO C 103542DG	SHT. 1 OF 1