
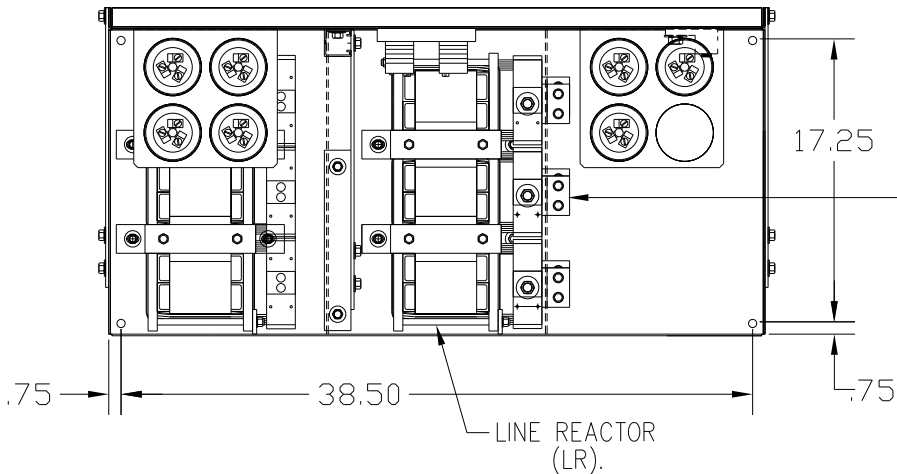


UNIT SPECIFICATIONS:					
KVAR	HARMONIC	VOLT	HZ	PHASE	HP
135	5TH	600	60	3	450
ENCLOSURE		WHITE OPEN PANEL			
APPROX.WT. LBS.		725			
SYMBOL		TCI PART NUMBER			
LR		KDRX44T			
TR		KTR135C65HG			
CAP1-6 (20KVAR)		KCAP20C6B			
CAP7 (15KVAR)		KCAP15C6B			
Fu1, 2, 3		12462			



SEE 25115 FOR SCHEMATIC

CUSTOMER CONNECTIONS:
WIRE RANGE-TWO 600MCM-2
TIGHTENING TORQUE 500 IN-LB.

GROUND LUG:
WIRE RANGE-TWO 600MCM-2
TIGHTENING TORQUE 500 IN-LB.

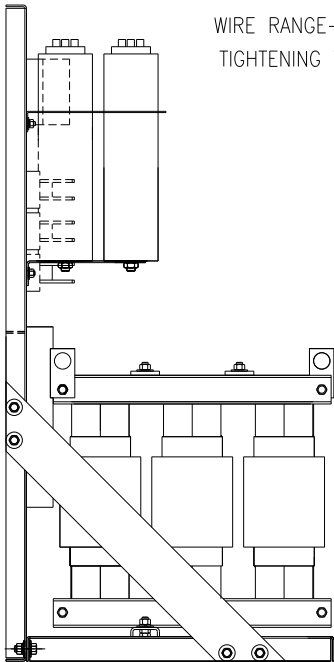

CUSTOMER CONNECTIONS:
L1 L2 L3
T1 T2 T3

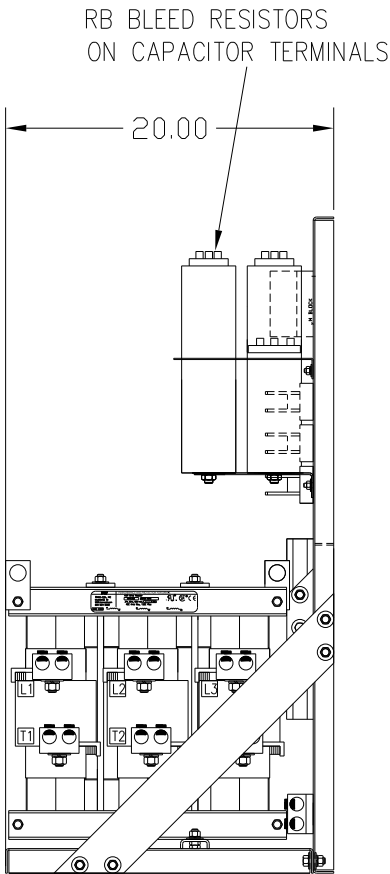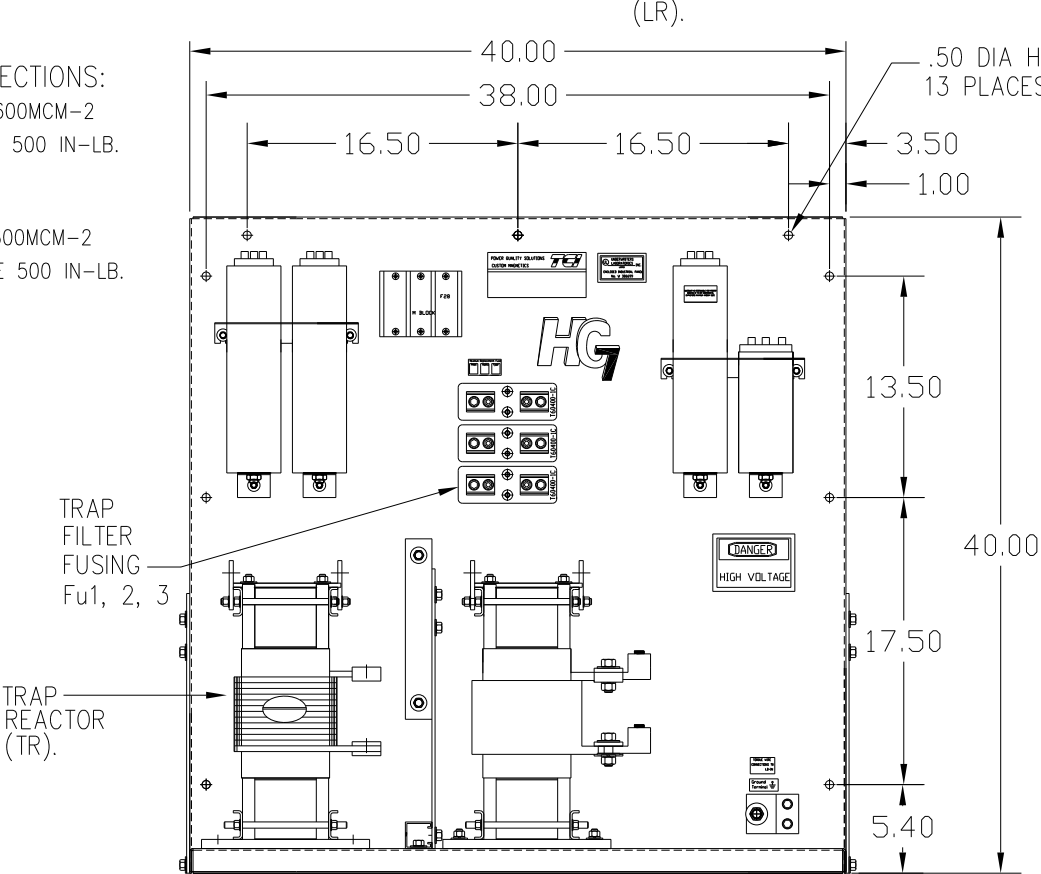

CUSTOMER IS RESPONSIBLE FOR PROPER
COOLING OF FILTER COMPONENTS.
CAPACITORS MAXIMUM AMBIENT 50°C
CUSTOMER IS RESPONSIBLE FOR INSTALLATION
TO MEET ALL NATIONAL AND LOCAL ELECTRICAL CODES.

B	WAS 150 KVAR, 15KVAR 10 KVAR,UPDATED TRAP REACTOR, ADD DIST.BLK	CAP WAS	9/8/11	RJC	TOLERANCES (EXCEPT AS NOTED):	
					DECIMAL	.XX ±.03 .XXX±.01
A	2516, CAP 1-7 WERE 18612 CAP 8 WAS 17816	1/2/08	RJC		FRACTIONAL	± 1/32
					ANGULAR	± 1/2°
NO	REVISION	DATE	BY			

		7878 N. 86th STREET MILWAUKEE, WI 53224	
HG450CW00ST HG7 STANDARD 450HP, 600/3/60 OPEN			
DRN BY	DSW	DATE	06/02/05
SCALE	TO FIT	APPROV	
DWG. NO.		102696DG	
		SHT. 1 OF 1	