


| UNIT SPECIFICATIONS: |          |        |    |       |    |
|----------------------|----------|--------|----|-------|----|
| KVAR                 | HARMONIC | VOLT   | HZ | PHASE | HP |
| 15                   | 5TH      | 480    | 60 | 3     | 50 |
| ENCLOSURE            |          | NEMA 1 |    |       |    |
| APPROX.WT. LBS.      |          | 185    |    |       |    |

| HG50AW01STC         |   |
|---------------------|---|
| COMPONENTS          |   |
| LINE REACTOR LR     | X |
| TRAP REACTOR TR     | X |
| CAPACITOR CAP       | X |
| TRAP FUSING FU1,2,3 | X |
| XFMR                | X |
| XFMR FU4,6          | X |
| CNT                 | X |

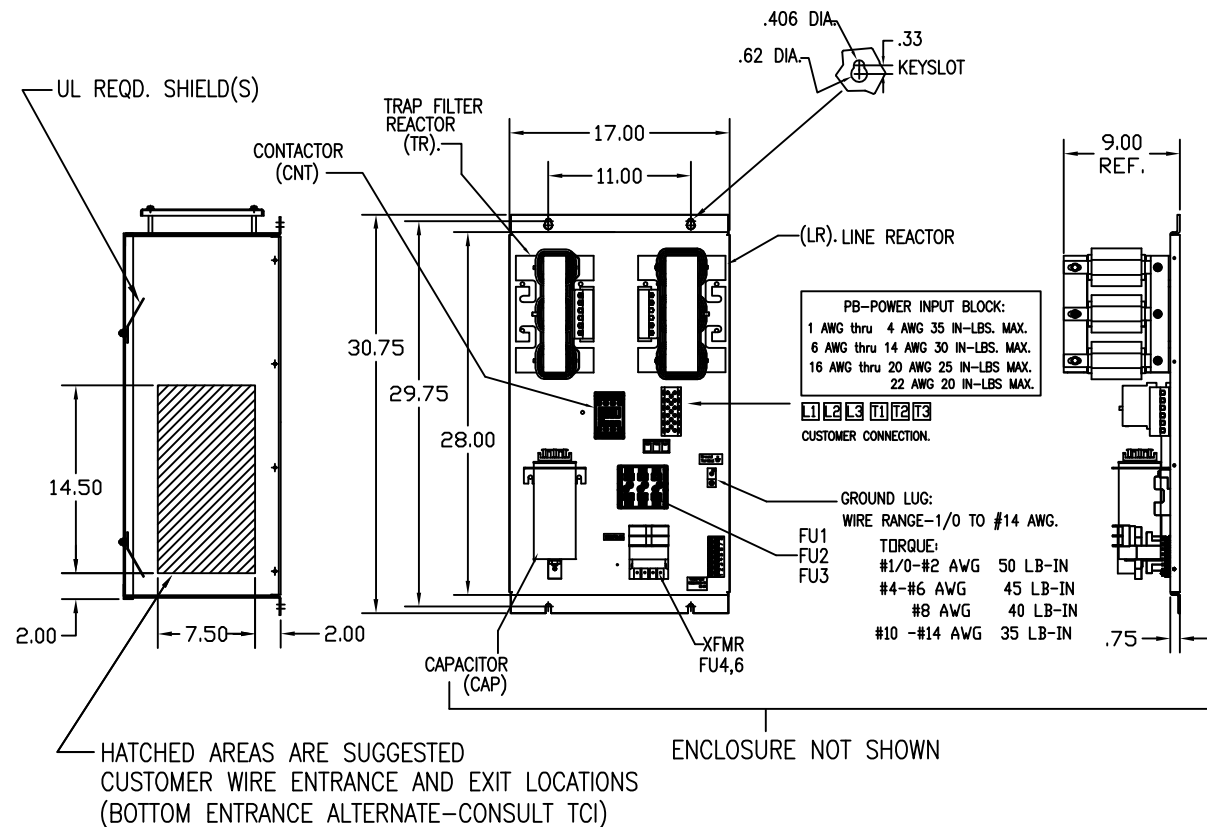

SEE DWG# 26689 FOR SCHEMATIC

CUSTOMER IS RESPONSIBLE FOR INSTALLATION TO MEET ALL NATIONAL AND LOCAL ELECTRICAL CODES.

|    |                       |         |     |                            |                                                                                                                                                                                                                                                                                         |
|----|-----------------------|---------|-----|----------------------------|-----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|
| G  | 3267 CONTACTOR CHANGE | 6/12/15 | BWM | TOLERANCES EXCEPT AS NOTED |  W132 N10611 GRANT DRIVE GERMANTOWN, WI. 53022<br><br><b>HG50AW01STC 50 HP</b><br><b>480/3/60, ENCLOSED, WITH CNT</b><br>DRN BY DSW DATE 7/7/08 DWG. NO. 103507DG<br>SCALE TO FIT APRVD. SHT.1 OF1 |
| F  | 3014 FBLK CHG         | 1/24/14 | BMZ | DECIMAL                    |                                                                                                                                                                                                                                                                                         |
| E  | 2900 CHG TO ASC CAPS  | 3/15/13 | DSW | .XX ± .03                  |                                                                                                                                                                                                                                                                                         |
| D  | CHG BACK TO VISHAY    | 6/30/11 | DSW | .XXX± .01                  |                                                                                                                                                                                                                                                                                         |
| C  | 2722 ASC CAP TRIAL    | 3/15/11 | DSW | FRACTIONAL ± 1/32          |                                                                                                                                                                                                                                                                                         |
| B  | REVSD GRD LUG SPECS   | 3/11/11 | RJC | ANGULAR ± 1/2°             |                                                                                                                                                                                                                                                                                         |
| NO | REVISION              | DATE    | BY  |                            |                                                                                                                                                                                                                                                                                         |