
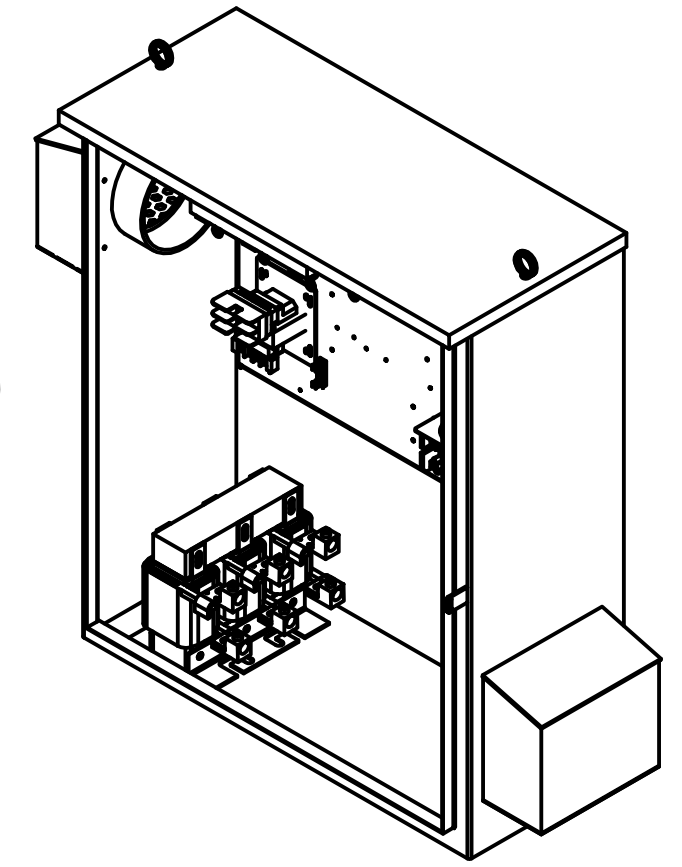
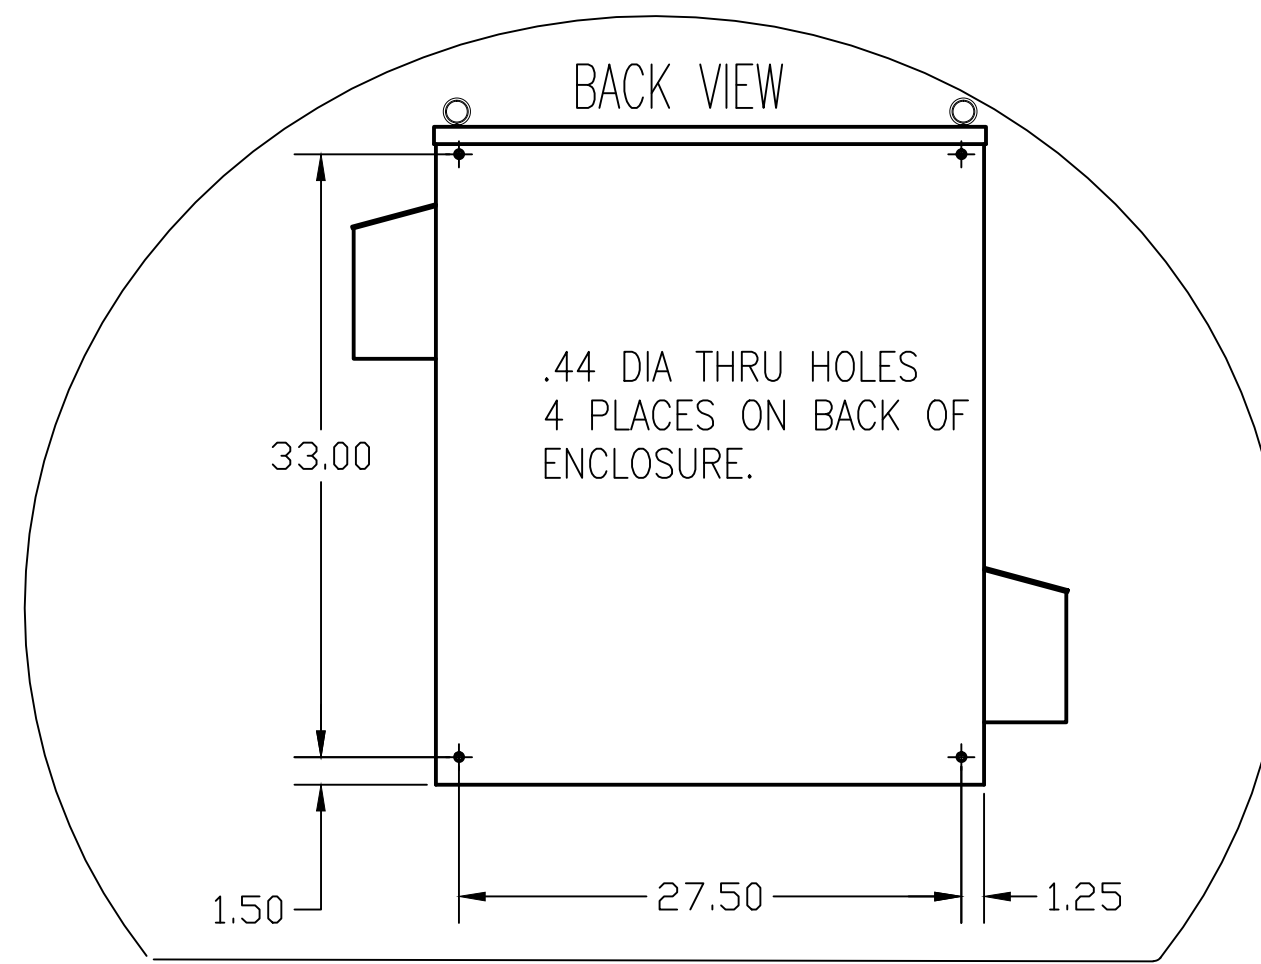





CUSTOMER IS RESPONSIBLE FOR INSTALLATION TO MEET ALL NATIONAL AND LOCAL ELECTRICAL CODES.

NOTE: USE ONLY HUBS OR FITTINGS THAT COMPLY WITH UL514B FOR TYPE 3R ENCLOSURES.


SEE DWG# 26902 FOR SCHEMATIC

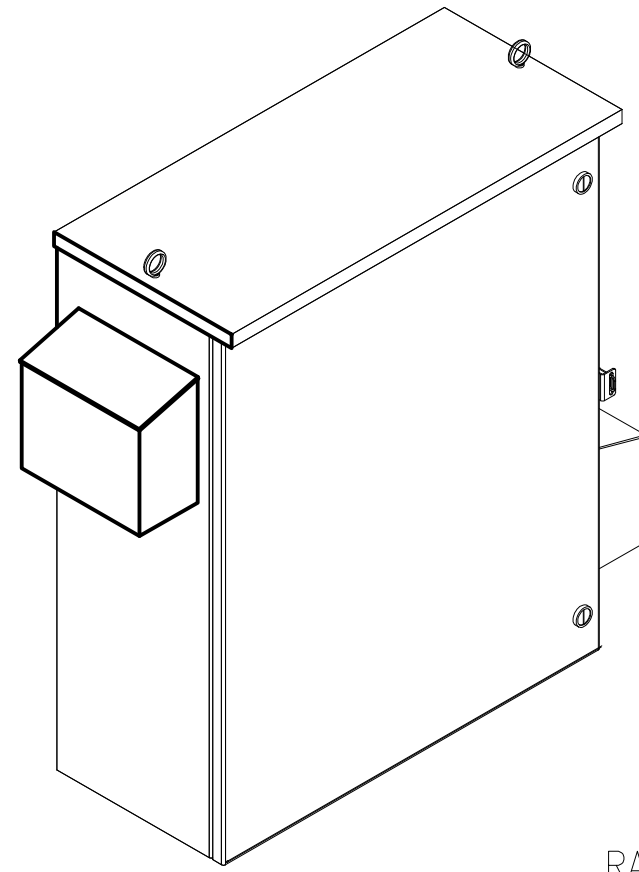

SIDE VIEW

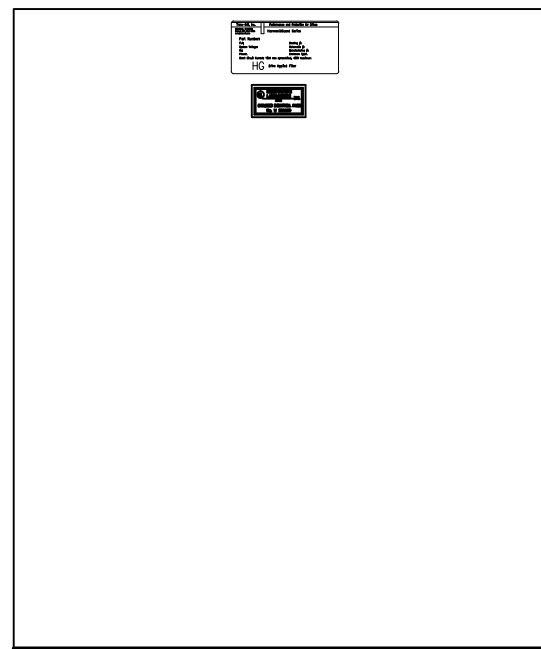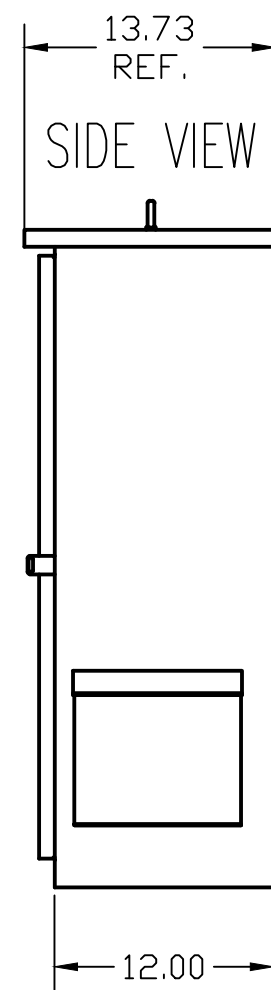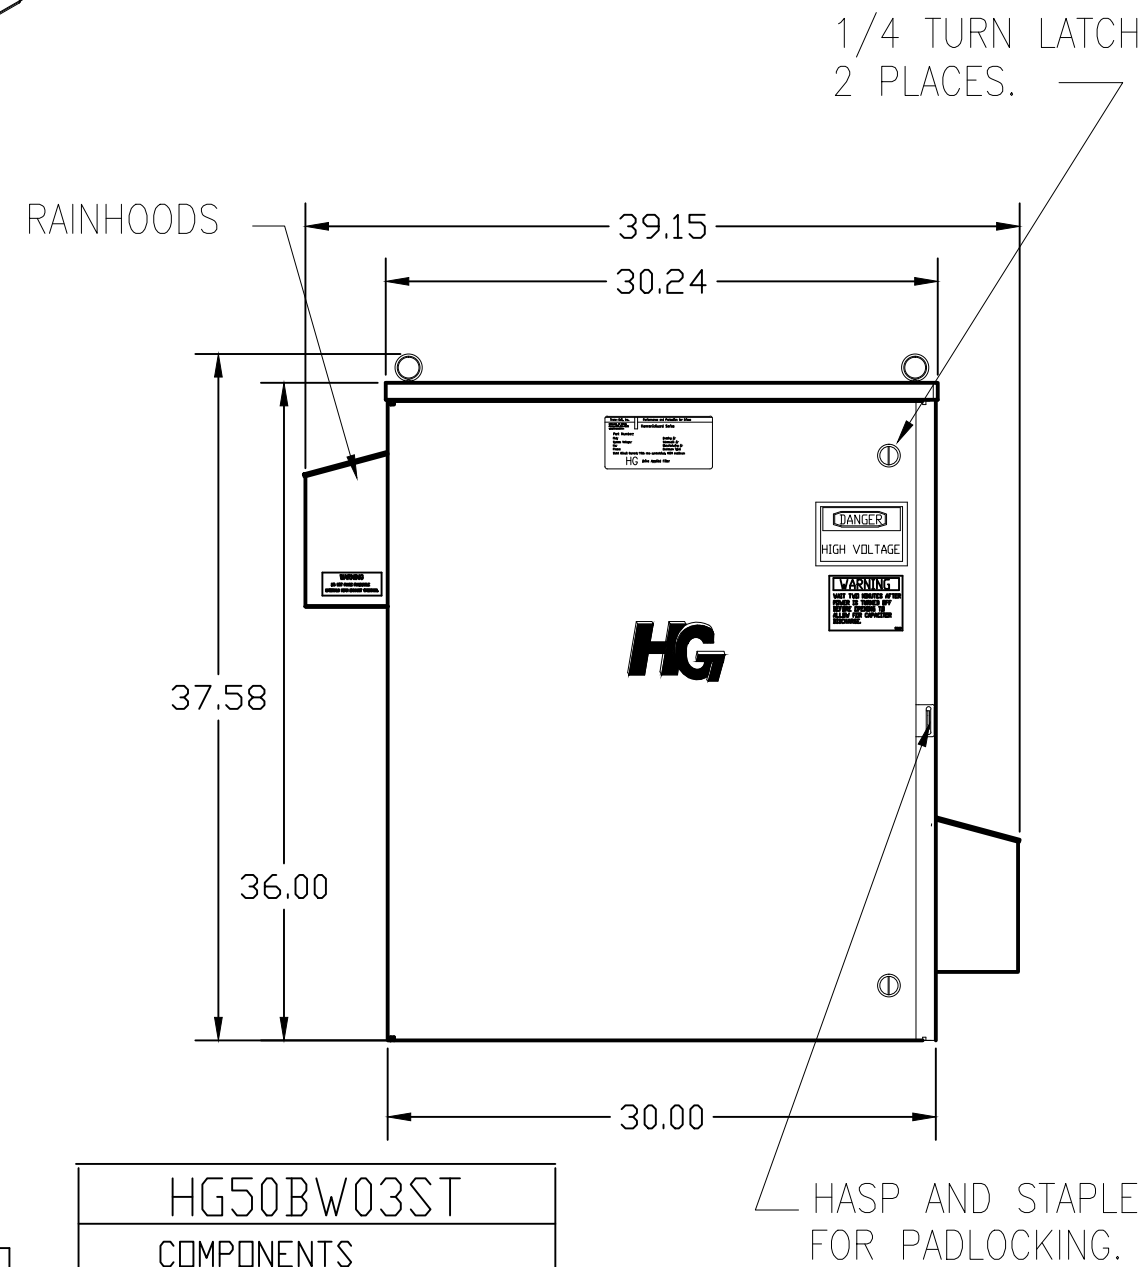

INSIDE DOOR

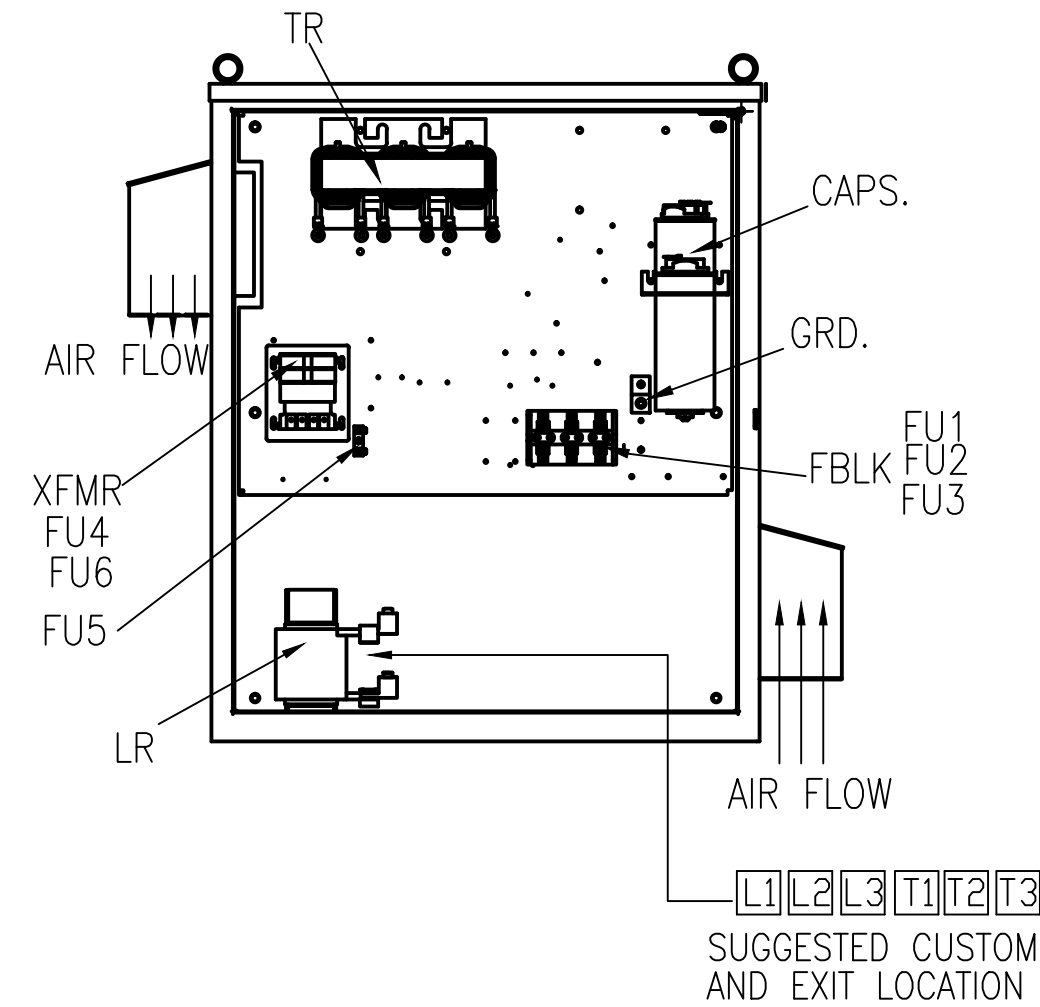

UNIT SPECIFICATIONS:					
KVAR HARMONIC	VOLT	HZ	PHASE	HP	
15	5TH	240	60	3	50
ENCLOSURE	UL TYPE 3R				
COLOR	WHITE				
APPROX.WT. LBS.	210				

HG50BW03ST	
COMPONENTS	
LINE REACTOR LR	X
TRAP REACTOR TR	X
CAPACITOR CAP	X
TRAP FUSING FU1,2,3	X
XFMR	X
XFMR FU4,6	X
XFMR FU5	X

CUSTOMER CONNECTIONS:

WIRE RANGE-250MCM-6

TIGHTENING TORQUE 275 IN-LB.

GROUND LUG:

WIRE RANGE-250MCM-6

TIGHTENING TORQUE 275 IN-LB.

CUSTOMER IS RESPONSIBLE FOR INSTALLATION TO MEET ALL NATIONAL AND LOCAL ELECTRICAL CODES.

TCI, LLC CLAIMS PROPRIETARY RIGHTS IN THE MATERIAL HEREIN DISCLOSED. IT IS SUPPLIED WITHOUT PREJUDICE TO ANY PATENT RIGHTS OF TCI AND MAY NOT BE REPRODUCED OR USED TO MANUFACTURE ANYTHING SHOWN THEREIN WITHOUT WRITTEN PERMISSION FROM TCI.				TOLERANCES (EXCEPT AS NOTED)	W132 N10611 Grant Drive Germantown, WI 53022
				DECIMAL	
				.XX ±.12	
				.XXX±.03	
	B 3033 UPDATE LAYOUT	2/24/14	DSW	FRACTIONAL ± 1/32	HG50BW03ST, 50HP 240/3/60 UL TYPE 3R
	A 2641 ADD EYEBOLTS	10/13/09	DSW	ANGULAR ± 1/2°	
	NO REVISION	DATE	BY	SCALE TO FIT	DRN. BY DSW DATE 12/22/08 DWG. NO. 103661DG SIZE C SHT. 1 OF 1