
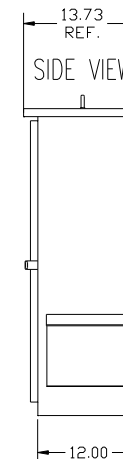
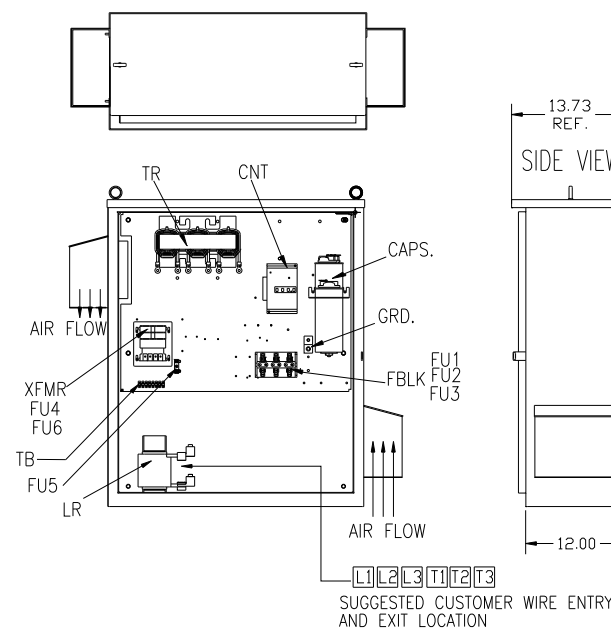
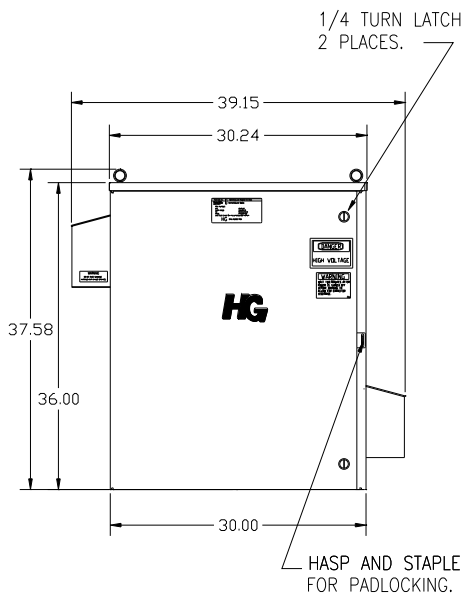
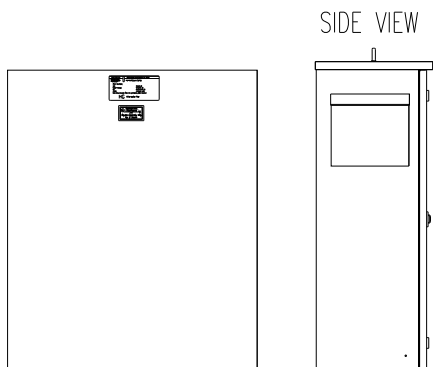
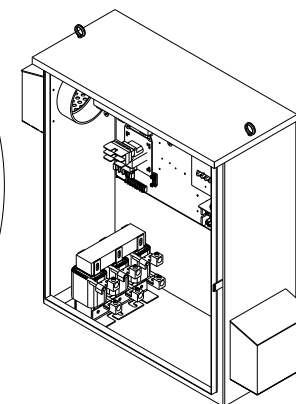
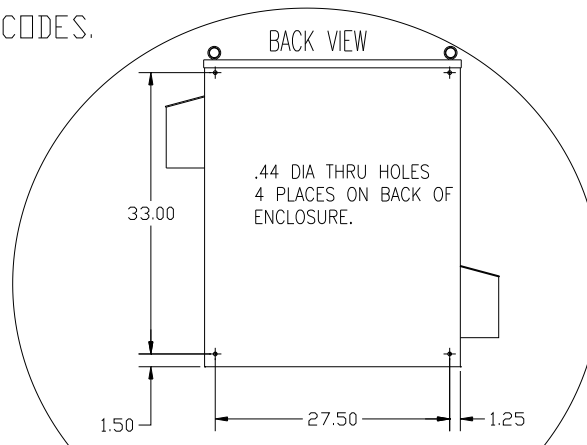


CUSTOMER IS RESPONSIBLE FOR INSTALLATION TO MEET ALL NATIONAL AND LOCAL ELECTRICAL CODES.

NOTE: USE ONLY HUBS OR FITTINGS THAT COMPLY WITH UL514B FOR TYPE 3R ENCLOSURES.

SEE DWG# 26900 FOR SCHEMATIC

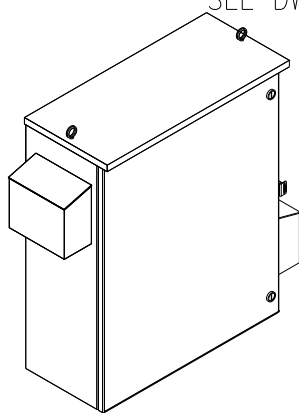

INSIDE DOOR

SIDE VIEW

SIDE VIEW

| UNIT SPECIFICATIONS: |          |            |    |       |    |
|----------------------|----------|------------|----|-------|----|
| KVAR                 | HARMONIC | VOLT       | HZ | PHASE | HP |
| 15                   | 5TH      | 240        | 60 | 3     | 50 |
| ENCLOSURE            |          | UL TYPE 3R |    |       |    |
| COLOR                |          | WHITE      |    |       |    |
| FEATURES             |          | CONTACTOR  |    |       |    |
| APPROX. WT. LBS.     |          | 215        |    |       |    |

| HG50BW03STC         |   |
|---------------------|---|
| COMPONENTS          |   |
| LINE REACTOR LR     | X |
| TRAP REACTOR TR     | X |
| CAPACITOR CAP       | X |
| TRAP FUSING FU1,2,3 | X |
| XFMR                | X |
| XFMR FU4,6          | X |
| XFMR FU5            | X |
| CNT                 | X |

CUSTOMER CONNECTIONS:

WIRE RANGE-250MCM-6

TIGHTENING TORQUE 275 IN-LB.

GROUND LUG:

WIRE RANGE-250MCM-6

TIGHTENING TORQUE 275 IN-LB.

| TOLERANCES (EXCEPT AS NOTED) |            |         |        |
|------------------------------|------------|---------|--------|
| DECIMAL                      | FRACTIONAL | ANGULAR | SCALE  |
| .XX ± .12                    | ± 1/32     | ± 1/2°  | TO FIT |
| XXX ± .03                    |            |         |        |

|         |          |          |             |
|---------|----------|----------|-------------|
| DRN. BY | DATE     | DATE     | DWG. NO.    |
| DSW     | 12/22/08 | 12/22/08 | 103716DG    |
| SCALE   | APPROV.  | BY       | SHT. 1 OF 1 |
| TO FIT  |          |          |             |

**TCL** 7878 N. 86th STREET MILWAUKEE, WI 53224

HG50BW03STC, 50HP  
240/3/60 UL TYPE 3R

| NO | REVISION           | DATE     | BY  |
|----|--------------------|----------|-----|
| 1  | 3033 UPDATE LAYOUT | 2/24/14  | DSW |
| 2  | 2641 ADD EYEBOLTS  | 10/21/09 | DSW |