

PB-POWER INPUT BLOCK:
 WIRE RANGE-#18 TO #4 AWG.
 TIGHTENING TORQUE 20 IN-LB.

GROUND LUG:
 WIRE RANGE-1/0 TO #14 AWG.
 1/0 AWG thru 2 AWG 50 IN-LBS. MAX.
 4 AWG thru 6 AWG 45 IN-LBS. MAX.
 8 AWG 40 IN-LBS. MAX.
 10 AWG thru 14 AWG 35 IN-LBS. MAX.


HATCHED AREAS ARE SUGGESTED
 CUSTOMER WIRE ENTRANCE AND EXIT LOCATIONS
 (BOTTOM ENTRANCE ALTERNATE-CONSULT TCI)

SEE 26822 FOR SCHEMATIC

CUSTOMER IS RESPONSIBLE FOR INSTALLATION
 TO MEET ALL NATIONAL AND LOCAL ELECTRICAL CODES.

UNIT SPECIFICATIONS:						
KVAR	HARMONIC	VOLT	HZ	PHASE	HP	
3	5TH	240	60	3	7.5	
ENCLOSURE	NEMA 1					
	WITH CONTACTOR					
APPROX.WT. LBS.	115					

SYMBOL	TCI PART NUMBER
LR	KDRC21T
TR	KTR3B65HG
CAP1,2,3,4	KCAP3A6A
XFMR.	23891
Fu1, 2, 3	15752
Fu4,6	24073
Fu5	13364
CNT	12434

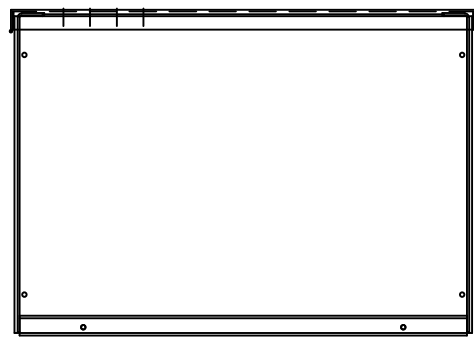

				TOLERANCES (EXCEPT AS NOTED)		W132 N10611 Grant Drive Germantown, WI 53022	
				DECIMAL		HG8BW01STC, 7.5HP	
				.XX ±.03		240/3/60, ENCLOSED, WITH CNT	
				.XXX±.01		DRN. BY DSW DATE 10/15/08 DWG. NO. 103588DG	
A COLOR WAS BLACK				FRACTIONAL		SCALE TO FIT	
2702 RVSD UL SHIELD				± 1/32		APRV.D. C	
NO REVISION				ANGULAR		SHT.1 OF1	
				± 1/2°			