
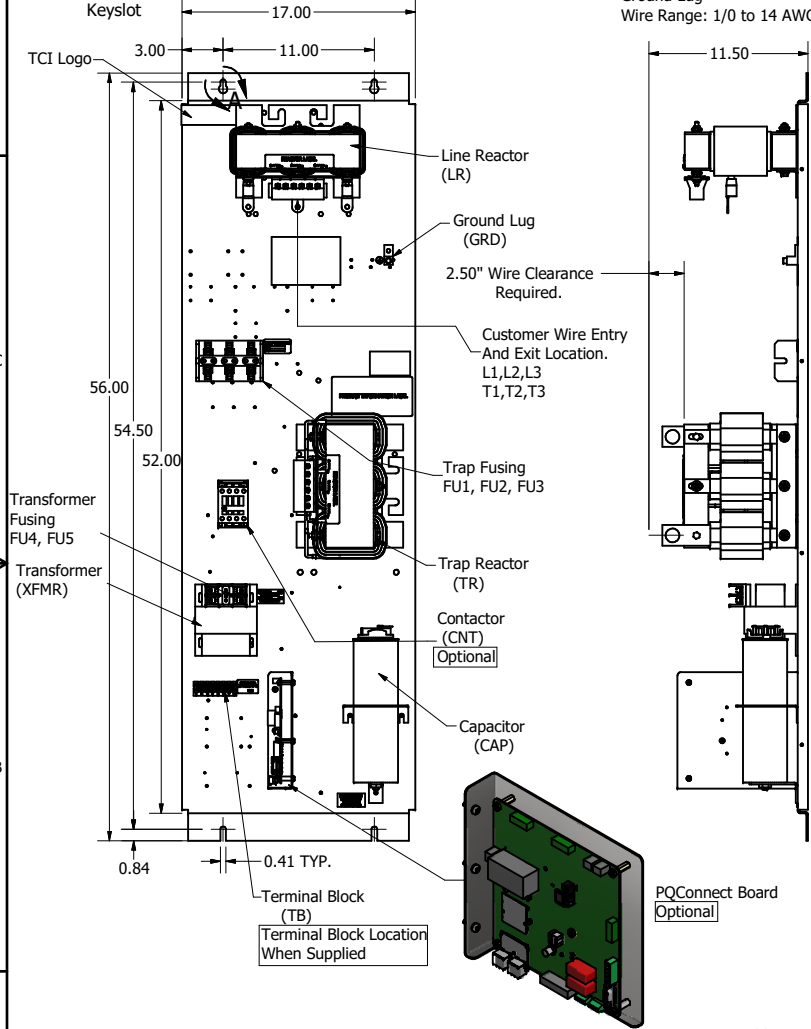


HGL Open Part Number	Schematic Drawing #	Approx Weight (LBS)
HGL0075CW0S0000	30807-1	180
HGL0075CW0C0000	30807	185
HGL0075CW0S1000	30807-PQ1	181
HGL0075CW0C1000	30807-PQ	186




Note: For Torque Information See IOM Manual.
 Customer Connections. L1, L2, L3, T1, T2, T3
 Wire Range: 1 AWG to 22 AWG.
 Ground Lug Wire Range: 1/0 to 14 AWG.

Note: Customer is responsible for proper cooling of filter components on open panels. Capacitors Maximum Ambient 50°C

HGP0075CW-----				
Components	0S0000/1S0000	0C0000/1C0000	0S1000/1S1000	0C1000/1C1000
Line Reactor (LR)	X	X	X	X
Trap Reactor (TR)	X	X	X	X
Capacitor (Cap)	X	X	X	X
Trap Fusing, FU1, FU2, FU3	X	X	X	X
Contactor (CNT)		X		X
Transformer (XFMR)		X	X	X
XFMR Fusing, FU4, FU5		X	X	X
PQConnect Board			X	X

Unit Specifications					
kVar	Harmonic	Volt	HZ.	Phase	HP
15	5TH	600	60	3	75

HGL Enclosed Type1 Part Number	Schematic Drawing #	Approx Weight (LBS)
HGL0075CW1S0000	30807-1	275
HGL0075CW1C0000	30807	280
HGL0075CW1S1000	30807-PQ1	276
HGL0075CW1C1000	30807-PQ	281

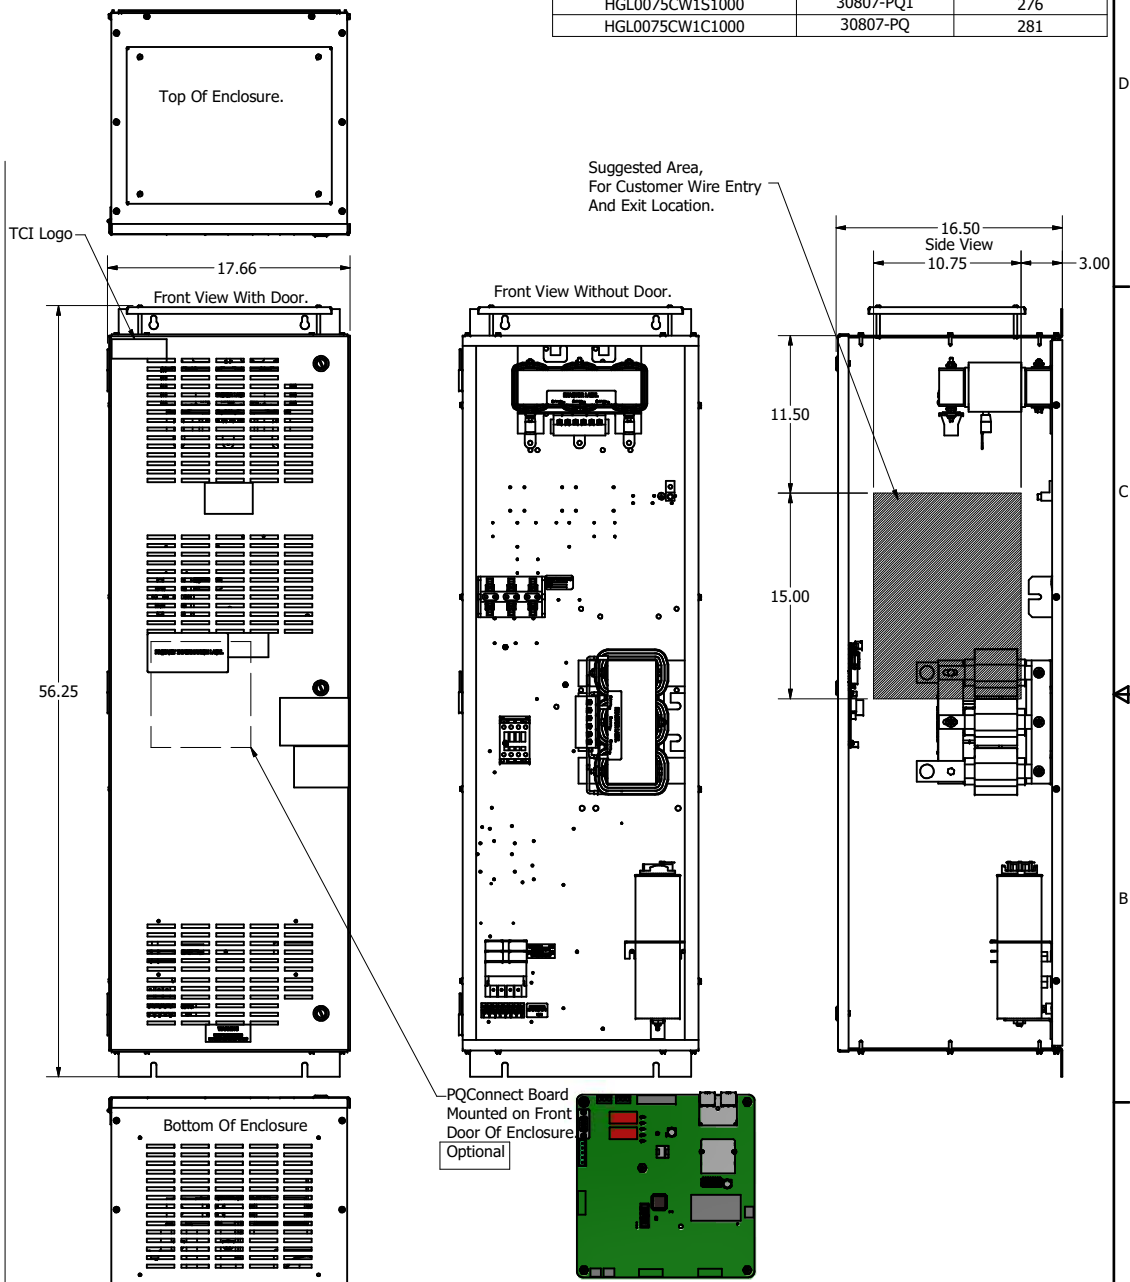

Customer Is Responsible For Installation to Meet All National And Local Electrical Codes. Material(s) Shall be RoHS Compliant

TCL, LLC CLAIMS PROPRIETARY RIGHTS IN THE MATERIAL HEREIN DISCLOSED. IT IS SUPPLIED WITHOUT PREJUDICE TO ANY PATENT RIGHTS OF TCL AND MAY NOT BE REPRODUCED OR USED TO MANUFACTURE ANYTHING SHOWN THEREIN WITHOUT WRITTEN PERMISSION FROM TCL.

REVISED	DATE	BY	SCALE	DATE	DATE	DATE	DATE
NO	4/3/19	DSW	1/6	10/3/17	10/3/17	10/3/17	10/3/17

107287DG

W132 N10611 Grant Drive
 Germantown, WI 53022

HarmonicGuard Low Capacitance
 HGL, 75HP, 600/3/60, Open and Type 1

1/6