





Unit Specifications					
kVar	Harmonic	Volt	HZ.	Phase	HP
120	5TH	600	60	3	800

Note: For Torque Information See IOM Manual.


Customer Connections:
L1, L2, L3, T1, T2, T3, and
Ground Lug.
Wire Range- Three , 600MCM-2AWG

L1,L2,L3
T1,T2,T3
Suggested Area,
For Customer Wire Entry
And Exit Location.

HGL Enclosed Type 1 Part Number	Schematic Drawing #	Approx Weight (LBS)
HGL0800CW1S0000	30807-1	1620
HGL0800CW1C0000	30807	1650
HGL0800CW1S1000	30807-PQ1	1621
HGL0800CW1C1000	30807-PQ	1650

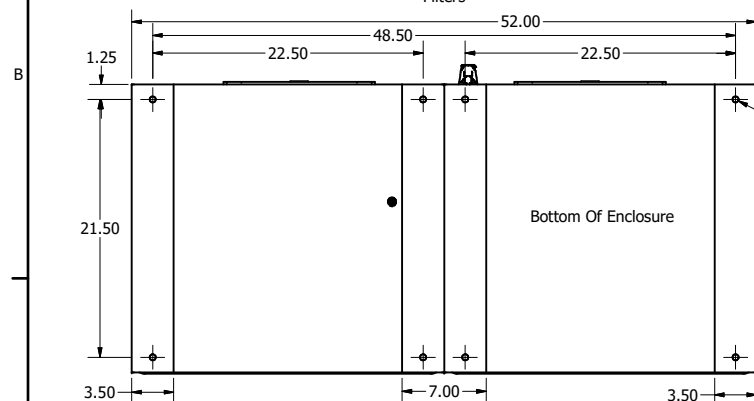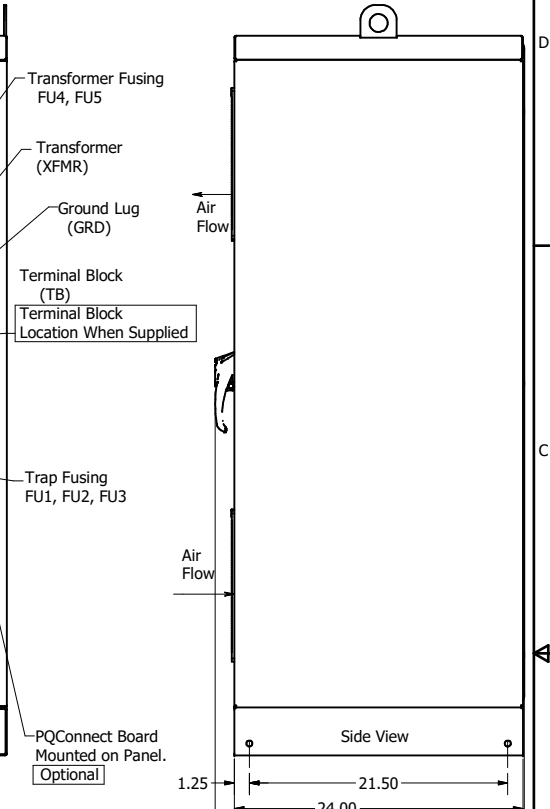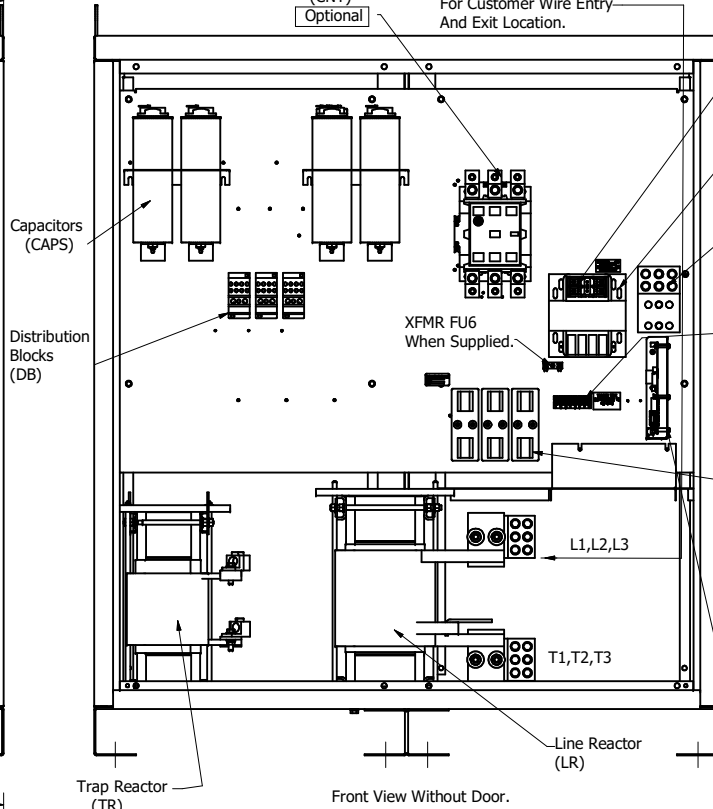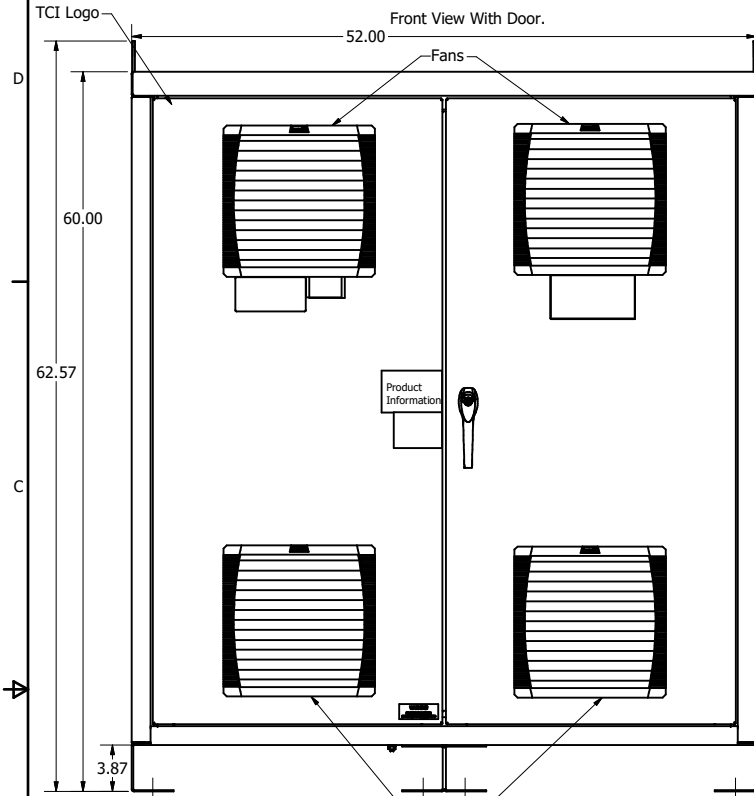

HGL0800CW-----				
Components	1S0000	1C0000	1S1000	1C1000
Line Reactor (LR)	X	X	X	X
Trap Reactor (TR)	X	X	X	X
Capacitor (Cap)	X	X	X	X
Trap Fusing, FU1, FU2, FU3	X	X	X	X
Contactant (CNT)		X		X
Transformer (XFMR)	X	X	X	X
XFMR Fusing, FU4, FU5	X	X	X	X
PQConnect Board			X	X



Customer Is Responsible For Installation to Meet All National And Local Electrical Codes.

Material(s) Shall be RoHS Compliant

TCI, LLC CLAIMS PROPRIETARY RIGHTS IN THE MATERIAL HEREIN DISCLOSED. IT IS SUPPLIED WITHOUT PREJUDICE TO ANY PATENT RIGHTS OF TCI AND MAY NOT BE REPRODUCED OR USED TO MANUFACTURE ANYTHING SHOWN THEREIN WITHOUT WRITTEN PERMISSION FROM TCI.					TOLERANCES (EXCEPT AS NOTED)	W132 N10611 Grant Drive Germantown, WI 53022 HarmonicGuard Low Capacitance HGL, 800HP, 600/3/60, Type 1 107300DG DATE 10/9/17 SCALE 1/8
					DECIMAL	
					.XX ±.25 .XXX ±.10	
					FRACTIONAL	
	B Add PQ Connect	4/3/19	DSW		± 1/16	DRN BY
	NO REVISION	DATE	BY		± 1°	DATE 10/9/17
						FILE
						SIZE
						SHT 1 OF 1