



HGP Part Number	HorsePower (HP)	kVar	Harmonic	Voltage (V)	Hz.	Phase
HGP0008AW3----	8	3	5th	480	60	3

HGP Part Number	Schematic Drawing #	Approx Weight (LBS)
HGP0008AW3S0000	28697-2S	105
HGP0008AW3C0000	28697-2	106
HGP0008AW3C000H	28697-2H	110
HGP0008AW3G0000	28697-2S	107
HGP0008AW3S1000	29597-PQ3	108
HGP0008AW3C1000	29597-PQ2	110
HGP0008AW3C100H	29597-PQ2H	118

Note: For Torque Information See IOM Manual

Customer Connections.
L1, T1, L2, T2, L3, T3
Wire Range: 18 AWG to 4 AWG.

Ground Lug
Wire Range: 1/0 to 14 AWG.

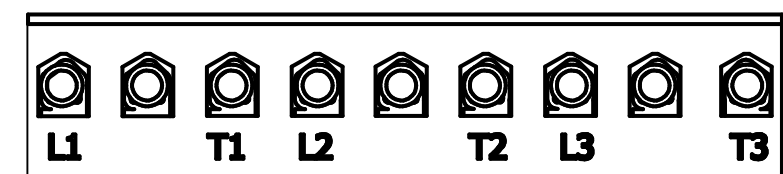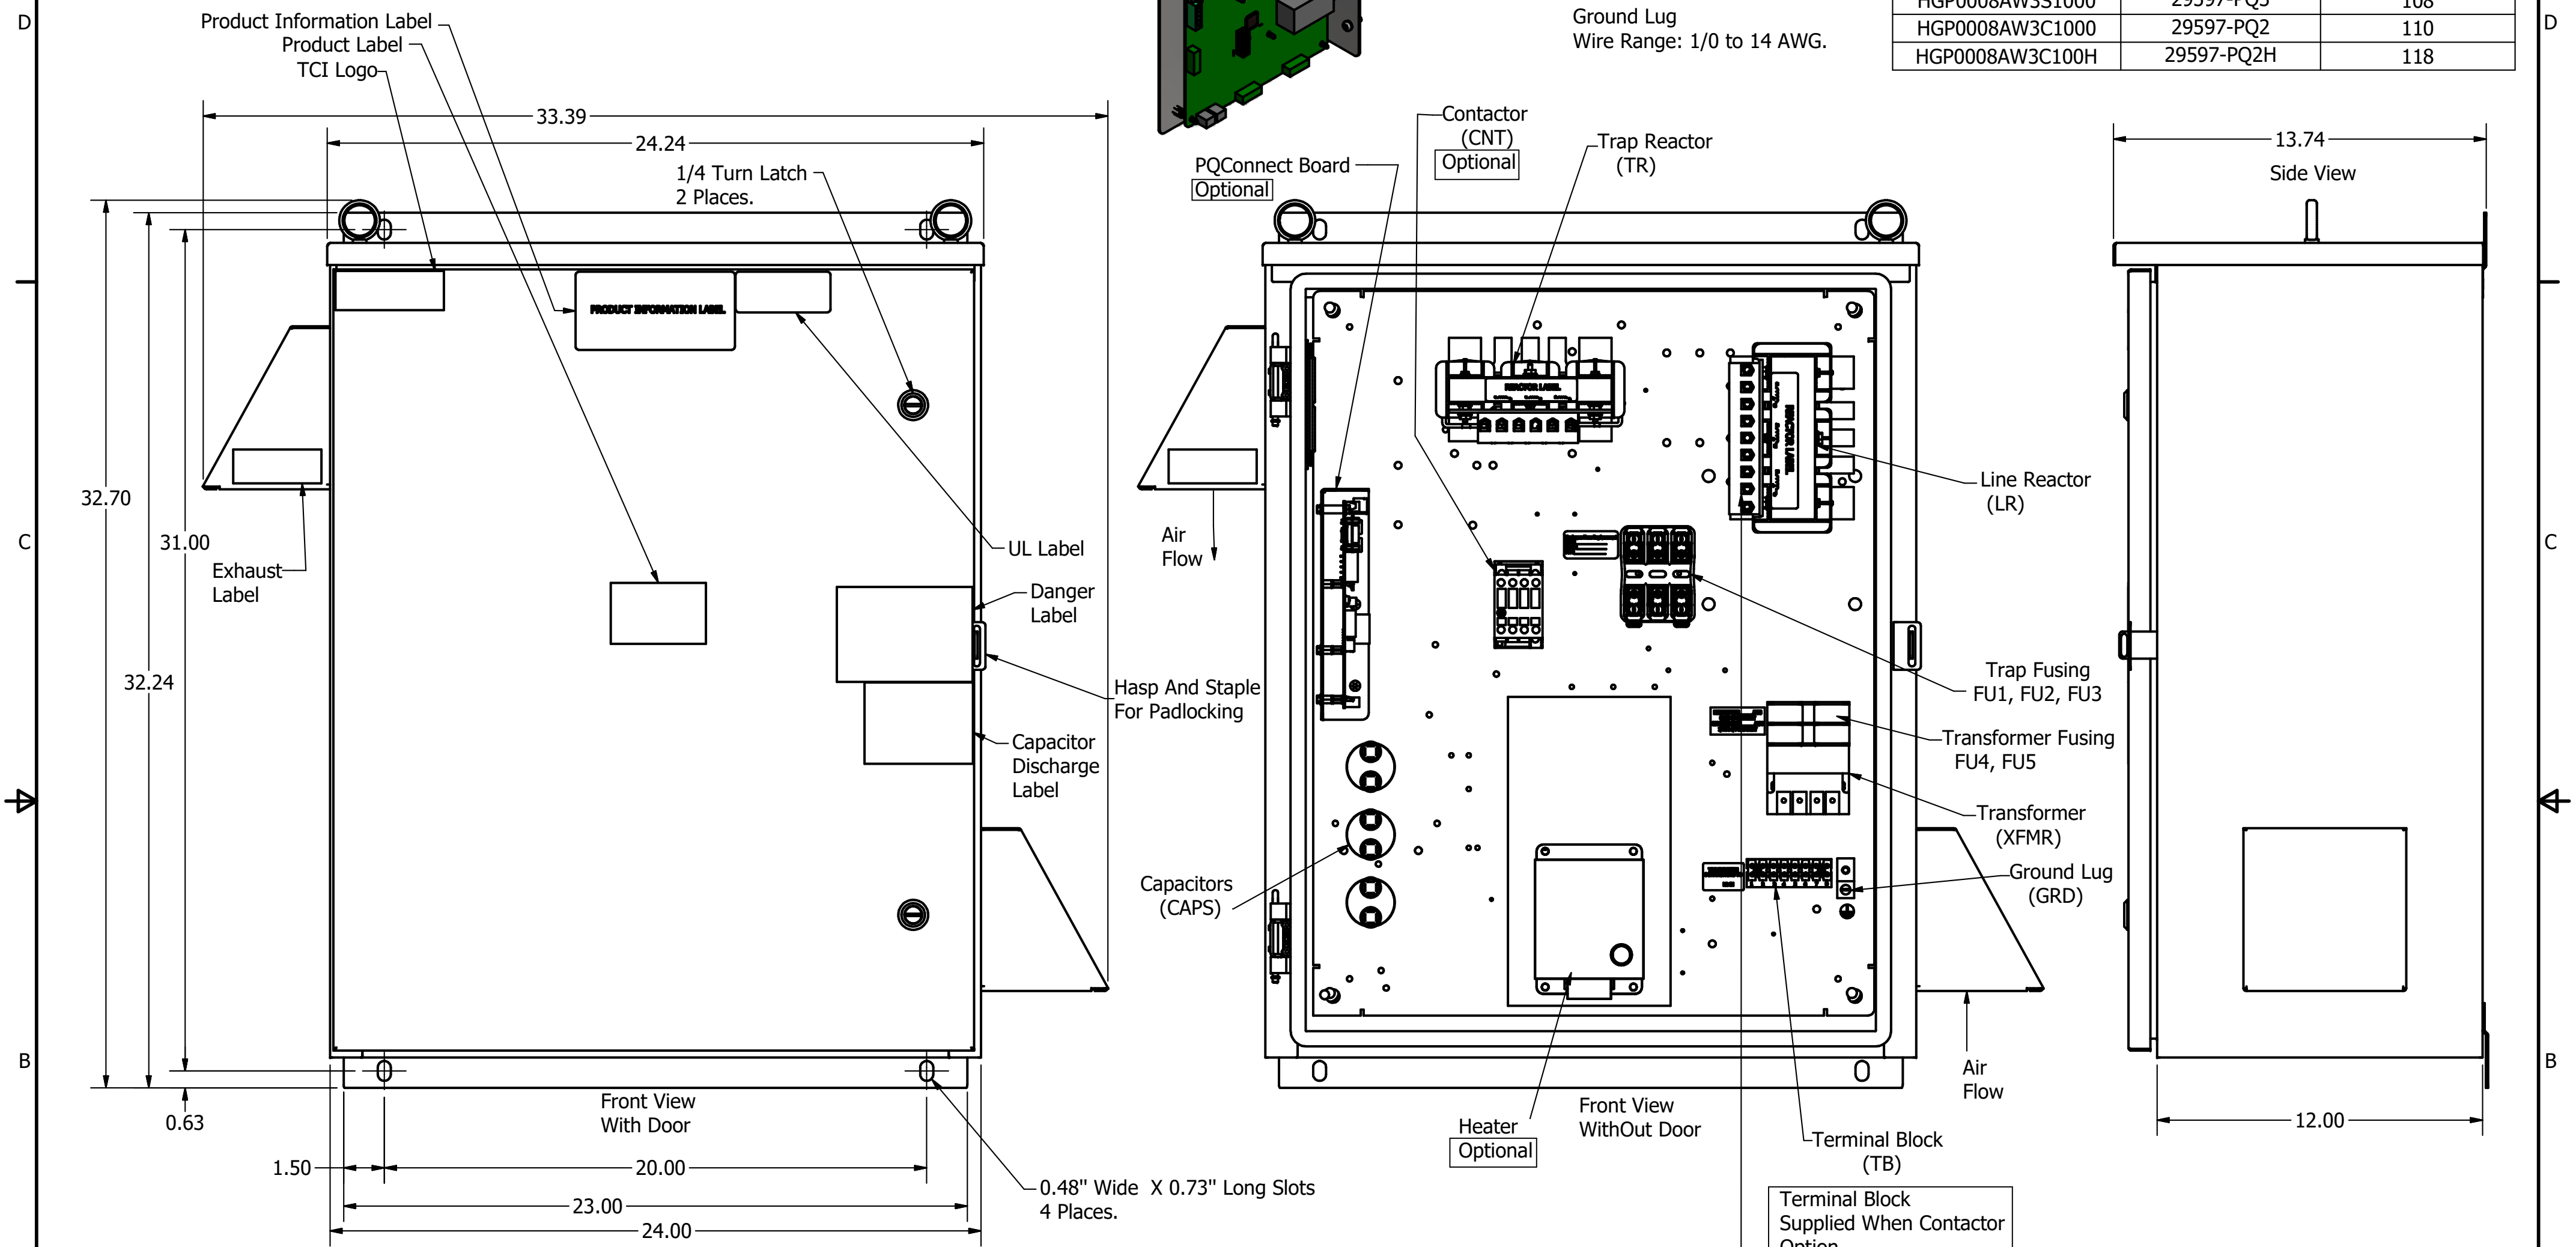

Suggested Customer Wire Entry And Exit Location.

HGP0008AW3----							
Components	S0000	C0000	C000H	G0000	S1000	C1000	C100H
Line Reactor (LR)	x	x	x	x	x	x	x
Trap Reactor (TR)	x	x	x	x	x	x	x
Capacitor (Cap)	x	x	x	x	x	x	x
Trap Fusing, FU1, FU2, FU3	x	x	x	x	x	x	x
Contactor (CNT)		x	x			x	x
Transformer (XFMR)	x	x	x	x	x	x	x
XFMR Fusing, FU4, FU5	x	x	x	x	x	x	x
Heater			x				x
PQConnect Board					x	x	x

NOTE: USE ONLY HUBS OR FITTINGS THAT COMPLY WITH UL514B FOR TYPE 3R ENCLOSURES

Customer Is Responsible For Installation to Meet All National And Local Electrical Codes.

Material(s) Shall be RoHS Compliant

TCI, LLC CLAIMS PROPRIETARY RIGHTS IN THE MATERIAL HEREIN DISCLOSED. IT IS SUPPLIED WITHOUT PREJUDICE TO ANY PATENT RIGHTS OF TCI AND MAY NOT BE REPRODUCED OR USED TO MANUFACTURE ANYTHING SHOWN THEREIN WITHOUT WRITTEN PERMISSION FROM TCI.	DRN BY	DATE	BY	SCALE	DATE	APRVD	SIZE	<p>W132 N10611 Grant Drive Germantown, WI 53022</p> <p>HarmonicGuard Passive HGP, 8HP, 480/3/60, Type 3R</p> <p>105551DG</p>
	B Add PQConnect	6/11/18		1/8	1/23/14		C	
	NO REVISION	DATE	BY	ANGULAR ± 1°				